

# Catalog of Pipes for Building Applications

| Water Supply | Hot Water Supply | Drain & Vent |



# Okubo Plumbing Co., Ltd

## Products for Building Applications

**VP and VU Pipes**  
**For drain and vent applications**




**Transparent DV Fittings**  
**For drain and vent applications**




**Transparent Fittings**  
**for Water Supply**  
**For water supply**



**HI-VP and VP Pipes**  
**For water supply**

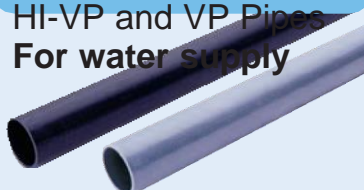

**HT-VP Pipes and Fittings**  
**For hot water supply**

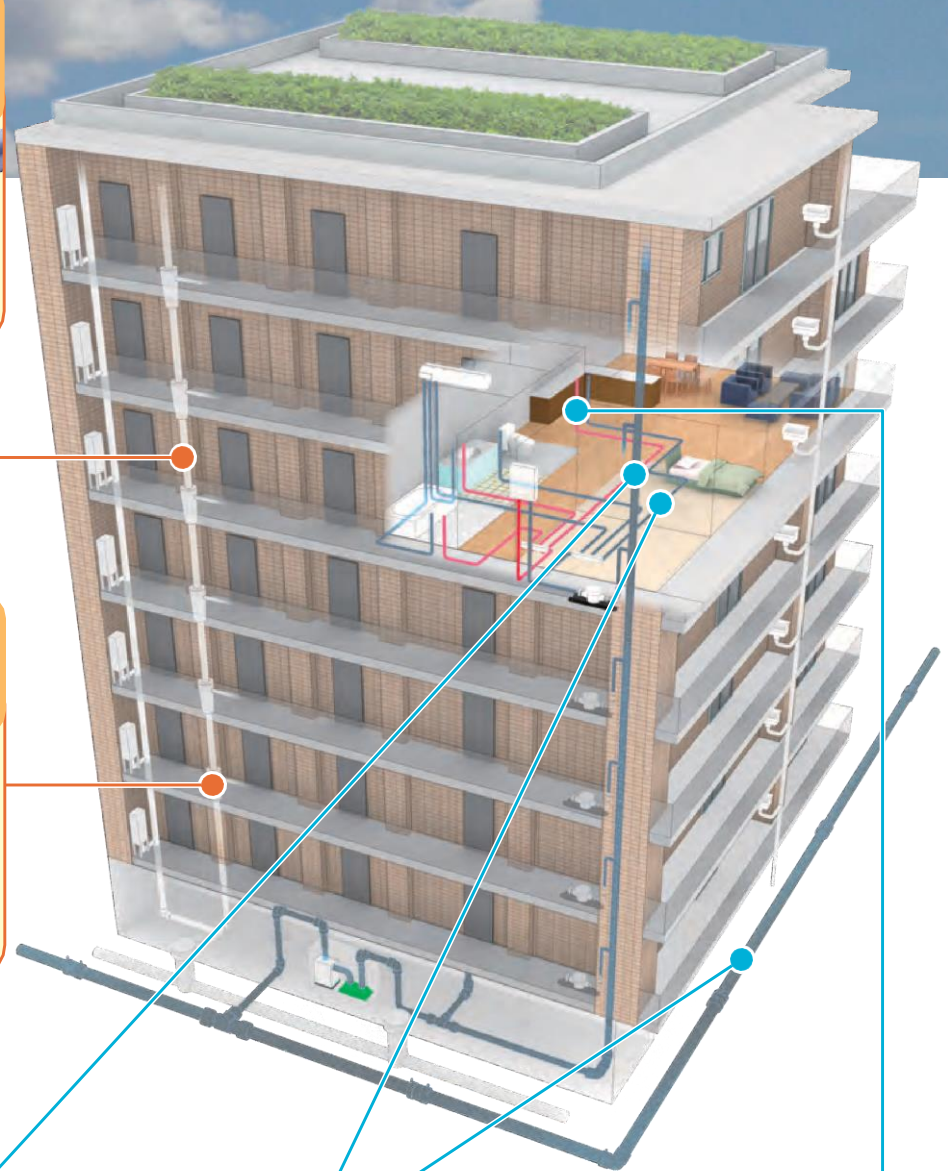

# Products Introduction

## For Water Supply

### OP HI-VP Pipes

**For water supply: Products conform to Japanese Industrial Standards JIS K6742.**

Impact-resistant PVC-U pipes

### OP HI-TS Fittings

**For water supply: Products conform to Japanese Industrial Standards JIS K6743.**

Impact-resistant PVC-U fittings

### For water supply pipes inside buildings and for piping in cold areas


These products are highly impact resistant even under low temperatures (low outdoor air temperatures) and minimize impact-induced damage during the cold season and when other plumbing work is conducted nearby.

Operating temperature and pressure

Operating temperature range	Normal temperature (5 to 35°C)
Operating pressure (hydrostatic pressure)	0.75MPa

**⚠ Note that the water-hammer pressure becomes greater as the pipe flow velocity increases. (Make sure that the pipe flow velocity does not exceed 2 m/sec as a general rule.)**

See page 5.

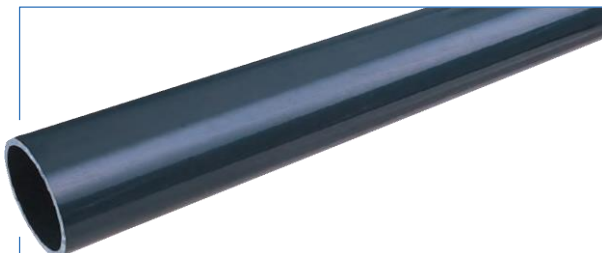

## Okubo Transparent Fittings for Water Supply

See page 14.

The transparent body enables to check the joint condition. It prevents plumbers from forgetting to apply adhesive.



\*Note: It may be difficult to insert the pipe all the way to the stopper depending on the type of fitting. In that case, insert the pipe to the following position: Zero point + Min. 1/3 L.



Available diameters (nominal diameters): 13mm to 50mm

## For Hot Water Supply

### OP HT Pipes and Fittings

**Products conform to Japanese Industrial Standards JIS K6776/6777.**

Thermal-resistant PVC-C pipes and fittings

### Lightweight and thermal-resistant pipes suitable for hot water supply

These pipes are made from polyvinyl chloride and offer high corrosion resistance and excellent workability for hot water supply. Unlike metal pipes, these products eliminate the water quality degradation, electrolytic corrosion and electrical leakage accidents due to rusting or corrosion.

Operating temperature and pressure

● **Nominal diameters of 50 and less**  
Operating temperature and maximum operating pressure for HT pipes (JIS K6776)

Operating temperature (°C)	5 to 40	41 to 60	61 to 70	71 to 90
Maximum Operating pressure (MPa)	1.0	0.6	0.4	0.2

● **Nominal diameters of 65 and more**  
Operating temperature and maximum operating pressure for HT pipes (manufacturer's standards)

Operating temperature (°C)	5 to 40	41 to 60	61 to 70	71 to 85
Maximum Operating pressure (MPa)	1.0	0.4	0.25	0.15

\*1. Continuous normal operating temperature: maximum of 85°C for pipes with nominal diameters 50 and less, maximum of 80°C for pipes with nominal diameters 65 and more

\*2. Maximum operating pressure: Hydrostatic pressure + Water-hammer pressure

See page 17.



## For Drain and Vent

### OP VP and VU Pipes OP DV and VU-DV Fittings

See page 21.

**VP pipes and VU pipes (Products conform to Japanese Industrial Standards JIS K6741)  
DV and VU-DV fittings (Products conform to Japanese Industrial Standards JIS K6739  
and Japan PVC Pipe and Fittings Association standards AS38)**

PVC-U pipes and fittings



Piping in individual ownership space




## For Drain, Vent and Ventilation

### OP Transparent DV and VU-DV Fittings

See page 32.

The transparent body enables to check the joint condition.

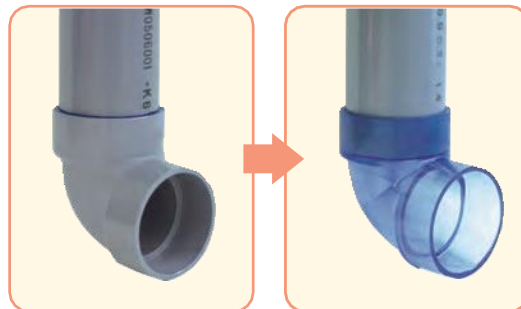

- It prevents plumbers from forgetting to apply adhesive and from not inserting the pipe all the way!

## For Drain and Sewage

### OP PVC-U Mini-Manholes

See page 35.

Space saving and speedy installation



# Contents

## Product Specifications

I PVC-U Pipes and Fittings for Water Supply and Pressure Pipeline .....	5
1. Pipes .....	5
• HI-VP Pipes and VP Pipes for Water Supply	
• HI-VP Pipes for General Purposes	
• VP Pipes for General Purposes	
• VM Pipes	
2. TS Fittings .....	6
• HI-TS Fittings and TS Fittings for Water Supply	
• HI-TS Fittings and TS Fittings for General Purposes	
3. Transparent Fittings for Water Supply .....	14
4. TS Flanges and KV Packings .....	16
II HT Pipes and Fittings for Hot Water Supply .....	17
1. Pipes .....	17
2. Fittings and Accessories .....	17
III PVC-U Pipes and Fittings for Drain and Vent .....	21
1. Pipes .....	21
2. DV and VU-DV Fittings .....	21
3. Transparent DV and VU-DV Fittings .....	32
4. PVC-U Mini-Manhole Product Lineup .....	35
VI Adhesives .....	36
1. Vinyl-Base Adhesives .....	36
2. Selection of Vinyl-Base Adhesive to Use .....	37
3. Lubricants for Rubber Ring Joints .....	37
4. Amount of Adhesive and Lubricant to Apply .....	37

## Reference

I Performance and Quality .....	38
1. Operating Temperature and Pressure .....	38
2. Performance Specification for VP and HI-VP Pipes for Water Supply .....	38
3. Performance Specification for VP Pipes for General Purposes .....	38
4. Performance Specification for HT-VP Pipes for Hot Water Supply .....	38
General Properties of VP, HI-VP and HT-VP Products .....	39
6. Chemical Resistance of VP and HI-VP Products .....	39
7. Chemical Resistance of HT-VP Products .....	39
II Installation Design .....	40
1. Installation Design for HT Pipes for Hot Water Supply .....	40
2. Installation Design for Drain and Vent Pipes .....	46
III Bonding Techniques .....	47
1. Bonding HI-TS and TS Products .....	47
2. Bonding HT-TS Products .....	48
3. Bonding DV Products .....	49
IV Preventing Solvent Cracking .....	50
V User Instructions .....	52

# Product Specifications

## I PVC-U Pipes and Fittings for Water Supply and Pressure Pipeline



Meaning of symbols

JIS K6741: Product conforms to Japanese Industrial Standards JIS K6741

JIS K6742: Product conforms to Japanese Industrial Standards JIS K6742

AS20: Product conforms to Japan PVC Pipe and Fittings Association's standards and approved by Japan Water Works Association

### 1. Pipes

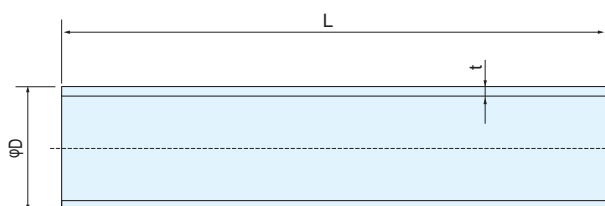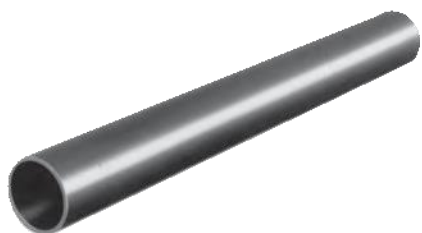

#### HI-VP Pipes for Water Supply

Code No. 6001

(Japanese Industrial Standards JIS K6742 : 2007)

#### VP Pipes for Water Supply

Code No. 1001

(Japanese Industrial Standards JIS K6742 : 2007)

Unit : mm

Unit : mm

Nominal Dia.	Outside Dia.D			Thickness t		Approx. Inside Dia. (Reference)	Length +30 L -10	Reference Weight				Standards
	Basic Dimension	Max./Min. OD Tolerance	Average OD Tolerance	Basic Dimension	Tolerance			VP		HI-VP		
								g/m	kg/piece	g/m	kg/piece	
13	18	±0.2	±0.2	2.5	±0.2	13	4000	174	0.696	170	0.680	JIS K 6742
16	22	±0.2	±0.2	3.0	±0.3	16	4000	256	1.024	251	1.004	
20	26	±0.2	±0.2	3.0	±0.3	20	4000	310	1.240	303	1.212	
25	32	±0.2	±0.2	3.5	±0.3	25	4000	448	1.792	439	1.756	
30	38	±0.3	±0.2	3.5	±0.3	31	4000	542	2.168	531	2.124	
40	48	±0.3	±0.2	4.0	±0.3	40	★ <sub>2</sub> 4000	791	3.164	774	3.096	
							5000		3.955		3.870	
50	60	±0.4	±0.2	4.5	±0.4	51	★ <sub>2</sub> 4000	1122	4.488	1098	4.392	
							5000		5.610		5.490	
65	76	±0.5	±0.2	4.5	±0.4	67	★ 4000 ★ 5000	1445	5.780	1415	5.660	
75	89	±0.5	±0.2	5.9	±0.4	77	★ <sub>2</sub> 4000	2202	8.808	2156	8.624	JIS K 6742
							5000		11.010		10.780	
100	114	±0.6	±0.2	7.1	±0.5	100	★ <sub>2</sub> 4000 5000	3409	13.636 17.045	3338	13.352 16.690	
125	140	±0.8	±0.3	7.5	±0.5	125	★ 4000 ★ 5000	4464	17.856	4370	17.484	AS20
150	165	±1.0	±0.3	9.6	±0.6	146	★ <sub>2</sub> 4000	6701	26.804	6561	26.244	JIS K 6742
							5000		33.505		32.805	

- Notes
1. The "★" mark indicates a made-to-order product, and the "★<sub>2</sub>" mark indicates a made-to-order VP product.
  2. The maximum/minimum OD tolerance is the difference between the basic dimension and the maximum/minimum outside diameter measured at randomly selected cross section.
  3. The average OD tolerance is the difference between the basic dimension and the average outside diameter obtained by averaging diameters measured in two directions perpendicular to each other at randomly selected cross section.
  4. The thickness applies to any location on the circumference of the pipe.
  5. For pipe lengths other than those listed above, contact our company.
  6. The reference weights are calculated by the basic dimension and pipe material density of 1.43 g/cm<sup>3</sup> for VP or 1.40 g/cm<sup>3</sup> for HI-VP.

#### HI-VP Pipes for General Purposes

Code No. 6001

(Japanese Industrial Standards JIS K 6741 : 2007)

Unit : mm

Nominal Dia.	Outside Dia.			Thickness		Approx. Inside Dia. (Reference)	Length	Reference Weight		Standards
	Basic Dimension	Max./Min. OD Tolerance	Average OD Tolerance	Min. Dimension	Tolerance			Weight/m (g/m)	Weight/m (kg/piece)	
65	76.0	±0.5	±0.2	4.1	+0.8	67	4000	1415	5.7	JIS K 6741
125	140.0	±0.8	±0.3	7.0	+1.0	125	4000	4370	17.5	
200	216.0	±1.3	±0.7	10.3	+1.4	194	4000	10129	40.5	
250	267.0	±1.6	±0.9	12.7	+1.8	240	4000	15481	61.9	
300	318.0	±1.9	±1.0	15.1	+2.2	286	4000	21962	87.8	

Note For nominal diameters smaller than those listed above, refer to the section for HI pipes for water supply.

#### VP Pipes for General Purposes

Code No. 1001

(Japanese Industrial Standards JIS K 6741 : 2007)

Unit : mm

Nominal Dia.	Outside Dia.			Thickness		Approx. Inside Dia. (Reference)	Length	Reference Weight		Standards
	Basic Dimension	Max./Min. OD Tolerance	Average OD Tolerance	Min. Dimension	Tolerance			Weight/m (g/m)	Weight/m (kg/piece)	
40	48.0	±0.3	±0.2	3.6	+0.8	40	4000	791	3.2	JIS K 6741
50	60.0	±0.4	±0.2	4.1	+0.8	51	4000	1122	4.5	
65	76.0	±0.5	±0.3	4.1	+0.8	67	4000	1445	5.8	
75	89.0	±0.5	±0.3	5.5	+0.8	77	4000	2202	8.8	
100	114.0	±0.6	±0.4	6.6	+1.0	100	4000	3409	13.6	
125	140.0	±0.8	±0.5	7.0	+1.0	125	4000	4464	17.9	
150	165.0	±1.0	±0.5	8.9	+1.4	146	4000	6701	26.8	
200	216.0	±1.3	±0.7	10.3	+1.4	194	4000	10129	40.5	
250	267.0	±1.6	±0.9	12.7	+1.8	240	4000	15481	61.9	
300	318.0	±1.9	±1.0	15.1	+2.2	286	4000	21962	87.8	

Note For nominal diameters of 13 to 30, use VP pipes for water supply.



HI-VP pipes and VP pipes for general purposes cannot be used as pipes for drinking water.

Nominal Dia.	Outside Dia.		Thickness		Approx. Inside Dia. (Reference)	Length	Reference Weight		Standards
	Basic Dimension	Average OD Tolerance	Min. Dimension	Tolerance			Weight/m (g/m)	Weight/m (kg/piece)	
350	370.0	±1.2	14.3	+2.0	339	4000	24380	97.5	JIS K 6741
400	420.0	±1.3	16.2	+2.2	385	4000	31298	125.2	
★450	470.0	±1.5	18.1	+2.6	431	4000	39272	157.1	
500	520.0	±1.6	20.0	+2.8	477	4000	47935	191.7	

Note The "★" mark indicates a made-to-order product.

Meaning of symbols


JIS K6743: Product conforms to Japanese Industrial Standards JIS K6743

AS21: Product conforms to Japan PVC Pipe and Fittings Association's standards and approved by Japan Water Works Association

Ⓜ: Product conforms to the manufacturer's standards

## 2. TS Fittings

### Common joint dimensions

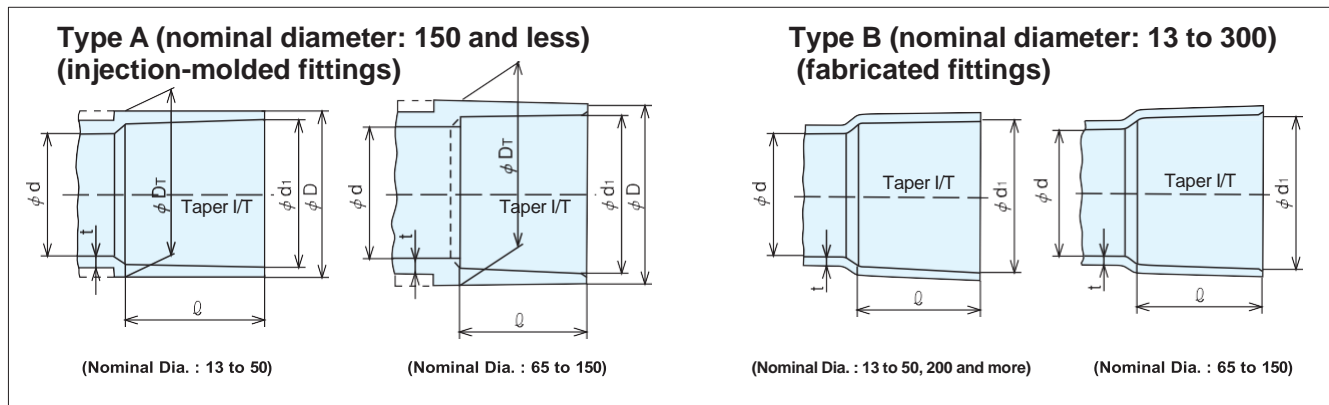

Nominal Dia.	d <sub>1</sub>	Tolerance of d <sub>1</sub>	D	D <sub>T</sub>	Tolerance of D, D <sub>T</sub>	I/T	ℓ	d (min.)	t (min.)
13	18.40	±0.20	24	24	-0.6	1/30	26	13	2.7
16	22.40	±0.20	29	29	-0.7	1/34	30	16	2.7
20	26.45	±0.20	33	33	-0.8	1/34	35	20	3.2
25	32.55	±0.25	40	40	-1.0	1/34	40	25	3.6
30	38.60	±0.25	46	46	-1.0	1/34	44	31	3.6
40	48.70	±0.30	57	57	-1.2	1/37	55	40	4.1
50	60.80	±0.30	70	70	-1.5	1/37	63	51	4.5
65	76.60	±0.30	87	88.5	-1.5	1/48	61	67	4.1
75	89.60	±0.30	102	104.5	-1.5	1/49	64	77	7.5
100	114.70	±0.30	130	133.5	-1.8	1/56	84	100	9.4
125	140.85	±0.35	157	161	-1.8	1/58	104	125	7.0
150	166.00	±0.40	186	190	-2.0	1/63	132	146	12.2
200	217.90	±0.80	—	—	—	1/50	200	194	10.3
250	269.30	±0.90	—	—	—	1/50	250	240	12.7
300	320.70	±1.00	—	—	—	1/50	300	286	15.1

Notes 1. There is no limit on the plus tolerances of D and D<sub>T</sub>.

2. The thickness value t for Type B indicates the thickness of the unfabricated part.


3. The tolerance of ℓ is  $+4_{-0.5}$  mm for nominal diameters 150 mm and less and  $+10$  mm for nominal diameters 200 mm and more.

**⚠ Be sure to use the Tough dyne HI adhesive (see page 36) for the bonding HI pipes and fittings.**


**HI-TS Sockets**
**Code No. 6011**
**TS Sockets**
**Code No. 5011**

Unit : mm

(Abbreviation : S)


**Type A**  
(Nominal Dia. : 150 and less)

(Abbreviation : RS)


**Type A**  
(Nominal Dia. : 150 x 100 and less)


Nominal Dia.	Z	L	Standards
13	5	57	JIS K 6743
16	7	67	
16x13	5	61	
20	7	77	
20x13	7	68	
20x16	6	71	
25	7	87	
25x13	20	86	
25x16	15	85	
25x20	9	84	
30	7	95	
30x20	14	93	
30x25	9	93	
40	7	117	
40x20	23	113	AS21
40x25	19	114	JIS K 6743
40x30	15	114	
50	7	133	AS21
50x25	37	140	
50x30	29	136	JIS K 6743
50x40	18	136	

Nominal Dia.	Z	L	Standards
65	23	145	AS21
65x 50	25	149	
75	27	155	JIS K 6743
75x 50	38	165	
75x 65	31	156	(M)
100	32	200	JIS K 6743
100x 75	42	190	
125	22	230	(M)
125x100	42	230	AS21
150	36	300	JIS K 6743
150x100	79	295	

**HI-TS Tees**
**Code No. 6013**
**TS Tees**
**Code No. 5013**

Unit : mm

(Abbreviation : T) Type A



Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	H	I	Standards
13	10	10	36	36	JIS K 6743
16	13	13	43	43	
16x13	11	12	41	38	
20	15	15	50	50	
20x13	11	14	46	40	
20x16	13	15	48	45	
25	18	18	58	58	
25x13	11	17	51	43	
25x16	13	18	53	48	
25x20	15	18	55	53	
30	21	21	65	65	
30x13	11	20	55	46	
30x16	15	21	57	51	
30x20	15	21	59	56	
30x25	18	21	62	61	
40	27	27	82	82	
40x13	11	26	66	52	
40x16	13	27	68	57	
40x20	15	27	70	62	
40x25	18	27	73	67	
40x30	21	27	76	71	


Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	H	I	Standards
50	33	33	96	96	JIS K 6743
50x 13	11	32	74	58	
50x 16	16	34	76	63	
50x 20	15	33	78	68	
50x 25	18	33	81	73	
50x 30	21	33	84	77	AS21
50x 40	27	33	90	88	
65	49	49	110	110	
65x 50	40	41	101	104	JIS K 6743
75	56	56	120	120	
75x 25	29	48	93	88	
75x 40	36	47	100	102	
75x 50	41	47	105	110	AS21
75x 65	49	56	113	117	
100	68	68	152	152	JIS K 6743
100x 50	41	59	125	122	
100x 75	56	68	140	132	
125	86	86	190	190	(M)
125x 75	64	66	168	150	
125x100	73	85	177	169	JIS K 6743
150	98	98	230	230	
150x 75	63	94	195	158	
150x100	76	98	208	182	(M)
150x125	87	101	219	205	

- Notes 1. When uneven settlement or a change in water pressure is expected, SGR-NA Tees or cast-iron SGR T-shape pipes should be used for branching pipes with nominal diameter of 125 and more.  
2. Nominal diameter 125 x 75 is not available for HI-VP products.

**HI-TS Elbows**
**Code No. 6012**
**TS Elbows**
**Code No. 5012**

Unit : mm


(Abbreviation : L) Type A



Nominal Dia.	Z	H	Standards
13	10	36	JIS K 6743
16	13	43	
20	15	50	
20x13	12 (side 20) 15 (side 13)	47 (side 20) 41 (side 13)	(M)
25	18	58	JIS K 6743
30	21	65	
40	27	82	
50	33	96	
65	49	110	AS21
75	56	120	
100	69	153	
125	88	192	(M)
150	98	230	

- Notes 1. Elbow part must not be applied with bending force or vibration.  
2. HI 90° Bends, TS 90° Bends or SGR 90° Bends is recommended for buried applications.  
3. The dashed line in the diagram indicates the shape of elbows with nominal diameters of 50 and less.

(Abbreviation : 45L) Type A

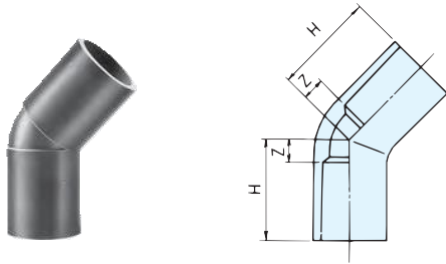

Nominal Dia.	Z	H	Standards
13	7	33	JIS K 6743
16	8	38	(M)
20	9	44	JIS K 6743
25	11	51	
30	12	56	
40	14	69	
50	17	80	
75*	33	97	(M)
100	38	122	

Notes 1. The HI-VP products with nominal diameter of 75 mm are now under planning.  
 2. The (Z) mark indicates that the product is manufactured by Maezawa Kasei Industries Co., Ltd.


## &lt;Reference&gt; Guideline dimensions for S Bends formed with TS 45° Elbows

## Calculation of guideline dimensions of S Bends formed with TS 45° Elbows

Item	Formula
Length of Diagonal Section	$A=2Z+B$
Cut Pipe Length	$B=2\ell+C$
Distance between Fittings	$C=B-2\ell$
Distance between Staggered Pipes	$H=A\sin\theta$
Effective Length of S-shape Section	$L=2Z+A\cos\theta$

## Trigonometric Function

$\sin 45^\circ$	0.707
$\cos 45^\circ$	0.707

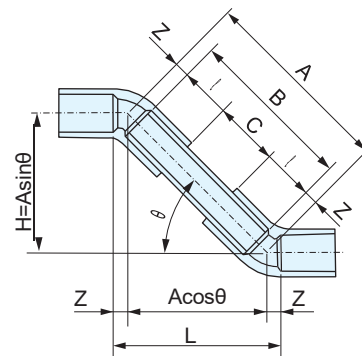

## Results of calculations of guideline dimensions for S Bends formed with TS 45° Elbows


Unit : mm

Nominal Dia.	TS 45° Elbow Dimension		Calculation Results by Joint Type									
	Effective Length	Length of Socket	When C = 0					When H = 200 mm				
	Z	$\ell$	A	B	C	L	H	A	B	C	L	H
13	7	26	66	52	0	61	47	283	269	217	214	200
16	8	30	76	60	0	70	54	283	267	207	216	200
20	9	35	88	70	0	80	62	283	265	195	218	200
25	11	40	102	80	0	94	72	283	261	181	222	200
30	12	44	112	88	0	103	79	283	259	171	224	200
40	14	55	138	110	0	126	98	283	255	145	228	200
50	17	63	160	126	0	147	113	283	249	123	234	200
75	33	64	194	128	0	203	137	283	217	89	266	200
100	38	84	244	168	0	249	173	283	207	39	276	200

Note The above table shows the results of calculations when  $Z \cdot \ell$  is equal to the tolerance center dimension. However,  $Z \cdot \ell$  does not always equal to the tolerance center dimension in actual products. It is sometimes not possible to insert the pipe all the way to the stopper in the socket of the TS joint. Consequently, the dimension of S Bends formed with a combination of pipes and fittings may differ from the dimension in the above table. Therefore, consider the above dimensions as guideline figures.

Unit : mm

(Abbreviation : S-B) Type B

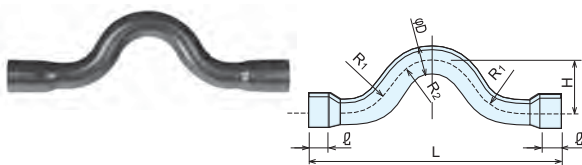


Nominal Dia.	H	L	D	$\ell$	R <sub>1</sub>	R <sub>2</sub>	Standards
★13	50	250	18	26	40	40	(M)
20	50	270	26	35	60	43	

Note The "★" mark indicates a made-to-order product.

## Injection-Molded Unions (Expansion Joints) Code No. 1066

Unit : mm

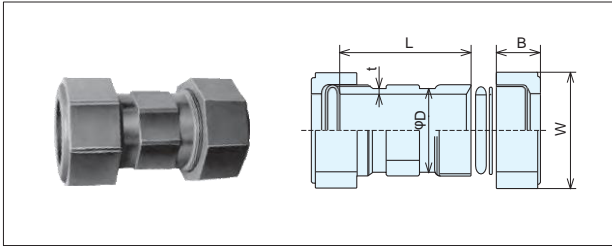

Nominal Dia.	D	t	L	B	W	Standards
13	26	3.0	68	25	38	JIS K 6743
Ⓐ 16	—	—	110	28	43	Ⓜ
20	35	3.5	78	29	50	JIS K 6743
25	43	4.0	89	29	56	
30	48	4.0	98	33.5	63	
40	59	4.5	108	38.5	79	
50	72	5.0	118	39	93	

- Notes
1. The product with nominal diameter of 16 is not injection-molded and its shape differ from that shown in the diagram.
  2. The material of the rubber ring conforms to JIS K6353 Type I-A (rubber goods for water works).
  3. The Ⓐ mark indicates that the product is manufactured by Aronkasei Co., Ltd.


## HI-TS Union Sockets

Code No. 6041

## TS Union Sockets

Code No. 5041

Unit : mm

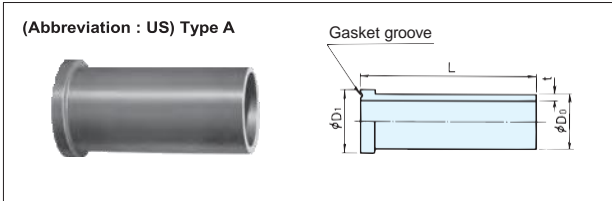

Nominal Dia.	D <sub>0</sub>	D <sub>1</sub>	t	L	Standards
13	18	23	2.5	80	JIS K 6743
16	22	27.5	3.0	85	
20	26	29.5	3.0	90	
25	32	36.5	3.5	100	
30	38	42	3.5	110	
40	48	53	4.0	120	
50	60	71	4.5	130	

Note Nominal diameter 16 mm is presently only available for HI-TS union sockets.


## HI-TS Caps

Code No. 6042

## TS Caps

Code No. 5042

Unit : mm

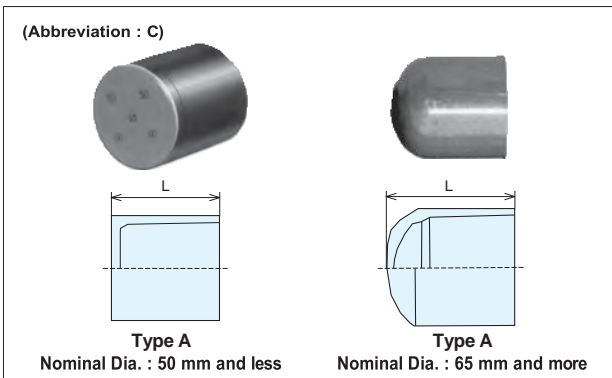

Nominal Dia.	L	Standards
13	29	JIS K 6743
16	33.5	
20	38.5	
25	44	
30	48	
40	59.5	
50	68	
65	96	AS21
75	105	JIS K 6743
100	138	
150	205	

Note Nominal diameter 65 mm is only available for TS caps.


## HI-TS Valve Sockets

Code No. 6031

## TS Valve Sockets

Code No. 5031

Unit : mm

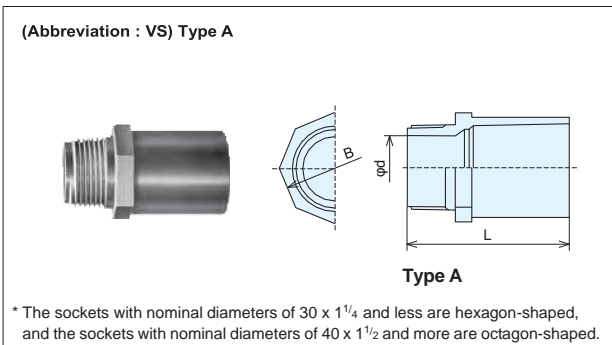

\* The sockets with nominal diameters of 30 x 1<sup>1</sup>/<sub>4</sub> and less are hexagon-shaped, and the sockets with nominal diameters of 40 x 1<sup>1</sup>/<sub>2</sub> and more are octagon-shaped.

Nominal Dia.	d	B	Nominal Thread Dia.	L	Standards
13x 1 <sup>1</sup> / <sub>2</sub>	13	24	R1 <sup>1</sup> / <sub>2</sub>	50	JIS K 6743
16x 1 <sup>1</sup> / <sub>2</sub>	13	29	R1 <sup>1</sup> / <sub>2</sub>	57	
20x 3 <sup>3</sup> / <sub>4</sub>	18	33	R3 <sup>3</sup> / <sub>4</sub>	64	
25x1	23	40	R1	71	
30x1 <sup>1</sup> / <sub>4</sub>	31	46	R1 <sup>1</sup> / <sub>4</sub>	80	
40x1 <sup>1</sup> / <sub>2</sub>	37	57	R1 <sup>1</sup> / <sub>2</sub>	92	
50x2	48	70	R2	106	
65x2 <sup>1</sup> / <sub>2</sub>	63	86	R2 <sup>1</sup> / <sub>2</sub>	119	Ⓜ
75x3	74	101	R3	128	
100x4	97	129	R4	157	

- Notes
1. The threads are tapered male threads conform to JIS B0203 (taper pipe threads).
  2. When the sockets are installed in a place where bending force or vibration applies, or where the sockets are disconnected and reconnected frequently, valve sockets with metal insert should be used.

## HI-TS Valve Sockets with Metal Insert

Code No. 7031


## TS Valve Sockets with Metal Insert

Code No. 4031

Unit : mm

(Abbreviation : MVS) Type II

PVC Inner Surface Type

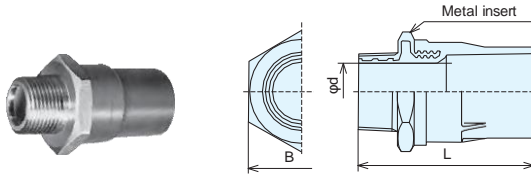


\* The sockets with nominal diameters of 50 x 2 and less are hexagon-shaped at the section B and the sockets with nominal diameter of 65 x 2-1/2 and more are octagon-shaped.

Nominal Dia.	d	B	Nominal Thread Dia.	L	Standards
13x 1/2	13	32	R 1/2	60	JIS K 6743
16x 1/2	13	32	R 1/2	67	
20x 3/4	18	40	R 3/4	75	
25x1	23	50	R1	85	
30x1 1/4	31	55	R1 1/4	95	
40x1 1/2	37	65	R1 1/2	110	
50x2	48	75	R2	125	
65x2 1/2	61	98	R2 1/2	134	(M)
75x3	72	112	R3	151	
100x4	96	140	R4	189	

- Notes
1. The threads are tapered male threads conform to JIS B0203 (taper pipe threads).
  2. The material of the thread insert conforms to JIS H5120 CAC406 (cast brass).
  3. The shape of the socket with nominal diameter of 16 differs partially from that shown in the diagram.

Unit : mm

(Abbreviation : MVS) Type I

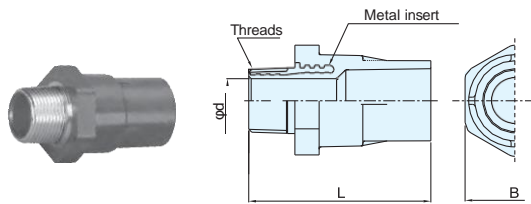

\* Section B is hexagon-shaped.

Nominal Dia.	d	B	Nominal Thread Dia.	L	Standards	
					VP	HI-VP
13x 1/2	13	32	R 1/2	60	JIS K 6743	
16x 1/2	13	34	R 1/2	65		
20x 1/2	13	34	R 1/2	72		(M)
20x 3/4	18	41	R 3/4	75	JIS K 6743	
25x1	23	50	R1	85		
30x1 1/4	31	56	R1 1/4	95		

- Notes
1. The threads are tapered male threads conform to JIS B0203 (taper pipe threads).
  2. The material of the thread insert conforms to JIS H3250 C3602 (free-cutting brass) or C3604 (free-cutting brass).


## HI-TS Hydrant Sockets with Metal Insert

Code No. 7028

## HI-TS Hydrant Sockets

Code No. 6021

(Abbreviation: MWS = With metal insert, WS = Without metal insert) Type A

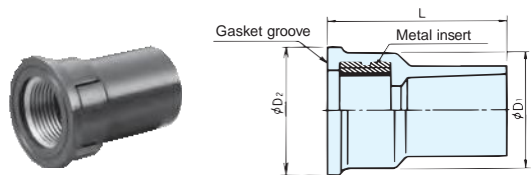

## TS Hydrant Sockets with Metal Insert

Code No. 4028

## TS Hydrant Sockets

Code No. 5021

Unit : mm

Nominal Dia.	D1	D2	Nominal Thread Dia.	L	Standards	
					MWS	WS
13	30	34	Rp 1/2	47	JIS K 6743	(M)
16x13	30	34	Rp 1/2	52		
20	37	42	Rp 3/4	59		
20x13	30	34	Rp 1/2	57		
25	46	52	Rp1	68		

- Notes
1. The threads are parallel female threads conform to JIS B0203 (taper pipe threads).
  2. The material of the thread insert of the products with nominal diameters of 13, 16 and 20 conforms to JIS H3250 C3601, C3602 or C3604 (free-cutting brass) and that of the product with nominal diameter of 25 conforms to JIS H5121 CAC406C (cast brass).
  3. Use seal tape on threads for firm sealing. A solvent-free sealing agent must be used when seal tape and sealing agent are used together. If a solvent-containing sealing agent is used, cracks may occur in the hydrant joint.
  4. Excessive tightening of the tapered male threads may cause the RP female thread section to expand and break.
  5. Do not connect the product to a steel pipe with tapered male threads that are fabricated at construction sites.


## HI-TS Hydrant Tees with Metal Insert

Code No. 7030

## HI-TS Hydrant Tees

Code No. 6023

(Abbreviation: MWT = With metal insert, WT = Without metal insert) Type A

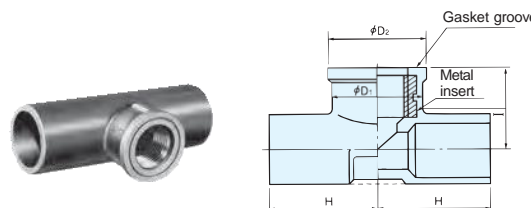

## TS Hydrant Tees with Metal Insert

Code No. 4030

## TS Hydrant Tees

Code No. 5023

Unit : mm


Nominal Dia.	D1	D2	Nominal Thread Dia.	H	I	Standards	
						MWT	WT
13	30 (28)	34	Rp 1/2	38	29	JIS K 6743	(M)
16x13	30	34	Rp 1/2	43	32		
20	37	42	Rp 3/4	51	36		
20x13	30	34	Rp 1/2	47	34		
25	46	52	Rp1	59	42		

- Notes
1. The threads are parallel female threads conform to JIS B0203 (taper pipe threads).
  2. The material of the thread insert of the products with nominal diameters of 13, 16 and 20 conforms to JIS H3250 C3601, C3602 or C3604 (free-cutting brass) and that of the product with nominal diameter of 25 conforms to JIS H5121 CAC406C (cast brass).
  3. Use seal tape on threads for firm sealing. A solvent-free sealing agent must be used when seal tape and sealing agent are used together. If a solvent-containing sealing agent is used, cracks may occur in the hydrant joint.
  4. Excessive tightening of the tapered male threads may cause the RP female thread section to expand and break.
  5. Do not connect the product to a steel pipe with tapered male threads that are fabricated at construction sites.
  6. HI-TS Hydrant Tees with a nominal diameter of 20 x 13 or 25 are not available. Note that the numeric value in ( ) is the dimension of WT product.

## HI-TS Hydrant Elbows with Metal Insert Code No. 7033

## HI-TS Hydrant Elbows Code No. 6022

(Abbreviation: MWL = With metal insert, WL = Without metal insert)  
Type A

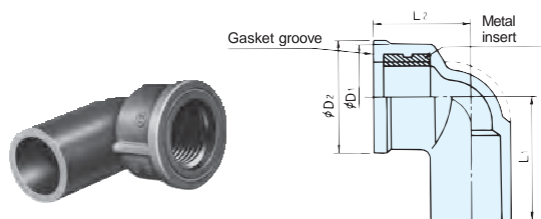

## TS Hydrant Elbows with Metal Insert Code No. 4033

## TS Hydrant Elbows Code No. 5022

Unit : mm


Nominal Dia.	D <sub>1</sub>	D <sub>2</sub>	Nominal Thread Dia.	L <sub>1</sub>	L <sub>2</sub>	Standards		
						MWL		WL
						VP	HI	
13 (Type S)	30	34	Rp <sup>1</sup> / <sub>2</sub>	38	29	JIS K 6743		(M)
13 (Type L)	30	34	Rp <sup>1</sup> / <sub>2</sub>	38	45			—
16x13	30	34	Rp <sup>1</sup> / <sub>2</sub>	43	32			(M)
20	37	42	Rp <sup>3</sup> / <sub>4</sub>	51	36	JIS K 6743		—
20x13	30	34	Rp <sup>1</sup> / <sub>2</sub>	47	33			(M)
25	46	52	Rp1	59	40			(M)

- Notes
- For products with nominal diameter of 13, Type S (short size) and Type L (long size) are available.
  - The threads are parallel female threads conform to JIS B0203 (taper pipe threads).
  - The material of the thread insert of the products with nominal diameters of 13, 16 and 20 conforms to JIS H3250 C3601, C3602 or C3604 (free-cutting brass) and that of the product with nominal diameter of 25 conforms to JIS H5121 CAC406C (cast brass).
  - Use seal tape on threads for firm sealing. A solvent-free sealing agent must be used when seal tape and sealing agent are used together. If a solvent-containing sealing agent is used, cracks may occur in the hydrant joint.
  - Excessive tightening of the tapered male threads may cause the RP female thread section to expand and break.
  - Do not connect the product to a steel pipe with tapered male threads that are fabricated at construction sites.

## HI-TS Hydrant Elbows with Mount Code No. 7034

Unit : mm

(With metal insert)

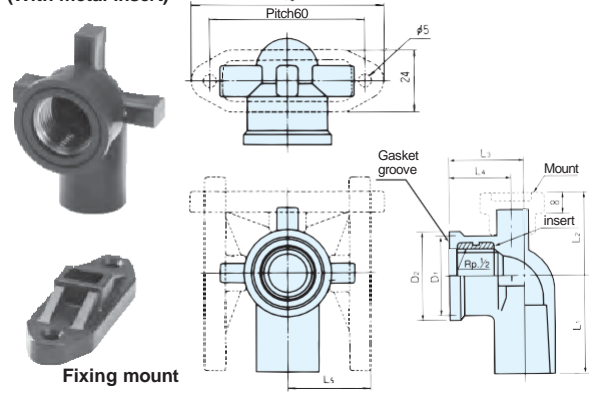


Nominal Dia.	D <sub>1</sub>	D <sub>2</sub>	Nominal Thread Dia.	L <sub>1</sub>	L <sub>2</sub>	L <sub>3</sub>	L <sub>4</sub>	L <sub>5</sub>	Standards
13	31	34	Rp <sup>1</sup> / <sub>2</sub>	38	33	29	24.5	33	(M)
16x13	33	35	Rp <sup>1</sup> / <sub>2</sub>	44	34	33	24.5	33	
20x13	32	34	Rp <sup>1</sup> / <sub>2</sub>	51	33.5	36	24.5	33	

- Notes
- The threads are parallel female threads conform to JIS B0203 (taper pipe threads).
  - The material of the thread insert conforms to JIS H3250 C3601 (free-cutting brass) or C3602 (free-cutting brass).
  - Use seal tape on threads for firm sealing. A solvent-free sealing agent must be used when seal tape and sealing agent are used together. If a solvent-containing sealing agent is used, cracks may occur in the hydrant joint.
  - Excessive tightening of the tapered male threads may cause the RP female thread section to expand and break.
  - Do not connect the product to a steel pipe with tapered male threads that are fabricated at construction sites.

## HI-TS Hydrant Elbows with Mount (Back-Side Mount) Code No. 7036

Unit : mm

Back-side mount (with metal insert)

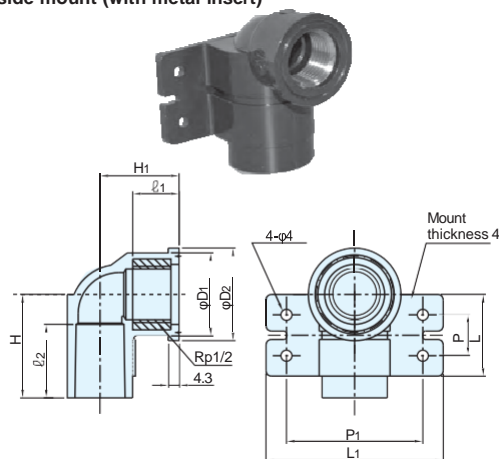


Nominal Dia.	D <sub>1</sub>	D <sub>2</sub>	φ <sub>1</sub>	φ <sub>2</sub>	Nominal Thread Dia.	H	H <sub>1</sub>	L	L <sub>1</sub>	P	P <sub>1</sub>	Standards
13	30.5	34.5	17	27	Rp <sup>1</sup> / <sub>2</sub>	38	29	30	65	15	50	(M)
16x13	30.5	34.5	17	31	Rp <sup>1</sup> / <sub>2</sub>	43	33	33	70	18	55	
20x13	31.0	34.5	17	35	Rp <sup>1</sup> / <sub>2</sub>	47	36	36	75	20	60	

- Notes
- The threads are parallel female threads conform to JIS B0203 (taper pipe threads).
  - The material of the metal insert conforms to JIS H3250 C371BD (brass for casting).
  - Use seal tape on threads for firm sealing. A solvent-free sealing agent must be used when seal tape and sealing agent are used together. If a solvent-containing sealing agent is used, cracks may occur in the hydrant joint.
  - Excessive tightening of the tapered male threads may cause the RP female thread section to expand and break.
  - Do not connect the product to a steel pipe with tapered male threads that are fabricated at construction sites.

## HI-TS Hydrant Sockets with Flange Code No. 7035

Unit : mm

(Abbreviation : HI-TMWS)

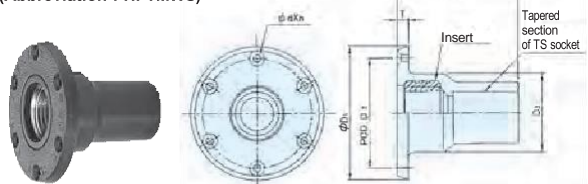

Nominal Dia.	I <sub>-1</sub>	D <sub>1</sub>	D <sub>2</sub>	D <sub>3</sub>	Nominal Thread Dia.	T	d	n	Standards
13	47	54	45	30	Rp <sup>1</sup> / <sub>2</sub>	4	3	6	(M)
20x13	59	54	45	33	Rp <sup>1</sup> / <sub>2</sub>	4	3	6	

- Notes
- The threads are parallel female threads conform to JIS B0203 (taper pipe threads).
  - The material of the thread insert conforms to JIS H3250 C3602 (free-cutting brass).
  - Use seal tape on threads for firm sealing. A solvent-free sealing agent must be used when seal tape and sealing agent are used together. If a solvent-containing sealing agent is used, cracks may occur in the hydrant joint.
  - Excessive tightening of the tapered male threads may cause the RP female thread section to expand and break.
  - Do not connect the product to a steel pipe with tapered male threads that are fabricated at construction sites.


## HI-TS Sockets

Code No. 9661

## TS Sockets

Code No. 9061

Unit : mm

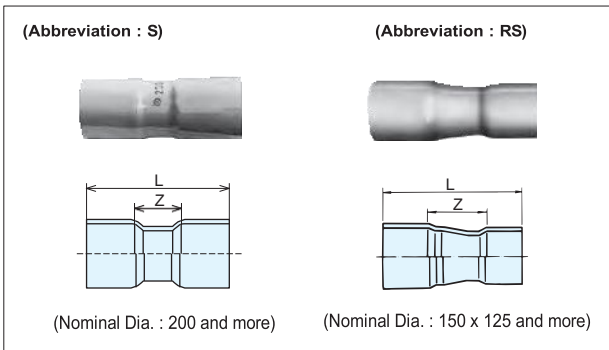

**⚠ TS sockets with nominal diameter of 200 and more cannot be used on pipes for drinking water.**

Nominal Dia.	Z	L	Standards	
			For general purposes	
			VP	HI-VP
150x125	184	420	M	★M
200	150	550		
200x150	328	660		
250	200	700		
250x200	350	800		
300	250	850		
300x250	350	900		

Note The "★" mark indicates a made-to-order product.

For Water Supply and Pressure Pipeline


## HI-TS 90° Bends

Code No. 9662

## TS 90° Bends

Code No. 9062

Unit : mm

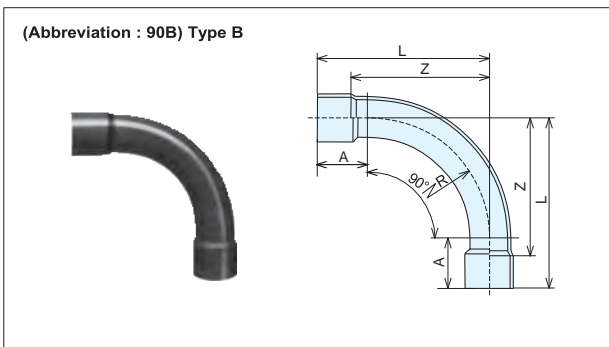

**⚠ TS 90° Bends with nominal diameter of 200 and more cannot be used on pipes for drinking water.**

Nominal Dia.	A	R (Reference)	Z	L	Standards				
					For water supply		For general purposes		
					VP	HI-VP	VP	HI-VP	
13	40	40	54	80	★JIS K 6743	JIS K 6743	—		
16	50	50	170	100		★JIS K 6743			
20	55	60	180	115		JIS K 6743			JIS K 6743
25	60	75	195	135					
30	65	90	111	155					
40	85	110	140	195					
50	100	150	187	250					
65	110	200	249	310	AS21	★AS21			
75	120	250	306	370	JIS K 6743	JIS K 6743			
100	145	300	361	445					
125	165	400	461	565	AS21	★AS21			
150	195	475	538	670	JIS K 6743	★JIS K 6743			
200	300	700	800	1000	—		(M)	★(M)	
250	350	1000	1100	1350			★(M)		
300	400	1200	1300	1600					

Note The "★" mark indicates a made-to-order product.


## HI-TS 45° Bends

Code No. 9662

## TS 45° Bends

Code No. 9062

Unit : mm

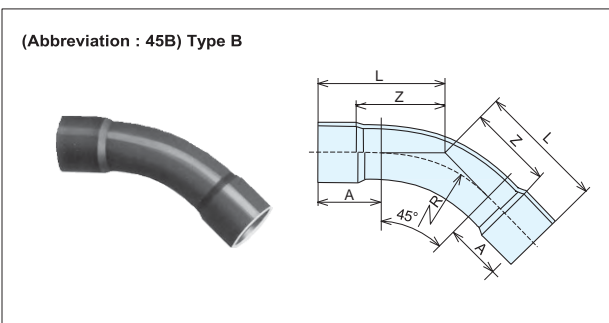

**⚠ TS 45° Bends with nominal diameter of 200 and more cannot be used on pipes for drinking water.**

Nominal Dia.	A	R (Reference)	Z	L	Standards			
					For water supply		For general purposes	
					VP	HI-VP	VP	HI-VP
13	40	40	31	57	★JIS K 6743	★JIS K 6743	—	
16	50	50	41	71		JIS K 6743		
20	55	60	45	80				
25	60	75	51	91				
30	65	90	58	102				
40	85	110	76	131				
50	100	150	99	162				
65	110	200	132	193	AS21	AS21		
75	120	250	160	224	JIS K 6743	JIS K 6743		
100	145	300	185	269				
125	165	400	227	331	AS21	★AS21		
150	195	475	260	392	JIS K 6743	JIS K 6743		
200	310	700	400	600	—	(M)	★(M)	
250	336	1000	500	750				
300	403	1200	600	900				

Note The "★" mark indicates a made-to-order product.

Unit : mm


## HI-TS 22° 1/2 Bends

Code No. 9662

## TS 22° 1/2 Bends

Code No. 9062

(Abbreviation : 22<sup>1</sup>/<sub>2</sub>B) Type B

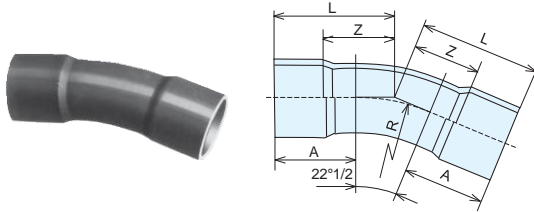

**⚠ TS 22 ° 1/2 bends with nominal diameter of 200 and more cannot be used on pipes for drinking water.**

Nominal Dia.	A	R (Reference)	Z	L	Standards			
					For water supply		For general purposes	
					VP	HI-VP	VP	HI-VP
13	40	40	22	48	★JIS K 6743	★JIS K 6743	—	
16	50	50	30	60		JIS K 6743		
20	55	60	32	67				
25	60	75	35	75				
30	65	90	39	83				
40	85	110	52	107				
50	100	150	67	130	AS21	AS21		
65	110	200	89	150	JIS K 6743	JIS K 6743		
75	120	250	106	170				
100	145	300	121	205				
125	165	400	141	245	AS21	★AS21		
150	195	475	157	289	JIS K 6743	★JIS K 6743		
200	312	700	250	450	—		(M)	★(M)
250	352	1000	300	550				—
300	413	1200	350	650				

Note The "★" mark indicates a made-to-order product.

## HI-TS 11° 1/4 Bends


Code No. 9662

## TS 11° 1/4 Bends

Code No. 9062

Unit : mm

(Abbreviation : 11<sup>1</sup>/<sub>4</sub>B) Type B

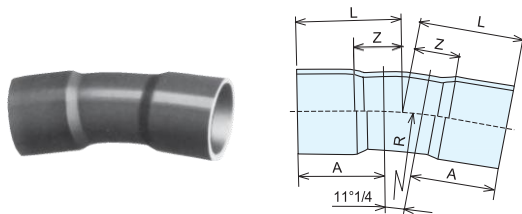

**⚠ TS 11 ° 1/4 bends with nominal diameter of 200 and more cannot be used on pipes for drinking water.**

Nominal Dia.	A	R (Reference)	Z	L	Standards			
					For water supply		For general purposes	
					VP	HI-VP	VP	HI-VP
13	40	40	18	44	★JIS K 6743	★JIS K 6743	—	
16	50	50	25	55				
20	55	60	26	61				
25	60	75	27	67				
30	65	90	30	74				
40	85	110	41	96	JIS K 6743	JIS K 6743		
50	100	150	52	115				
65	110	200	67	128				
75	120	250	81	145	AS21	★AS21		
100	145	300	91	175	JIS K 6743	JIS K 6743		
125	165	400	97	201				
150	195	475	110	242				
200	281	700	150	350	JIS K 6743	★JIS K 6743	(M)	★(M)
250	351	1000	200	450	—	—		
300	381	1200	200	500				

Note The "★" mark indicates a made-to-order product.

## HI-TS 5° 5/8 Bends


Code No. 9662

## TS 5° 5/8 Bends

Code No. 9062

Unit : mm

(Abbreviation : 5<sup>5</sup>/<sub>8</sub>B) Type B

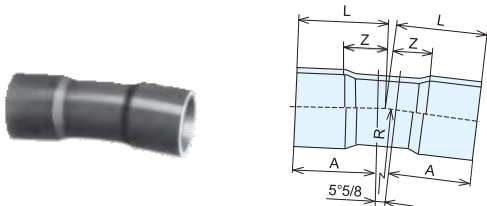

**⚠ TS 5 ° 5/8 bends with nominal diameter of 200 and more cannot be used on pipes for drinking water.**

Nominal Dia.	A	R (Reference)	Z	L	Standards			
					For water supply		For general purposes	
					VP	HI-VP	VP	HI-VP
40	85	110	35	90	★JIS K 6743	★JIS K 6743	—	
50	100	150	44	107				
65	110	200	59	120	★AS21	★AS21		
75	120	250	68	132	JIS K 6743	★JIS K 6743		
100	145	300	76	160				
125	165	400	81	185	AS21	★AS21		
150	195	475	86	218	JIS K 6743	★JIS K 6743		
200	272	700	100	300	—		(M)	★(M)
250	330	1000	120	370				
300	392	1200	140	440			★(M)	—

Note The "★" mark indicates a made-to-order product.

## HI-TS S Bends


Code No. 9660

## TS S Bends

Code No. 9060

Unit : mm

(Abbreviation : S-B) Type B

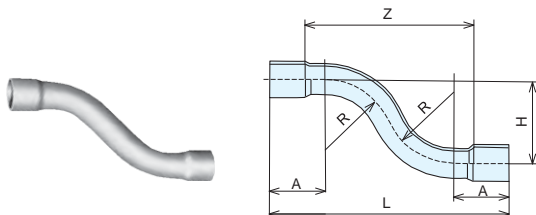

Nominal Dia.	A	R (Reference)	Z	H	L	Standards	
						VP	HI-VP
13	40	90	208	150	260	-	★JIS K 6743
16	55	100	240	150	300		JIS K 6743
20	55	105	250	150	320		★JIS K 6743
25	60	120	280	150	360		JIS K 6743
30	65	130	302	200	390		★JIS K 6743
40	85	150	360	200	470	★JIS K 6743	JIS K 6743
50	100	150	399	200	525		★JIS K 6743
75	120	250	572	300	700		JIS K 6743
100	145	300	642	300	810		★JIS K 6743
150	195	475	841	300	1105		★JIS K 6743

Note The "★" mark indicates a made-to-order product.

### 3. Transparent Fittings for Water Supply


Meaning of symbols

Ⓜ: Product conforms to the manufacturer's standards

#### Transparent Sockets for Water Supply

Code No. 6011

Unit : mm

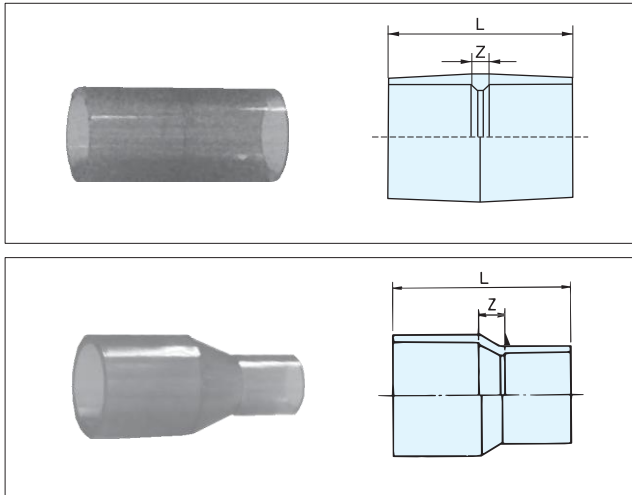


Nominal Dia.	Z	L	Standards
13	5	57	Ⓜ
16	7	67	
16x13	5	61	
20	7	77	
20x13	7	68	
20x16	6	71	
25	7	87	
25x13	20	86	
25x16	15	85	
25x20	9	84	
30	7	95	
30x20	14	93	
30x25	9	93	
40	7	117	
40x25	19	114	
40x30	15	114	
50	7	133	
50x30	29	136	
50x40	18	136	

#### Transparent Elbows for Water Supply

Code No. 6012

Unit : mm

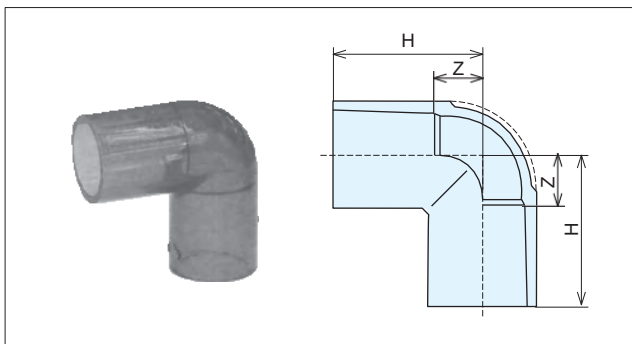


Nominal Dia.	Z	H	Standards
13	10	36	Ⓜ
16	13	43	
20	15	50	
20x13	12 (side 20)	15 (side 13)	
25	18	58	
30	21	65	
40	27	82	
50	33	96	

Note Elbow sections must not be applied with a bending force or vibration.

#### Transparent 45° Elbows for Water Supply

Code No. 6012

Unit : mm

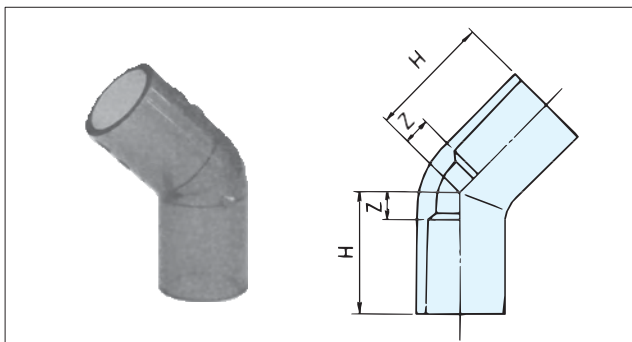


Nominal Dia.	Z	H	Standards
13	7	33	Ⓜ
20	9	44	
25	11	51	
30	12	56	
40	14	69	
50	17	80	

#### Transparent Tees for Water Supply

Code No. 6013

Unit : mm

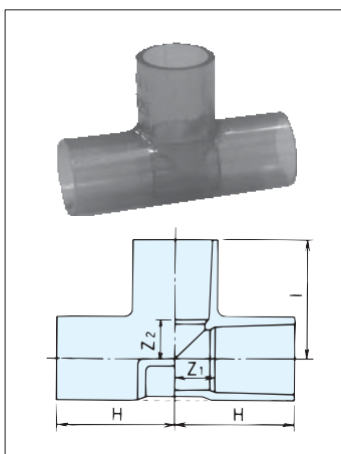


Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	H	I	Standards
13	10	10	36	36	Ⓜ
16	13	13	43	43	
16x13	11	12	41	38	
20	15	15	50	50	
20x13	11	14	46	40	
20x16	13	15	48	45	
25	18	18	58	58	
25x13	11	17	51	43	
25x16	13	18	53	48	
25x20	15	18	55	53	
30	21	21	65	65	
30x13	11	20	55	46	
30x16	15	21	57	51	
30x20	15	21	59	56	
30x25	18	21	62	61	

Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	H	I	Standards
40	27	27	82	82	Ⓜ
40x13	11	26	66	52	
40x16	13	27	68	57	
40x20	15	27	70	62	
40x25	18	27	73	67	
40x30	21	27	76	71	
50	33	33	96	96	
50x13	11	32	74	58	
50x16	16	34	76	63	
50x20	15	33	78	68	
50x25	18	33	81	73	
50x30	21	33	84	77	
50x40	27	33	90	88	

## Transparent Hydrant Sockets with Metal Insert

Code No. 7028

Unit : mm

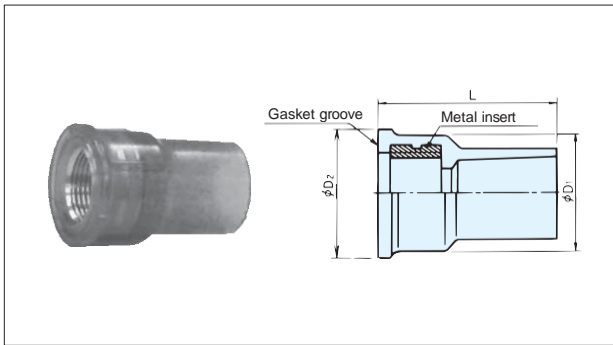


Nominal Dia.	D <sub>1</sub>	D <sub>2</sub>	Nominal Thread Dia.	L	Standards
13	30	34	Rp <sup>1</sup> / <sub>2</sub>	47	(M)
16x13	30	34	Rp <sup>1</sup> / <sub>2</sub>	52	
20	37	42	Rp <sup>3</sup> / <sub>4</sub>	59	
20x13	30	34	Rp <sup>1</sup> / <sub>2</sub>	57	
25	46	52	Rp1	68	

- Notes
1. The threads are parallel female threads conform to JIS B0203 (taper pipe threads).
  2. The material of the thread insert of the products with nominal diameters of 13, 16 and 20 conforms to JIS H3250 C3601, C3602 or C3604 (free-cutting brass) and that of the product with nominal diameter of 25 conforms to JIS H5121 CAC406C (cast brass).
  3. Use seal tape on threads for firm sealing. A solvent-free sealing agent must be used when seal tape and sealing agent are used together. If a solvent-containing sealing agent is used, cracks may occur in the hydrant joint.
  4. Excessive tightening of the tapered male threads may cause the RP female thread section to expand and break.
  5. Do not connect the product to a steel pipe with tapered male threads that are fabricated at construction sites.

## Transparent Hydrant Elbows with Metal Insert

Code No. 7033

Unit : mm

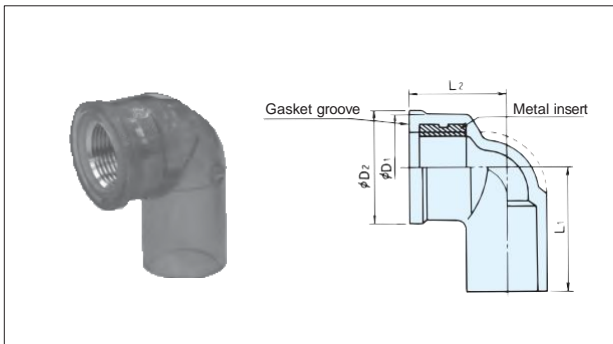


Nominal Dia.	D <sub>1</sub>	D <sub>2</sub>	Nominal Thread Dia.	L <sub>1</sub>	L <sub>2</sub>	Standards
13	30	34	Rp <sup>1</sup> / <sub>2</sub>	38	29	(M)
16x13	30	34	Rp <sup>1</sup> / <sub>2</sub>	43	32	
20	37	42	Rp <sup>3</sup> / <sub>4</sub>	51	36	
20x13	30	34	Rp <sup>1</sup> / <sub>2</sub>	47	33	
25	46	52	Rp1	59	40	

- Notes
1. The threads are parallel female threads conform to JIS B0203 (taper pipe threads).
  2. The material of the thread insert of the products with nominal diameters of 13, 16 and 20 conforms to JIS H3250 C3601, C3602 or C3604 (free-cutting brass) and that of the product with nominal diameter of 25 conforms to JIS H5121 CAC406C (cast brass).
  3. Use seal tape on threads for firm sealing. A solvent-free sealing agent must be used when seal tape and sealing agent are used together. If a solvent-containing sealing agent is used, cracks may occur in the hydrant joint.
  4. Excessive tightening of the tapered male threads may cause the RP female thread section to expand and break.
  5. Do not connect the product to a steel pipe with tapered male threads that are fabricated at construction sites.

## Transparent Valve Sockets with Metal Insert (Type II)

Code No. 7031

Unit : mm

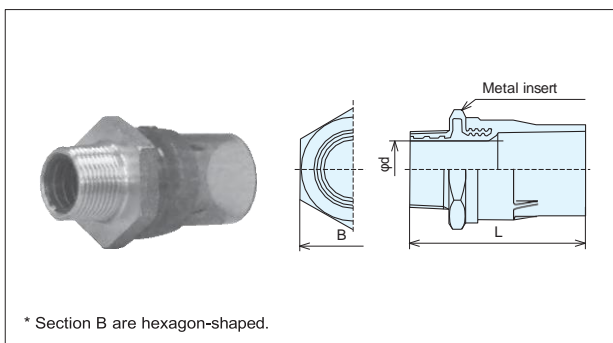


Nominal Dia.	d	B	Nominal Thread Dia.	L	Standards
13x <sup>1</sup> / <sub>2</sub>	13	32	R <sup>1</sup> / <sub>2</sub>	60	(M)
16x <sup>1</sup> / <sub>2</sub>	13	32	R <sup>1</sup> / <sub>2</sub>	67	
20x <sup>3</sup> / <sub>4</sub>	18	40	R <sup>3</sup> / <sub>4</sub>	75	
25x1	23	50	R1	85	
30x1 <sup>1</sup> / <sub>4</sub>	31	55	R1 <sup>1</sup> / <sub>4</sub>	95	
40x1 <sup>1</sup> / <sub>2</sub>	37	65	R1 <sup>1</sup> / <sub>2</sub>	110	
50x2	48	75	R2	125	

- Notes
1. The threads are tapered male threads conform to JIS B0203 (taper pipe threads).
  2. The material of the thread insert conforms to JIS H5120 CAC406 (cast brass).
  3. The shape of the socket with nominal diameter of 16 differs partially from that shown in the diagram.

## Tough dyne HI (White) Specially designed adhesive

Conform to JWWA S101

Be sure to apply **Tough dyne HI (White)** for bonding.

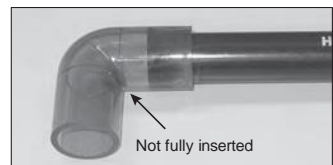


\*Note: It may be difficult to insert the pipe all the way to the stopper depending on the type of fitting.  
In that case, insert the pipe to the following position: Zero point + Min. 1/3L.

\* Color Tough dyne Blue cannot be used to bond pipes that are used for drinking water.

## 4. TS Flanges and KV Packings

### TS Flanges

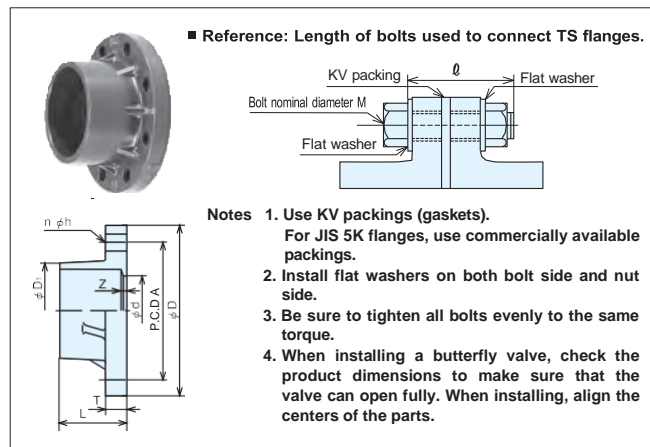

### HI-JIS 10K Flanges

Code No. 7642

### JIS 10K Flanges


Code No. 7142

Unit : mm

Nominal Dia.	D	A	d	D <sub>1</sub>	L	T	Z	n-h	Bolt nominal length M-ε	Standards
15 (16)	95	70	16	31	36	14	6	4-15	M12-55	(M)
20	100	75	20	35	42	14	7	4-15	M12-55	
25	125	90	25	43	46	14	6	4-19	M16-60	
32 (30)	135	100	31	49	51	16	7	4-19	M16-60	
40	140	105	40	61	62	16	7	4-19	M16-60	
50	155	120	51	73	72	20	9	4-19	M16-70	
65	175	140	67	88	69	22	8	4-19	M16-75	
80 (75)	185	150	77	103	72	22	8	8-19	M16-75	
100	210	175	100	132	94	24	10	8-19	M16-80	
125	250	210	125	156	116	24	12	8-23	M20-80	
150	280	240	146	185	146	26	14	8-23	M20-85	
200	330	290	194	240	168	28	15	12-23	M20-90	
250	400	355	247	292	173	30	15	12-25	M22-95	
300	445	400	298	344	195	31	15	16-25	M22-95	

- Notes
1. The flange dimensions conform to JIS B2220 (steel pipe flanges) 10 K.
  2. The TS socket dimensions conform to JIS K6741, JIS K6743 and AS21.
  3. The design pressure (hydrostatic pressure + water hammer) is 1.0 MPa for products with nominal diameters of 250 and less and 0.65 MPa for products with nominal diameter of 300.

### KV Packings (Flange Gaskets)

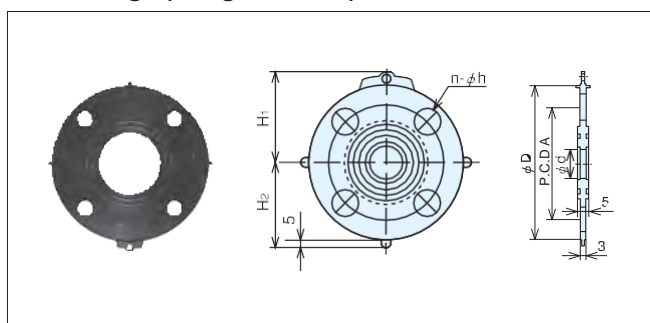

### JIS 10K Flange Type

Code No. 9742

Unit : mm

Nominal Dia.	D	A	d	H <sub>1</sub>	H <sub>2</sub>	n-h	Standards
★ 15	95	70	18	57.0	52.5	4-15	(M)
20	100	75	22	59.5	55.0	4-15	
25	125	90	30	73.0	67.5	4-19	
32	135	100	37	78.0	72.5	4-19	
40	140	105	43	80.5	75.0	4-19	
50	155	120	54	88.5	82.5	4-19	
65	175	140	69	99.0	92.5	4-19	
80	185	150	80	104.0	97.5	8-19	
100	210	175	102	118.5	110.0	8-19	
125	250	210	127	138.5	130.0	8-23	
150	280	240	150	153.5	145.0	8-23	
200	330	290	198	180.5	170.0	12-23	
★250	400	355	249	215.5	205.0	12-25	
★300	445	400	300	238.0	227.5	16-25	

- Notes
1. The "★" mark indicates a made-to-order product.
  2. The material is EPT (EPDM) and the operating temperature range is from -40°C to 90°C.

Meaning of symbols

(M): Product conforms to the manufacturer's standards

### JIS 5K Flanges

Code No. 7144

Unit : mm

Nominal Dia.	D	A	d	D <sub>1</sub>	L	T	Z	n-h	Bolt nominal length M-ε	Standards
★15 (16)	80	60	18	29	35	9	5	4-12	M10-40	(M)
20	85	65	22	33	40	10	5	4-12	M10-40	
★25	95	75	25	42	46	10	6	4-12	M10-40	
32 (30)	115	90	31	51	50	12	6	4-15	M12-50	
40	120	95	41	57	61	12	6	4-15	M12-50	
50	130	105	51	70	70	14	7	4-15	M12-50	
65	155	130	67	87	70	14	9	4-15	M12-50	
80 (75)	180	145	77	102	72	14	8	4-19	M16-55	
100	200	165	100	130	93	16	9	8-19	M16-60	
125	235	200	125	157	114	16	10	8-19	M16-60	
150	265	230	146	186	143	18	11	8-19	M16-65	

- Notes
1. The "★" mark indicates a made-to-order product.
  2. The flange dimensions conform to JIS B2220 (steel pipe flanges) 5K.
  3. The TS socket dimensions conform to JIS K6743 and AS21.
  4. The shape differs partially from that shown in the diagram depending on the size.
  5. The design pressure (hydrostatic pressure + water hammer) is 0.5 MPa.

### Flange Gaskets for Water Supply

Code No. 9743

Unit : mm

Nominal Dia	D	A	d	H <sub>1</sub>	H <sub>2</sub>	n-h	Standards
★ 40	140	105	43	81.0	75.0	4-19	(M)
★ 50	155	120	54	88.5	82.5	4-19	
75	211	168	80	117.0	110.5	4-19	
100	238	195	102	132.5	124.0	4-19	
★125	263	220	127	145.0	136.5	6-19	
★150	290	247	151	158.5	150.0	6-19	
★200	342	299	200	184.5	176.0	8-19	
★250	410	360	252	218.5	210.0	8-23	
★300	464	414	300	245.5	237.0	10-23	

- Notes
1. The "★" mark indicates a made-to-order product.
  2. The material is SBR and the operating temperature range is from 5°C to 35°C.

### Types of Packings That Can Be Used

Packing		JIS 10K Type
TS Flange		EPT (EPDM)
JIS 10K Flange	VP	○
	HI-VP	○

Note Use commercially available packings for JIS 5K flanges.

# II HT Pipes and Fittings for Hot Water Supply

## 1. Pipes


HT Pipes

Code No. 2002

Meaning of symbols

JIS K6776: Product conforms to Japanese Industrial Standards JIS K6776

(M) : Product conforms to the manufacturer's standards

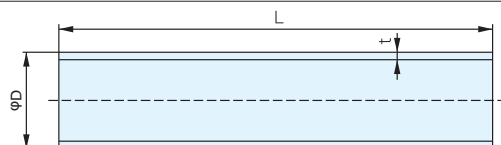

Unit : mm

Nominal Dia.	Outside Dia.D			Thickness t		Approx. Inside Dia. (Reference)	Length L	Tolerance	Reference Weight		Standards
	Basic Dimension	Max./Min. OD Tolerance	Average OD Tolerance	Thickness	Tolerance				kg/m	kg/piece	
13x4m	18.0	±0.2	±0.2	2.5	±0.2	13	4000	+30 -10	0.191	0.76	JIS K 6776
16x4m	22.0	±0.2	±0.2	3.0	±0.3	16	4000		0.281	1.12	
20x4m	26.0	±0.2	±0.2	3.0	±0.3	20	4000		0.340	1.36	
25x4m	32.0	±0.2	±0.2	3.5	±0.3	25	4000		0.492	1.97	
30x4m	38.0	±0.3	±0.2	3.5	±0.3	31	4000		0.596	2.38	
40x4m	48.0	±0.3	±0.2	4.0	±0.3	40	4000		0.868	3.47	
50x4m	60.0	±0.4	±0.2	4.5	±0.4	51	4000		1.232	4.93	
65x4m	76.0	±0.5	±0.3	5.0	±0.5	66	4000		1.651	6.60	
75x4m	89.0	±0.5	±0.3	5.9	±0.4	77	4000		2.380	9.52	
100x4m	114.0	±0.6	±0.4	7.1	±0.5	100	4000		3.743	14.97	
125x4m	140.0	±0.8	±0.5	8.2	±0.6	124	4000	+10 0	5.025	20.10	(M)
150x4m	165.0	±1.0	±0.5	9.6	±0.6	146	4000		7.280	29.12	
40x1m	48.0	±0.3	±0.2	4.0	±0.3	40	1000		0.868	0.87	
40x2m	48.0	±0.3	±0.2	4.0	±0.3	40	2000		0.868	1.74	
50x1m	60.0	±0.4	±0.2	4.5	±0.4	51	1000		1.232	1.23	
50x2m	60.0	±0.4	±0.2	4.5	±0.4	51	2000		1.232	2.46	
50x3m	60.0	±0.4	±0.2	4.5	±0.4	51	3000		1.232	3.70	
★ 75x3m	89.0	±0.5	±0.3	5.9	±0.4	77	3000		2.380	7.14	(M)

Notes 1. The reference weights are calculated by the basic dimension and a pipe material density of 1.48 g/cm<sup>3</sup>, and they are not part of the standards.

2. The ★ mark indicates a made-to-order product.

## 2. Fittings and Accessories


Meaning of symbols

JIS K6777 : Product conforms to Japanese Industrial Standards JIS K6777

(M) : Product conforms to the manufacturer's standards

Unit : mm

**Be sure to use the Tough dyne HT adhesive for bonding pipes and fittings.**

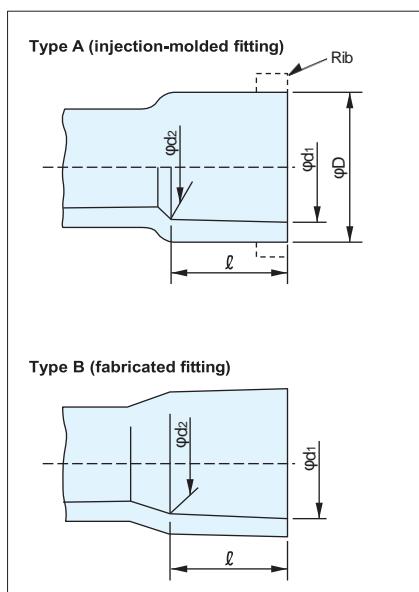

Nominal Dia.	Type A (injection-molded fitting)				Type B (fabricated fitting)			Standards
	Product	d1	Tolerance	d2	Tolerance	±4	D (min.)	
13	All products	18.30	±0.20	17.55	±0.25	22	26	JIS K 6777
16		22.35		21.55		27	29	
20		26.35		25.50		33	34	
25		32.50		31.40		38	41	
30		38.50	±0.30	37.45	±0.35	42	46	
40		48.50		47.45		47	56	

Nominal Dia.	Type A (injection-molded fitting)				Standards
	Product	d1	Tolerance	d2	
50	All Type A products	60.50	±0.30	59.45	JIS K 6777
65	Socket	76.60		75.30	
	Elbow/Tee	76.60		—	
75	All Type A products	89.60		—	
100		114.70		—	
125		140.80		—	
150		166.00	±0.40	—	(M)

When the socketed end is rib-shaped, the dimension D above indicates the rib diameter.


Nominal Dia.	Type B (fabricated fitting)				Standards
	Product	d1	Tolerance	d2	
50	Bends	60.50	±0.30	59.45	(M)
65	All Type A products	76.80		75.12	
75		89.80		88.13	
100		115.00		112.91	
125		141.20	±0.40	138.71	—
150		166.50	±0.50	163.38	

Unit : mm


HT Sockets

Code No. 2011

(Abbreviation : HT-S)



(Abbreviation : HT-RS)




Nominal Dia.	L	Standards	Nominal Dia.	L	Standards
13	49	JIS K 6777	40x25	100	JIS K 6777
16	59		40x30	97	
16x13	53		50	109	
20	71		50x25	110	
20x13	61.5		50x30	110	
20x16	66		50x40	110	
25	82		65	136	(M)
25x13	73		65x50	215	
25x16	76		75	155	
25x20	80.5		75x50	245	
30	87		75x65	163	
30x20	85		100	200	
30x25	90		100x75	190	
40	99		125	240	
40x20	98		150	300	

Note The tolerance for the dimension L of HT sockets is 6 mm and the tolerance for the dimension L of HT reducing sockets is ±5 mm.

## HT Tees

Code No. 2013

(Abbreviation : HT-T)

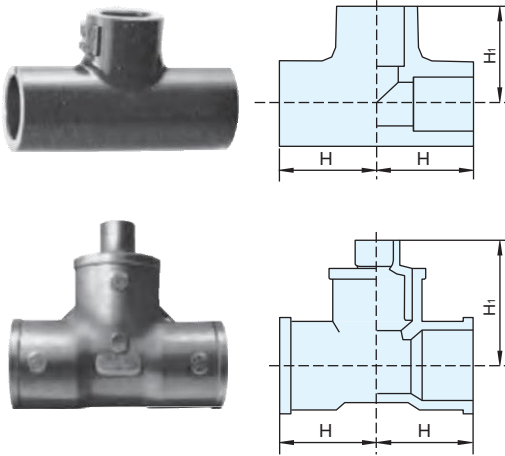

Note HT tee part must not be applied with a bending force or vibration.


Nominal Dia.	H	H <sub>1</sub>	Standards	nominal Dia.	H	H <sub>1</sub>	Standards
13	34	34	JIS K 6777	50x 30	79	75	JIS K 6777
16	41	41		50x 40	82	80	
16x13	39	36		65	110	110	(M)
20	53	53		65x 13	100	135	
20x13	45	38		65x 16	100	137	
20x16	47	43		65x 20	100	142	
25	58	58		65x 25	100	147	
25x13	49	41		65x 30	100	150	
25x16	52	46		65x 40	95	95	
25x20	54	52		65x 50	102	104	
30	64	64		75	120	120	
30x13	54	44		75x 20	105	147	
30x16	56	49		75x 25	93	88	
30x20	58	55		75x 30	105	155	
30x25	60	60		75x 40	100	102	
40	75	75		75x 50	105	110	
40x13	62	49		100	152	152	
40x16	63	54		100x 20	125	159	
40x20	65	60		100x 25	125	164	
40x25	68	65		100x 30	125	167	
40x30	72	69		100x 40	125	178	
50	87	87		100x 50	125	122	
50x13	69	55		100x 75	140	132	
50x16	70	60		125	187	187	
50x20	72	70		150	230	230	
50x25	75	75					

## HT Elbows

Code No. 2012

Unit : mm

(Abbreviation : HT-L)

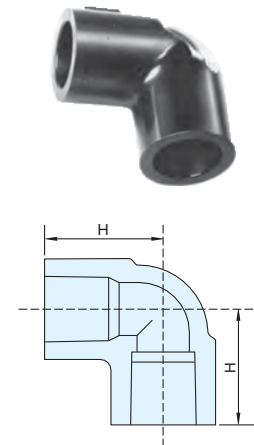

Nominal Dia.	H	Standards
13	34	JIS K 6777
16	41	
20	53	
25	58	
30	64	
40	74	
50	85	(M)
65	110	
75	120	
100	155	
125	188	
150	228	


- Notes 1. Use HT 90° Bends for bending sections of buried pipes.  
 2. HT Elbow sections must not be applied with a bending force or vibration.  
 3. The tolerance for the dimension H of HT Elbows is  $\pm 4$  and the tolerance for the dimension H of products with nominal diameters of 65 and more is  $\pm 5/-1$ .

## HT 90° Bends

Code No. 9262

Unit : mm

(Abbreviation : HT-90B)

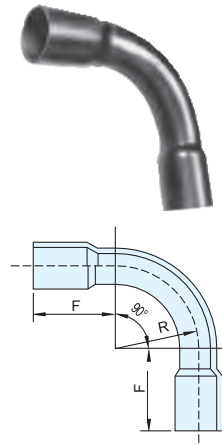

Nominal Dia.	F	R	Standards
★ 13	42	40	(M)
★ 16	47	48	
★ 20	54	55	
★ 25	62	78	
★ 30	70	100	
★ 40	86.5	120	
★ 50	100	160	
★ 65	110	200	
★ 75	120	245	
★ 100	145	300	
★ 125	165	400	
★ 150	195	500	


Note The ★ mark indicates a made-to-order product.

## HT 45° Bends

Code No. 9262

Unit : mm

(Abbreviation : HT-45B)



Nominal Dia.	F	R	Standards
★ 13	42	40	(M)
★ 16	47	48	
★ 20	54	55	
★ 25	62	78	
★ 30	70	100	
★ 40	86.5	120	
★ 50	100	160	
★ 65	110	200	
★ 75	120	245	
★ 100	145	300	
★ 125	165	400	
★ 150	195	500	


Note The ★ mark indicates a made-to-order product.

## HT 22° 1/2 Bends

Code No. 9262

Unit : mm

(Abbreviation : HT-22 1/2 B)



Nominal Dia.	F	R	Standards
★ 13	42	40	(M)
★ 16	47	48	
★ 20	54	55	
★ 25	62	78	
★ 30	70	100	
★ 40	86.5	120	
★ 50	100	160	
★ 65	110	200	
★ 75	120	245	
★ 100	145	300	
★ 125	165	400	
★ 150	195	500	


Note The ★ mark indicates a made-to-order product.

## HT 11° 1/4 Bends

Code No. 9262

Unit : mm

(Abbreviation : HT-11 1/4 B)



Nominal Dia.	F	R	Standards
★ 50	100	160	(M)
★ 65	110	200	
★ 75	120	245	
★ 100	145	300	
★ 125	165	400	
★ 150	195	500	


Note The ★ mark indicates a made-to-order product.

## HT-TS Flanges

Code No. 2342

JIS 10K Flange Type

Unit : mm

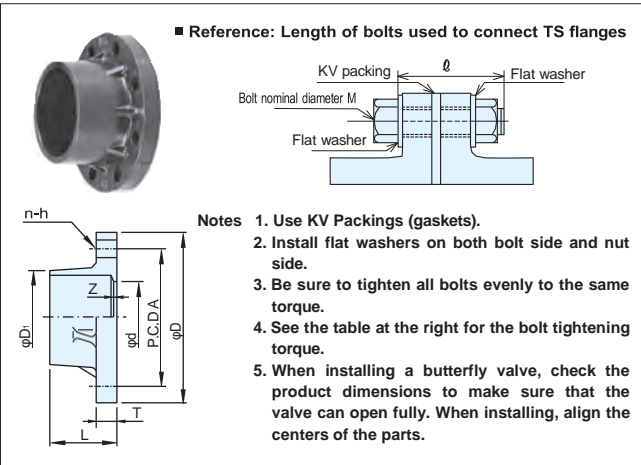

Nominal Dia.	D	A	d	D <sub>1</sub>	L	T	Z	n-h	Dimension below Bolt Head $\phi$	Standards
15 (16)	95	70	16	31	36	14	6	4-15	M12-50	(M)
20	100	75	20	35	42	14	7	4-15	M12-50	
25	125	90	25	43	46	14	6	4-19	M16-55	
32 (30)	135	100	31	49	51	16	7	4-19	M16-60	
40	140	105	40	61	62	16	7	4-19	M16-60	
50	155	120	51	73	72	20	9	4-19	M16-70	
65	175	140	67	88	69	22	8	4-19	M16-70	
80 (75)	185	150	77	103	72	22	8	8-19	M16-70	
100	210	175	100	132	94	24	10	8-19	M16-75	

Nominal Dia.	Bolt Tightening Torque (Guideline Values) N·m(kgf·m)
13~30	15(1.5)
40	25(2.5)
50	30(3.1)
75(80)	40(4.1)
100	45(4.6)

Notes


1. The flange conforms to JIS B2220 (steel pipe flanges) 10K.
2. The TS sockets conform to JIS K6777, JIS K6743 and AS 21.

## HT 180° Bends

Code No. 9262

Unit : mm

(Abbreviation : HT-180B)

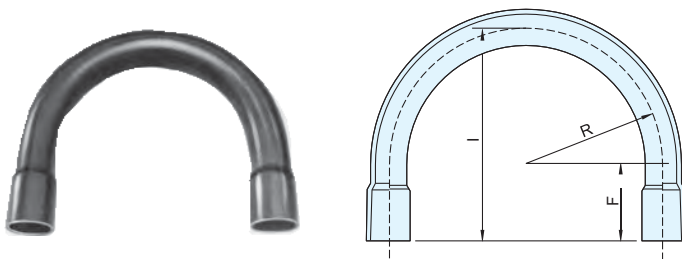

Nominal Dia.	F	I	R	Standards
★13	40	110	70	(M)
★16	45	125	80	
★20	50	140	90	
★25	60	165	105	
★30	65	185	120	
★40	85	225	140	
★50	100	265	165	


Note The "★" mark indicates a made-to-order product.

## HT Loop Bends

Code No. 9262

Unit : mm

(Abbreviation : HT-RB)

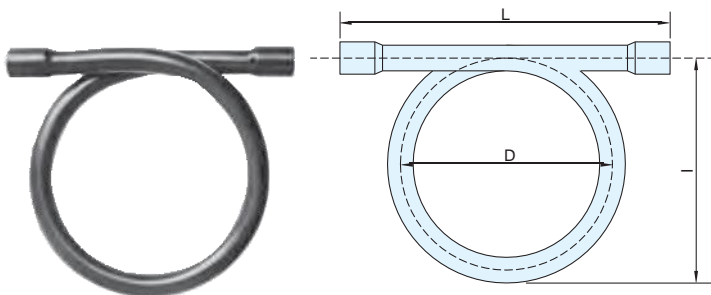

Nominal Dia.	L (min.)	I (Reference)	D	Standards
★13	212	167	158	(M)
★16	256	198	187	
★20	305	230	217	
★25	358	264	248	
★30	406	299	280	
★40	537	340	316	
★50	638	408	378	


Note The "★" mark indicates a made-to-order product.

## HT Hydrant Sockets with Metal Insert

Code No. 3028

Unit : mm

(Abbreviation : HT-MWS)



Nominal Dia.	L	Thread Designation	Standards
13	47	Rp $\frac{1}{2}$	JIS K 6777
16x13	52	Rp $\frac{1}{2}$	
20	61	Rp $\frac{3}{4}$	
20x13	56	Rp $\frac{1}{2}$	(M)
25	69	Rp1	JIS K 6777


- Notes
1. The threads are parallel female threads conform to JIS B0203 (taper pipe threads).
  2. The material of the thread insert is free-cutting brass conforms to JIS H5120 CAC406, JIS H5121 CAC406C or JIS H3250.
  3. Use seal tape on threads for firm sealing. A solvent-free sealing agent must be used when seal tape and sealing agent are used together. If a solvent-containing sealing agent is used, cracks may occur in the hydrant joint.
  4. Excessive tightening of the tapered male threads may cause the RP female thread section to expand and break.
  5. Do not connect the product to a steel pipe with tapered male threads that are fabricated at construction sites.

## HT Hydrant Elbows with Metal Insert

Code No. 3033

Unit : mm

(Abbreviation : HT-MWL)



Nominal Dia.	L <sub>1</sub>	L <sub>2</sub>	Thread Designation	Standards
13	35	29	Rp $\frac{1}{2}$	JIS K 6777
16x13	42	33	Rp $\frac{1}{2}$	
20	51	36	Rp $\frac{3}{4}$	
20x13	48	37	Rp $\frac{1}{2}$	(M)
25	60	40	Rp1	JIS K 6777


- Notes
1. The threads are parallel female threads conform to JIS B0203 (taper pipe threads).
  2. The material of the thread insert is free-cutting brass conforms to JIS H5120 CAC406, JIS H5121 CAC406C or JIS H3250.
  3. Use seal tape on threads for firm sealing. A solvent-free sealing agent must be used when seal tape and sealing agent are used together. If a solvent-containing sealing agent is used, cracks may occur in the hydrant joint.
  4. Excessive tightening of the tapered male threads may cause the RP female thread section to expand and break.
  5. Do not connect the product to a steel pipe with tapered male threads that are fabricated at construction sites.

## HT Valve Sockets with Metal Insert

Code No. 3031

Unit : mm

(Abbreviation : HT-MVS)

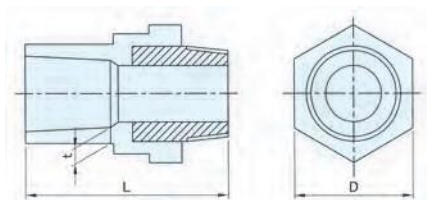

Nominal Dia.	L	D (min.)	t (min.)	Thread Designation	Standards
13x $\frac{1}{2}$	64	34	3.5	R $\frac{1}{2}$	JIS K 6777
16x $\frac{1}{2}$	70	34	3.5	R $\frac{1}{2}$	
20x $\frac{3}{4}$	85	40	4.0	R $\frac{3}{4}$	
25x1	99	45	4.0	R1	
30x1 $\frac{1}{4}$	109	62	4.5	R1 $\frac{1}{4}$	
40x1 $\frac{1}{2}$	114	68	4.5	R1 $\frac{1}{2}$	
50x2	132	84	5.0	R2	


- Notes
1. The threads are parallel male threads conform to JIS B0203 (taper pipe threads).
  2. The material of the thread insert is free-cutting brass conforms to JIS H5120 CAC406, JIS H5121 CAC406C or JIS H3250.

## Thermal-Resistant Expansion Joints

Code No. 1063

Unit : mm

(Abbreviation : HT-EXP.J)

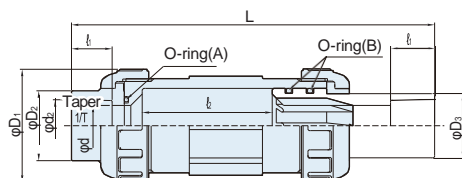

Nominal Dia.	L		d	d <sub>1</sub>	e <sub>1</sub>
	Max.	Min.			
20	243	163	20	26	24
25	250	170	25	32	27

Nominal Dia.	1/T	D <sub>1</sub>	D <sub>2</sub>	D <sub>3</sub>	e <sub>2</sub>	Standards
					Amount of Expansion and Contraction	
20	1/34	60	35	35	80	(M)
25	1/34	70	43	39	80	

# III. PVC-U Pipes and Fittings for Drain and Vent

## 1. Pipes


Meaning of symbols

JIS K6741 : Product conforms to Japanese Industrial Standards JIS K6741

AS59 : Product conforms to Japan PVC Pipe and Fittings Association's standards AS59

(M) : Product conforms to the manufacturer's standards

### Pipes for General Purposes

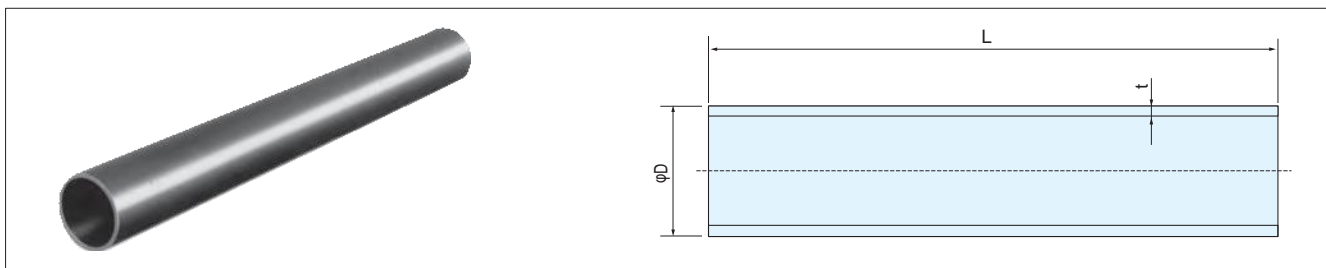

### VP Pipes

Code No. 1001

Unit : mm

Nominal Dia.	Outside Dia.D			Thickness t		Approx. Inside Dia. (Reference)	Length L ±10	Reference Weight		Standards
	Basic Dimension	Max./Min. OD Tolerance	Average OD Tolerance	Min. Dimension	Tolerance			Weight/m kg/m	Weight/m kg/piece	
40	48	±0.3	±0.2	3.6	+0.8	40	4000	0.791	3.2	JIS K 6741
50	60	±0.4	±0.2	4.1	+0.8	51	4000	1.122	4.5	
65	76	±0.5	±0.3	4.1	+0.8	67	4000	1.445	5.8	
75	89	±0.5	±0.3	5.5	+0.8	77	4000	2.202	8.8	
100	114	±0.6	±0.4	6.6	+1.0	100	4000	3.409	13.6	
125	140	±0.8	±0.5	7.0	+1.0	125	4000	4.464	17.9	
150	165	±1.0	±0.5	8.9	+1.4	146	4000	6.701	26.8	
200	216	±1.3	±0.7	10.3	+1.4	194	4000	10.129	40.5	
250	267	±1.6	±0.9	12.7	+1.8	240	4000	15.481	61.9	
300	318	±1.9	±1.0	15.1	+2.2	286	4000	21.962	87.8	

Note For nominal diameter of 30, use VP pipes for water supply shown on page 5.

### VU Pipes

Code No. 1005

Unit : mm

Nominal Dia.	Outside Dia.D		Thickness t		Approx. Inside Dia. (Reference)	Length L ±10	Reference Weight		Standards
	Basic Dimension	Average OD Tolerance	Min. Dimension	Tolerance			Weight/m kg/m	Weight/m kg/piece	
40	48	±0.2	1.8	+0.4	44	4000	0.413	1.7	JIS K 6741
50	60	±0.2	1.8	+0.4	56	4000	0.521	2.1	
65	76	±0.3	2.2	+0.6	71	4000	0.825	3.3	
75	89	±0.3	2.7	+0.6	83	4000	1.159	4.6	
100	114	±0.4	3.1	+0.8	107	4000	1.737	6.9	
125	140	±0.5	4.1	+0.8	131	4000	2.739	11.0	
150	165	±0.5	5.1	+0.8	154	4000	3.941	15.8	
200	216	±0.7	6.5	+1.0	202	4000	6.572	26.3	
250	267	±0.9	7.8	+1.2	250	4000	9.758	39.0	
300	318	±1.0	9.2	+1.4	298	4000	13.701	54.8	
350	370	±1.2	10.5	+1.4	348	4000	18.051	72.2	
400	420	±1.3	11.8	+1.6	395	4000	23.059	92.2	
450	470	±1.5	13.2	+1.8	442	4000	28.875	115.5	
500	520	±1.6	14.6	+2.0	489	4000	35.346	141.4	
600	630	±3.2	17.8	+2.8	592	4000	52.679	210.7	

Meaning of symbols

JIS K6739 : Product conforms to Japanese Industrial Standards JIS K6739

K-1 : Product conforms to Japan Sewage Works Association Standard JSWAS K-1

K-11 : Product conforms to Japan Sewage Works Association Standard JSWAS K-11



AS12 : Product conforms to Japan PVC Pipe and Fittings Association's standards AS12

AS38 : Product conforms to Japan PVC Pipe and Fittings Association's standards AS38

(M) : Product conforms to the manufacturer's standards

## 2. DV and VU-DV Fittings

### Common joint dimensions

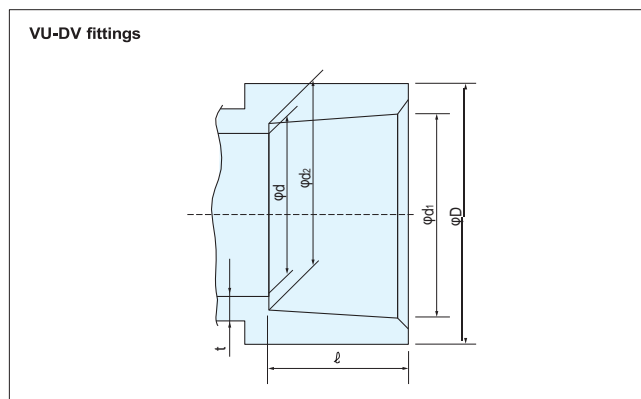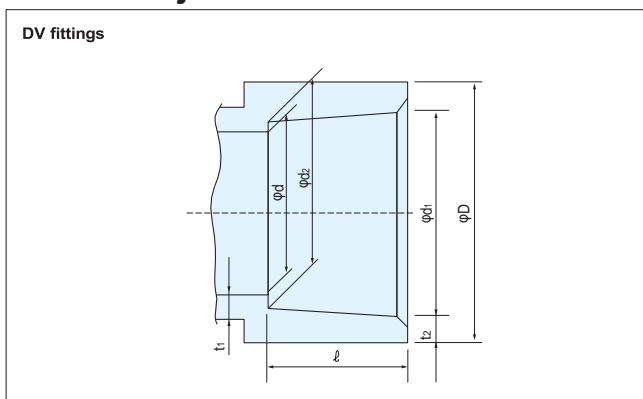

## DV Fittings (VP Stoppers)

Unit : mm

Nominal Dia.	d <sub>1</sub>		d <sub>2</sub>		ℓ		D	d		t <sub>1</sub>	
	Basic Dimension	Tolerance	Basic Dimension	Tolerance	Basic Dimension	Tolerance		Basic Dimension	Tolerance	Min. Dimension	Min. Dimension
30	38.25	±0.25	37.85	±0.25	18	±1	44	31.0	±0.8	2.7	2.5
40	48.30	±0.30	47.80	±0.30	22	±1	54	40.0	±0.9	2.7	2.5
50	60.35	±0.30	59.75	±0.30	25	±1	67	51.0	±0.9	3.1	3.0
65	76.40	±0.30	75.70	±0.30	35	±1	83	67.0	±0.9	3.1	3.0
75	89.45	±0.30	88.65	±0.30	40	±2	97	77.2	±0.9	3.6	3.4
100	114.55	±0.35	113.55	±0.35	50	±2	124	98.8	±1.0	4.5	4.3
125	140.70	±0.40	139.40	±0.40	65	±2	151	125.0	±1.2	5.4	4.7
150	165.85	±0.45	164.25	±0.45	80	±2	178	145.8	±1.3	6.3	5.6

## VU-DV Fittings (VU Stoppers)

Unit : mm


Nominal Dia.	d <sub>1</sub>		d <sub>2</sub>		ℓ		D	d		t
	Basic Dimension	Tolerance	Basic Dimension	Tolerance	Basic Dimension	Tolerance		Basic Dimension	Tolerance	
40	48.30	±0.30	47.80	±0.30	22	±1	54	40(Reference)	—	1.8
50	60.50	±0.30	59.50	±0.30	25	±3	67	56	-0	2.2
65	76.60	±0.30	75.40	±0.30	35	±3	83	71	-0	2.5
75	89.60	±0.30	88.30	±0.30	40	±5	97	83	-0	3.0
100	114.80	±0.40	113.20	±0.40	50	±5	124	107	-0	3.5
125	140.90	±0.40	139.10	±0.40	65	±5	150	131	-0	4.5
150	166.10	±0.50	163.90	±0.50	80	±5	178	154	-0	5.5
200	217.30	±0.55	214.70	±0.55	105	-0	227	202(Reference)	—	5.5(Reference)
250	268.55	±0.60	265.45	±0.60	125(130)	-0	280	250(Reference)	—	6.5(Reference)
300	319.75	±0.65	316.25	±0.65	140(155)	-0	333	298(Reference)	—	7.5(Reference)
350	373.00	±0.70	368.50	±0.70	168	-0	392	347(Reference)	—	9.3(Reference)
400	423.00	±0.75	417.75	±0.75	200	-0	444	395(Reference)	—	10.5(Reference)

Nominal Dia.	Dimension ℓ (min.)	DL	LL	45L	DT	DS	IN
200	105	•	•	•	•	•	•
250	125	•	•	•	•	•	•
	130					•	
300	140	•	•	•	•		
	155					•	

Note Since the dimension ℓ of the fittings with nominal diameters of 200, 250 and 300 varies depending on the type of fitting, check the "•" mark in the above table for available lengths.

## 90° Elbows

(Abbreviation : DL•VU-DL)



## VU-DV Fittings

Code No. 2251

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
40	27	49	28	AS38
50	33	58	31	
65	42	77	43	
75	48	88	54	
100	62	112	70	
125	75	140	84	
150	88	168	82	
200	110	216	114	M
250	142	267	177	
300	168	308	181	
350	196	366	212	
400	222	422	252	

## DV Fittings


Code No. 2151

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
30	22	40	23	JIS K 6739
40	27	49	27	
50	33	58	34	
65	42	77	43	
75	48	88	49	
100	62	112	65	
125	75	140	79.5	
150	88	168	89.5	

## 90° Large Radius Elbows

(Abbreviation : LL•VU-LL)



## VU-DV Fittings

Code No. 2252

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
50	66	91	85	AS38
75	100	140	120	
100	128	178	159	
125	140	205	180	
150	170	250	240	
200	196	301	270	K-1, AS12
250	225	350	225	
300	250	390	250	

## DV Fittings


Code No. 2152

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
40	52	74	75	JIS K 6739
50	66	91	88	
65	90	125	108	
75	100	140	119	
75x50	101 (side 75) / 100 (side 50)	141 (side 75) / 125 (side 50)	—	
100	128	178	152	
100x65	128	178 (side 100) / 163 (side 65)	—	
100x75	128	178 (side 100) / 168 (side 75)	—	
125	140	205	180	
150	170	250	210	

## 45° Elbows

(Abbreviation : 45L•VU-45L)



## VU-DV Fittings

Code No. 2253

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
40	14	36	34	(M)
50	18	43	45	
65	22	57	55	
75	25	65	60	
100	30	80	69	
125	38	103	92	
150	44	124	106	
200	48	153	114	AS12
250	58	183	140	
300	70	210	167	
350	90	258	212	(M)
400	110	310	243	

## DV Fittings


Code No. 2153

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
30	12	30	29	JIS K 6739
40	14	36	30	
50	18	43	42	
65	22	57	52	
75	25	65	58	
100	30	80	69	
125	38	103	90	
150	44	124	109	

## 90° Y

(Abbreviation : DT•VU-DT)



## VU-DV Fittings

Code No. 2254

Unit : mm

Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	Z <sub>3</sub>	L <sub>1</sub>	L <sub>2</sub>	L <sub>3</sub>	Standards
50	34	34	34	59	59	59	AS38
65	42	43	42	77	78	77	
75	48	49	48	88	89	88	
75x 50	34	35	48	74	75	73	
100	62	63	62	112	113	112	
100x 50	34	35	62	84	85	87	
100x 75	48	49	62	98	99	102	
150	89	90	89	169	170	169	AS12
200	113	113	113	218	218	218	
200x100	62	63	116	167	168	166	(M)
200x125	76	73	115	186	183	180	AS12
200x150	88	88	113	198	198	193	
250	139	139	139	264	264	264	(M)
250x200	116	118	141	246	248	251	
300	165	165	165	305	305	305	
350	197	200	197	367	370	367	

## DV Fittings


Code No. 2154

Unit : mm

Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	Z <sub>3</sub>	L <sub>1</sub>	L <sub>2</sub>	L <sub>3</sub>	Standards
30	22	22	22	40	40	40	JIS K 6739
40	27	27	27	49	49	49	
40x 30	22	22	27	44	44	45	
50	34	34	34	59	59	59	
50x 30	22	22	33	47	47	51	
50x 40	27	27	33	52	52	55	
65	42	43	42	77	78	77	
65x 40	27	28	42	62	63	64	
65x 50	34	35	42	69	70	67	
75	48	49	48	88	89	88	
75x 40	27	28	48	67	68	70	
75x 50	34	35	48	74	75	73	
75x 65	42	43	48	82	83	83	
100	62	63	62	112	113	112	
100x 40	27	28	62	77	78	84	
100x 50	34	35	62	84	85	87	
100x 65	42	43	62	92	93	97	
100x 75	48	49	62	98	99	102	
125	75	76	75	140	141	140	(M)
125x 75	49	51	75	114	116	115	
125x100	62	64	75	127	129	125	JIS K 6739
150	89	90	89	169	170	169	
150x 75	51	53	88	131	133	128	(M)
150x100	62	65	88	142	145	138	

## 90° Large Radius Y

(Abbreviation : LT-VU-LT)

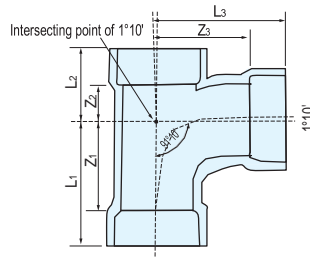

### DV Fittings

Code No. 2155

Unit : mm

Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	Z <sub>3</sub>	L <sub>1</sub>	L <sub>2</sub>	L <sub>3</sub>	Standards
40	52	23	52	74	45	74	JIS K 6739
50	66	26	66	91	51	91	
50x 40	52	23	57	77	48	79	
65	90	33	90	125	68	125	
65x 40	52	24	66	87	59	88	
65x 50	66	27	74	101	62	99	
75	100	30	100	140	70	140	
75x 40	52	25	71	92	65	93	
75x 50	66	29	79	106	69	104	
75x 65	90	32	95	130	72	130	
100	128	45	128	178	95	178	
100x 40	52	28	82	102	78	104	
100x 50	66	32	90	116	82	115	
100x 65	90	36	107	140	86	142	
100x 75	100	33	110	150	83	150	
125	140	50	140	205	115	205	
125x 65	90	38	120	155	103	155	
125x 75	100	42	124	165	107	164	
125x100	128	52	140	193	117	190	
150	170	65	170	250	145	250	
150x 65	90	42	130	170	122	165	
150x 75	100	45	135	180	125	175	
150x100	128	53	152	208	133	202	
150x125	140	60	152	220	140	217	

### VU-DV Fittings


Code No. 2255

Unit : mm

Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	Z <sub>3</sub>	L <sub>1</sub>	L <sub>2</sub>	L <sub>3</sub>	Standards
50	66	26	66	91	51	91	AS38
75	100	30	100	140	70	140	
75x 50	66	29	79	106	69	104	
100	128	45	128	178	95	178	
100x 50	66	32	90	116	82	115	
100x 75	100	33	110	150	83	150	
125	140	50	140	205	115	205	
150	170	65	170	250	145	250	
150x125	140	60	152	220	140	217	
200	196	94	196	301	199	301	
200x100	128	52	176	233	157	226	M
200x150	170	57	196	275	162	276	

## 45° Y

(Abbreviation : Y-VU-Y)

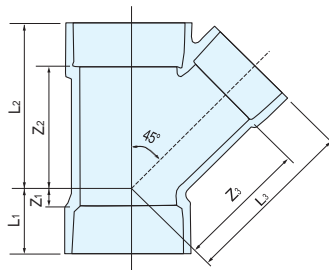

### DV Fittings

Code No. 2157

Unit : mm

Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	Z <sub>3</sub>	L <sub>1</sub>	L <sub>2</sub>	L <sub>3</sub>	Standards
40	12	58	62	34	80	84	JIS K 6739
40x 30	6	50	58	28	72	76	
50	20	72	78	45	97	103	
50x 40	8	62	70	33	87	92	
65	20	92	98	55	127	133	
65x 40	-1	72	82	34	107	104	
65x 50	8	80	88	43	115	113	
75	26	106	115	66	146	155	
75x 40	-6	78	92	34	118	114	
75x 50	3	86	98	43	126	123	
75x 65	14	98	106	54	138	141	
100	32	134	144	82	184	194	
100x 40	-14	96	112	36	146	134	
100x 50	-8	98	118	42	148	143	
100x 65	3	110	125	53	160	160	
100x 75	19	118	132	69	168	172	
125	38	172	175	103	237	240	
125x100	19	150	171	84	215	221	
150	44	204	210	124	284	290	
150x100	6	165	185	86	245	235	

### VU-DV Fittings

Code No. 2257


Unit : mm

Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	Z <sub>3</sub>	L <sub>1</sub>	L <sub>2</sub>	L <sub>3</sub>	Standards
50	20	72	78	45	97	103	AS38
75	26	106	115	66	146	155	
75x 50	3	86	98	43	126	123	
100	32	134	144	82	184	194	
100x 50	-8	98	118	42	148	143	
100x 75	19	118	132	69	168	172	
125	38	172	175	103	237	240	
150	44	204	210	124	284	290	
200	42	258	268	147	363	373	
200x100	-15	200	218	90	305	268	M
200x150	7	224	243	112	329	323	

Note The (Z) mark indicates that the product is manufactured by Maezawa Kasei Industries Co., Ltd.

## 90° Large Radius Double-Y

(Abbreviation : WLT)

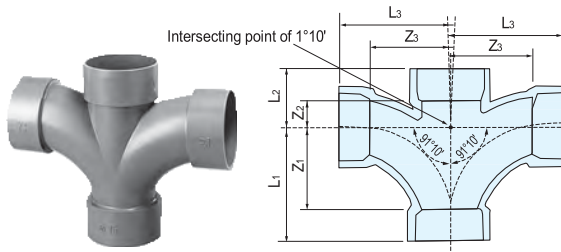

### DV Fittings

Code No. 2156


Unit : mm

Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	Z <sub>3</sub>	L <sub>1</sub>	L <sub>2</sub>	L <sub>3</sub>	Standards
65	90	33	90	125	68	125	JIS K 6739
75	100	38	100	140	78	140	
100	128	45	128	178	95	178	
100x 75	100	40	110	150	90	150	
①125x100	128	52	140	193	117	190	

Note The mark ① indicates that the product is manufactured by Toeikanki Co., Ltd.

## Sockets

(Abbreviation : DS•VU-DS)



### VU-DV Fittings

Code No. 2258

Unit : mm

Nominal Dia.	Z	L	Standards
40	3	47	(M)
50	3	53	AS38
65	3	73	
75	4	84	
100	5	105	
125	5	135	
150	5	165	K-11, AS12
200	5	215	
250	6	270	
300	6	320	
350	12	352	(M)
400	12	412	

### DV Fittings


Code No. 2158

Unit : mm

Nominal Dia.	Z	L	Standards
30	3	39	JIS K 6739
40	3	47	
50	3	53	
65	3	73	
75	4	84	
100	4	104	
125	4	134	
150	4	164	

## Increaser

(Abbreviation : IN•VU-IN)



### VU-DV Fittings

Code No. 2259

Unit : mm

Nominal Dia.	Z	L	Standards
50x 40	20	67	(M)
75x 50	25	90	AS38
75x 65	25	100	
100x 50	30	105	
100x 65	30	115	
100x 75	30	120	
125x100	35	150	
150x100	40	170	
150x125	40	185	(M)
200x100	45	203	
200x125	45	218	
200x150	50	235	
250x200	60	290	AS12

### DV Fittings

Code No. 2159

Unit : mm

Nominal Dia.	Z	L	Standards
40x 30	20	60	JIS K 6739
50x 30	20	63	
50x 40	20	67	
65x 40	20	77	
65x 50	20	80	
75x 40	25	87	
75x 50	25	90	
75x 65	25	100	
100x 40	30	102	
100x 50	30	105	
100x 65	30	115	
100x 75	30	120	
125x 65	35	135	
125x 75	35	140	
125x100	35	150	
150x 75	40	160	(M)
150x100	40	170	JIS K 6739
150x125	40	185	

## For Drain and Vent

[Transparent Type]

Self-lubricating rubber ring


## Unit : mm

Notes	<ol style="list-style-type: none"> <li>1. The dimensions not indicated with a tolerance are reference dimensions.</li> <li>2. The socket dimensions conform to those of JIS K6739 DV fittings. Refer to the approved drawing for the details of dimensions.</li> <li>3. If the large amount of adhesive is applied, cleaning opening could not be opened and closed.</li> <li>4. Note that the cleaning opening of the transparent type is harder to turn than the non-transparent type.</li> </ol>
-------	---

(Abbreviation : VO)




(Nominal Dia.50•65)

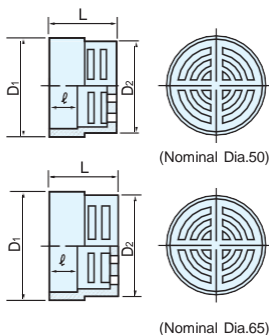


(Abbreviation : VO)



(Nominal Dia.75)

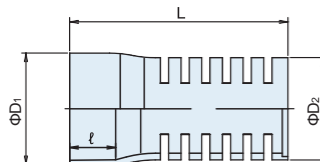


(Nominal Dia.100)



## Unit : mm

Nominal Dia.	D <sub>1</sub>	D <sub>2</sub>	L	$\ell$	Standards
50	68	64.3	50	22	(M)
65	84	80.3	52	22	
75	97	89	190	40	
100	129	114	245	50	

(Abbreviation : VCO)

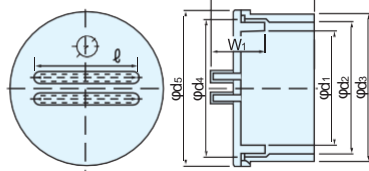


Notes 1. The seal rubber for products with nominal diameters of 40 to 125 is an O-ring.  
2. The seal rubber for products with nominal diameters of 150 and 200 is a flat packing.


## Unit : mm

Nominal Dia.	d <sub>1</sub>	d <sub>2</sub>	d <sub>3</sub>	d <sub>4</sub>	d <sub>5</sub>	W <sub>1</sub>	W <sub>2</sub>	ℓ	Standards
40	32.4	40.4	48	43.0	58	23.0	39	38	(M)
50	45	52.2	60	55.5	69	28.5	44	40	
65	56.8	66.6	76	70.0	88	31.0	56.5	55	
75	70	78.5	89	82.5	100	36.0	65.5	65	
100	91.5	100	114	104.0	125	37.0	74	80	
125	108.9	125	140	130.0	150	52.0	99.5	100	
150	133	146	165	149.8	179	58.0	115	120	
200	183	197	216	197	235	60.0	153.0	165	

(Abbreviation : CO)  
Nominal Dia. : 50,75

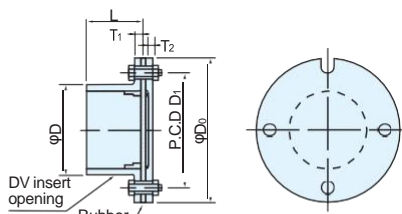


(Abbreviation : CO)  
Nominal Dia. : 65,100~150

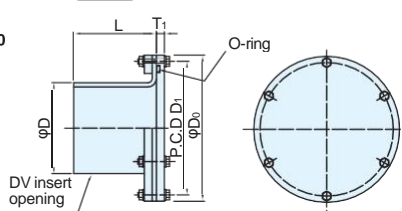


Note The bolts and nuts are made of stainless steel (SUS).

## Unit : mm

Nominal Dia.	D	D <sub>0</sub>	D <sub>1</sub>	L	T <sub>1</sub>	T <sub>2</sub>	Number of Bolt	Standards
50	60	100	85	38	5	8	4	
65	76	120	106	80	10		4	
75	89	130	115	55	5	8	4	
100	114	177	161	100	10		6	
125	140	205	191	112	10		6	
150	165	240	223	130	10		8	

## Valve Sockets

(Abbreviation : DVS)

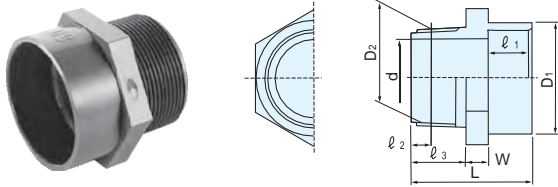

- Notes
1. The male threads conform to JIS B0203 (taper pipe threads) male tapered threads (R).
  2. The socket dimensions conform to JIS K6739.
  3. The products with nominal diameters of 50 and less are hexagon-shaped, and the products with nominal diameters of 65 and more are octagon-shaped.

### DV Fittings


Code No. 2166

Unit : mm


Nominal Dia.	D1	d	ℓ <sub>1</sub>	W	L	Threads				Standards
						D2	ℓ <sub>2</sub>	ℓ <sub>3</sub>	Number of Thread Crests 25.4mm	
40×11/2"	54	40	22	10	58	47.803	12.70	26	11	M
50×2"	67	51	25	12	68	59.614	15.88	31	11	
65×21/2"	83	68	35	15	85	75.184	17.46	35	11	
75×3"	97	77.2	40	16	95	87.884	20.64	39	11	
100×4"	124	98.8	50	18	115	113.030	25.40	47	11	

## Adaptors for Steel Pipes

(Abbreviation : DA) Injection-molded product

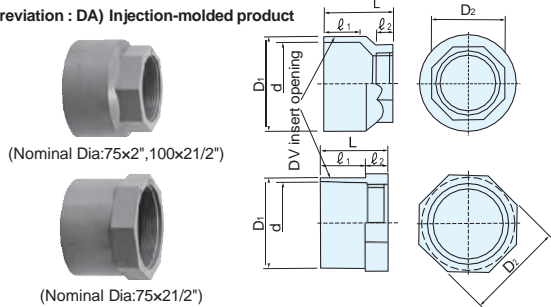

(Abbreviation : DA)  
Fabricated product

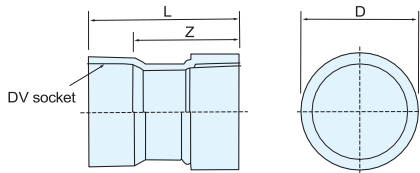

- Notes
1. The female threads conform to JIS B0203 (tapered pipe threads) tapered female threads (Rc).
  2. The DV socket dimensions conform to JIS K6739.

### DV Fittings

Code No. 2160

Unit : mm

Nominal Dia.	ℓ <sub>1</sub>	ℓ <sub>2</sub>	L	D1	D2	d	Nominal Thread Dia.	Standards
75×2"	40	16	65	89	72	77.2	Rc2	M
75×21/2"	45	20	65	89	90	77.2	Rc21/2	

### DV Fittings

Code No. 2160


Unit : mm

Nominal Dia.	Z	L	D	Nominal Thread Dia.	Standards
30×11/4"	62	80	45.2	Rc11/4	M
40×11/2"	68	90	56.3	Rc11/2	
50×2"	85	110	69.3	Rc2	
65×21/2"	90	125	85.4	Rc21/2	
75×3"	95	135	101.2	Rc3	
100×4"	100	150	128.0	Rc4	

## Insert Sockets (Expansion Fittings)


(Abbreviation : ES-A)

Type A

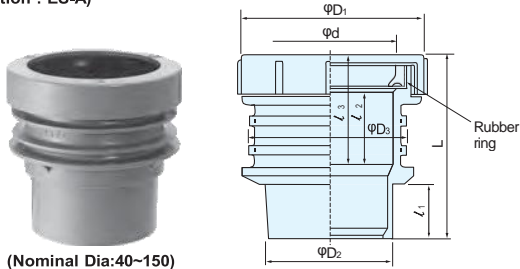

(Nominal Dia: 40~150)

Type B

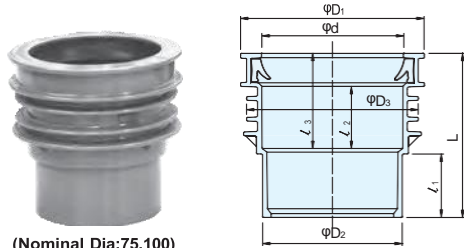

(Nominal Dia: 75, 100)

- Notes
1. The material of the rubber ring is SBR in the case of Type A and EPDM in the case of Type B.
  2. The pipe end to be inserted into the rubber ring end of the insert socket needs to be chamfered by about 1 to 2 mm. Use V Soap or V Spray as a joint lubricant.
  3. These products can be used for horizontal and vertical piping.
  4. The amount of expansion and contraction of each nominal diameter is shown in the table at the right.

### DV Fittings

Code No. 2162

Unit : mm


Nominal Dia.	Type	D1	D2	D3	d	L	ℓ <sub>1</sub>	ℓ <sub>2</sub>	ℓ <sub>3</sub>	Standards
40	A	69	48	60	48.9	80	23	34	48	M
50	A	85	60	76	60.8	85.5	26	35	51	
65	A	110	76	86	77.1	103.5	36	37	58	
75	B	120	89	114	91.0	114	42	43	65	
100	B	150	114	140	115.8	134.5	52	51	78	
125	A	181	140	165	141.2	160.5	66	53	83	
150	A	211	165	191	167.0	191.5	83	65	96	

Nominal Dia.	40	50	65	75	100	125	150
Amount of expansion and contraction	±13	±11	±8	±10	±11	±13	±21

## Repair Sockets (Expansion Fittings)

(Abbreviation : ES-B)

Product name: ES-B+  
(With Lubricant-Free Rubber Ring)

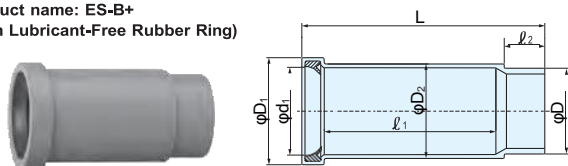

- Notes
1. The material of the rubber ring is self-lubricating chloroprene (CR).
  2. The pipe end to be inserted into the rubber ring socket needs to be chamfered by about 1 to 2 mm.
  3. A lubricant-free rubber ring is used in these products. If it is difficult to insert the pipe, use a lubricant (V Soap or V Spray).
  4. These products can be used with horizontal and vertical piping.

### DV Fittings


Code No. 2163

Unit : mm

Nominal Dia.	D	d	L	$\phi_1$	$\phi_2$	D <sub>1</sub>	D <sub>2</sub>	Standards
50	60	62	135	85	26	78	68	(M)
65	76	78	170	107	36	97	86	
75	89	91	198	125	42	111	98	
100	114	116	240	152	52	140	124	
125	140	142	291	183	67	172	151	
150	165	167	351	223	82	201	178	

## S Sockets

(Abbreviation : VUSS)



### VU-DV Fittings


Code No. 5437

Unit : mm

Nominal Dia.	Z	H	L	Standards
40	20	24	84	(M)
50	25	30	100	
65	32	38	134	
75	37.5	44.5	155	
100	47.5	57	195	

## VU Caps

(Abbreviation : VU-CAP)



### VU-DV Fittings

Code No. 2354

Unit : mm

Nominal Dia.	L(Reference)	$\ell$	D	Standards
40	25	22	54	(M)
50	27	25	67	
65	37.5	35	83	
75	43	40	97	
100	53.5	50	124	
125	69	65	150	
150	85	80	178	
200	115	110	227	
250	138	128	280	
300	154	145	333	


- Notes
1. In buried applications, these products must not be used to cover vertically buried pipes. When they are used to cover horizontally buried pipes, the following burial depth should be as follows.

Allowable burial depths

- 1.2 to 2 m when buried under streets and covered with soil
- 0.6 to 2 m when buried under sidewalks and covered with soil

2. The shape of caps with nominal diameters of 40, 250 and 300 differ from that shown in the diagram.

## 100 Elbows



### DV Fittings

Code No. 2351

Unit : mm

Nominal Dia.	Z	L	Standards
① 100	62	112	(M)

Note The mark ① indicates that the product is manufactured by Toeikanki Co., Ltd.

### VU-DV Fittings


Code No. 2351

Unit : mm

Nominal Dia.	Z	L	Standards
★ 50	31	56	(M)
75	48	88	
100	62	112	

Note The "★" mark indicates a made-to-order product.

## 10° Bushings

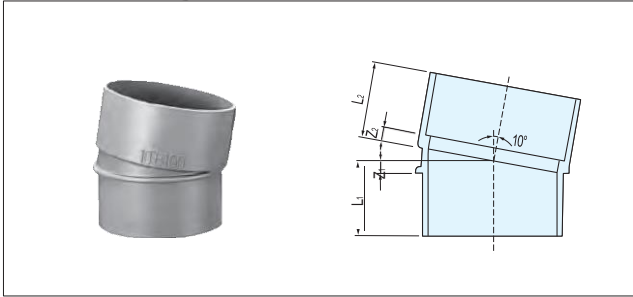

### VU-DV Fittings


Code No. 2353

Unit : mm

Nominal Dia.	Z <sub>1</sub>	L <sub>1</sub>	Z <sub>2</sub>	L <sub>2</sub>	Standards
50	6.0	31	6.0	31	Ⓜ
75	7.8	47.8	7.8	47.8	
100	2.0	52	14.0	64	

## 11° 1/4 Elbows

(Abbreviation : VU111/4 L)

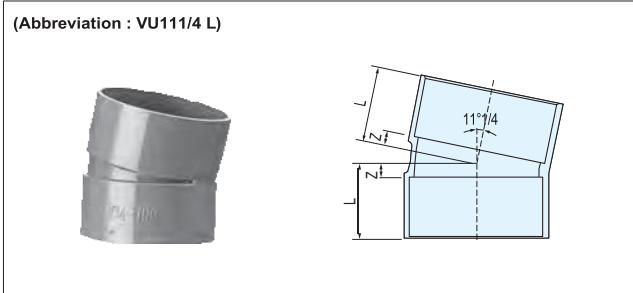

### VU-DV Fittings

Code No. 5430


Unit : mm

Nominal Dia.	Z	L	Standards
★ Ⓢ 75	9	49	Ⓜ
100	11	61	
★ 150	17	97	

- Notes
1. The "★" mark indicates a made-to-order product.
  2. The Ⓢ mark indicates that the product is manufactured by Maezawa Kasei Industries Co., Ltd.

## 22° 1/2 Elbows

(Abbreviation : VU221/2 L)

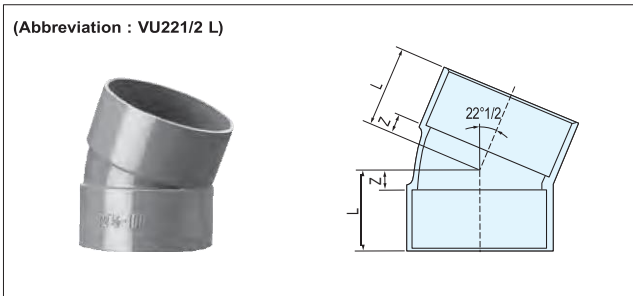

### VU-DV Fittings

Code No. 5431


Unit : mm

Nominal Dia.	Z	L	Standards
★ Ⓢ 50	9	34	Ⓜ
Ⓢ 75	13	53	
100	16	66	
150	26	106	

- Notes
1. The "★" mark indicates a made-to-order product.
  2. The Ⓢ mark indicates that the product is manufactured by Maezawa Kasei Industries Co., Ltd.

## 30° Elbows

(Abbreviation : VU30L)

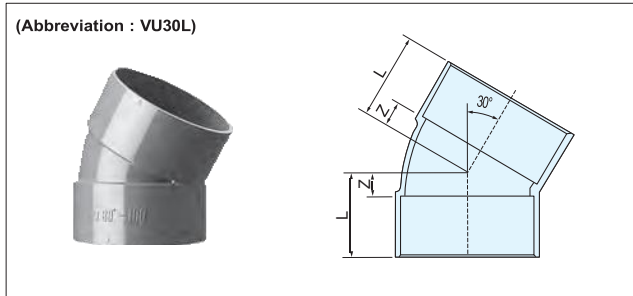

### VU-DV Fittings

Code No. 5432


Unit : mm

Nominal Dia.	Z	L	Standards
50	11	36	Ⓜ
★ Ⓢ 75	16	56	
100	19	69	
150	30	110	

- Notes
1. The "★" mark indicates a made-to-order product.
  2. The Ⓢ mark indicates that the product is manufactured by Maezawa Kasei Industries Co., Ltd.

## 60° Elbows

(Abbreviation : VU60L)

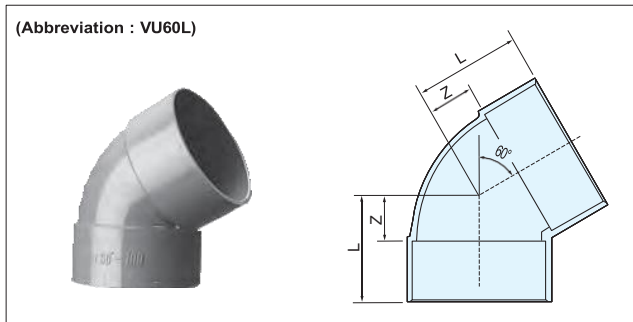

### VU-DV Fittings

Code No. 5433


Unit : mm

Nominal Dia.	Z	L	Standards
★ Ⓢ 75	30	70	Ⓜ
100	37	87	

- Notes
1. The "★" mark indicates a made-to-order product.
  2. The Ⓢ mark indicates that the product is manufactured by Maezawa Kasei Industries Co., Ltd.

## Reducing Elbows

(Abbreviation : VUL)



### VU-DV Fittings

Code No. 5434


Unit : mm

Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	L <sub>1</sub>	L <sub>2</sub>	Standards
50× 40	32	26	54	51	(M)
65× 50	41	33	66	68	
★ 75× 40	48	27	70	67	
75× 50	47	32	72	72	
75× 65	48	41	83	81	
100× 50	61	34	86	84	
100× 75	62	47	102	97	
★ 150×100	88	62	138	142	

Notes 1. The "★" mark indicates a made-to-order product.  
2. The (Z) mark indicates that the product is manufactured by Maezawa Kasei Industries Co., Ltd.

## 45° Single Socket Elbows

(Abbreviation : 45KL)



### VU-DV Fittings


Code No. 5435

Unit : mm

Nominal Dia.	Z <sub>1</sub>	L <sub>1</sub>	Z <sub>2</sub>	Standards
50	18	43	41	(M)
75	25	65	63	
100	30	80	78	

## 90° Single Socket Elbows

(Abbreviation : 90KL)



### VU-DV Fittings

Code No. 5436


Unit : mm

Nominal Dia.	Z <sub>1</sub>	L <sub>1</sub>	Z <sub>2</sub>	ℓ	Standards
(Z) 40	28	50	52	26	(M)
50	33	58	62	28	
(K) 65	41	76	81	39	
75	48	88	93	45	
100	62	112	116	52	

Notes 1. The (Z) mark indicates that the product is manufactured by Maezawa Kasei Industries Co., Ltd.  
2. The products with the (K) mark will change to products manufactured by Maezawa Kasei Industries Co., Ltd. when the current stock of products manufactured by Okubo Plumbing Co., Ltd runs out.

## VU Bushings

(Abbreviation : VUSR)

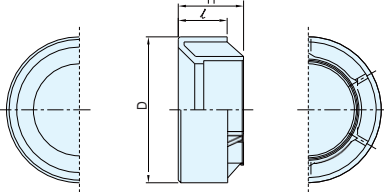

Code No. 5474


Unit : mm

Nominal Dia.	D	ℓ	H	Standards
(Z) 75×50	88.8	30	40	(M)
★ (Z) 100×50	113.8	35	50	
★ (Z) 100×65	113.8	35	50	
★ (Z) 100×75	113.8	35	50	

Notes 1. The "★" mark indicates a made-to-order product.  
2. The (Z) mark indicates that the product is manufactured by Maezawa Kasei Industries Co., Ltd.

## VU Eccentric Bushings

(Abbreviation : VUHB)

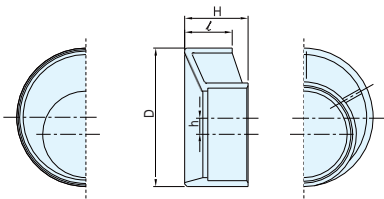

Code No. 5475


Unit : mm

Nominal Dia.	D	ℓ	h	H	Standards
(Z) 75× 40	88.8	30	18	40	(M)
(Z) 75× 50	88.8	30	11	40	
(Z) 75× 65	89.0	30	3.5	40	
(Z) 100× 40	113.8	40	30.5	50	
100× 50	113.7	57	23.6	57	
★ (Z) 100× 65	113.8	40	16	50	
100× 75	113.7	57	8.8	57	
★ (Z) 125×100	139.8	55	8.4	65	
150×100	164.2	87	20.5	87	
150×125	164.7	80	7.4	80	

Notes 1. The "★" mark indicates a made-to-order product.  
2. The (Z) mark indicates that the product is manufactured by Maezawa Kasei Industries Co., Ltd.

## VU Eccentric Sockets

(Abbreviation : OJH)

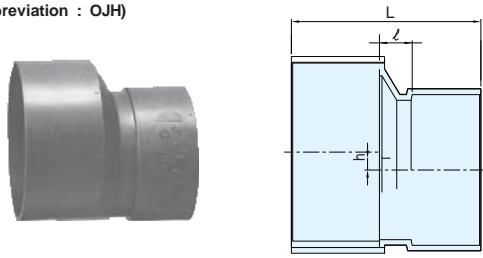

Code No. 5476


Unit : mm

Nominal Dia.	L	$\ell$	h	Standards
② 40× 50	60	13	6	Ⓜ
50× 65	80	20	7	
② 50× 75	95	30	13.5	
② 50×100	115	40	25.5	
② 65× 75	98	23	6	
★② 65×100	122	37	18	
② 75×100	125	35	12	
★② 100×125	145	30	12	
100×150	170	40	23	
125×150	175	30	11.5	

Notes 1. The "★" mark indicates a made-to-order product.  
2. The ② mark indicates that the product is manufactured by Maezawa Kasei Industries Co., Ltd.

## VU Eccentric Repair Sockets (Expansion Fittings)

(Abbreviation : SLRP)

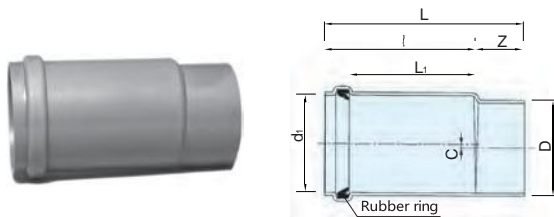

Code No. 5531


Unit : mm

Nominal Dia.	D	d <sub>1</sub>	L	L <sub>1</sub>	$\ell$	C	Z	Standards
★100	114±0.4	115	240	147	181	3.75	59	Ⓜ
150	165±0.5	166	355	218	260	5.75	95	

Note The "★" mark indicates a made-to-order product.

## VU Eccentric Socket (Socket End/Pipe End)

(Abbreviation : HENSIN-S)

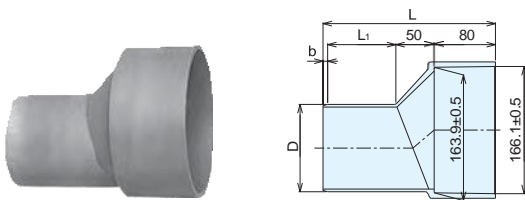

Code No. 5476

Unit : mm


Nominal Dia.	D	L <sub>1</sub>	L	b	Standards
150-100	114±0.4	89	225	6	Ⓜ
★150-125	140±0.5	102	240	8	

Note The "★" mark indicates a made-to-order product.

## Repair Sockets (Expansion Fittings)

(Abbreviation : SLR)

Expansion Fittings

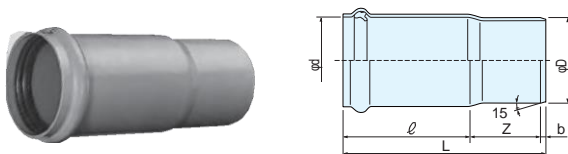

Code No. 5531

Unit : mm


Nominal Dia.	d	D	$\ell$	Z	L	b	Standards
100	115.5	114	209	125	340	6	Ⓜ
125	141.5	140	227	140	375	8	
150	166.5	165	270	155	435	10	
*200	218.6	216	308	180	500	12	AS19

Note It would be difficult to install the pipe, if the small amount of V Soap applied to the rubber ring end.

**Caution** When using on a column pipe, use an insertion jig when connecting.

## VU-VP Conversion Sockets

(Abbreviation : VU-VPS)

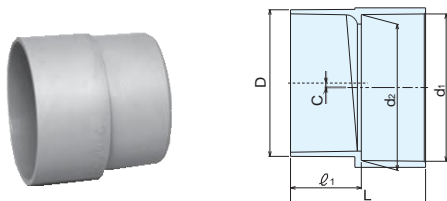

Code No. 5477

Unit : mm

Nominal Dia.	D	$\ell_1$	d <sub>1</sub>	d <sub>2</sub>	L	C	Standards
★ 100	114	55	114.6	113.5	105	3.5	Ⓜ
★ ① 125	140	72	140.9	139.1	137	2	
★ ① 150	165	110	166.1	163.9	190	4	

Notes 1. The "★" mark indicates a made-to-order product.  
2. The "①" mark are manufactured by Takiron Co., Ltd.


### 3. Transparent DV and VU-DV Fittings



1. Be sure to use the Color Tough dyne Blue adhesive (see page 36) for the connection of pipes and fittings.
2. These products cannot be used as pressurized pipes such as for water supply and for hot water supply.
3. Store products indoors. Do not store products under the sun or in extremely hot place.

#### 90° Elbows

(Abbreviation : DL)

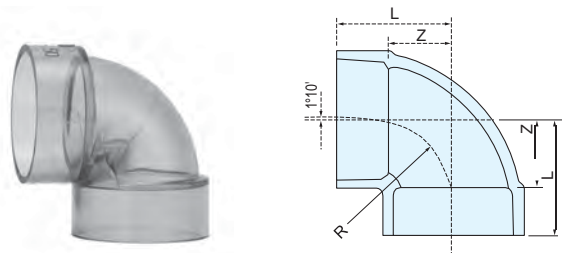

#### Transparent DV Fittings Code No. 2151

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
30	22	40	23	JIS K 6739
40	27	49	27	
50	33	58	34	
65	42	77	43	
75	48	88	49	
100	62	112	65	


#### Transparent VU-DV Fittings Code No. 2251

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
50	33	58	31	AS38
75	48	88	54	
100	62	112	70	

#### 90° Large Radius Elbows

(Abbreviation : LL)

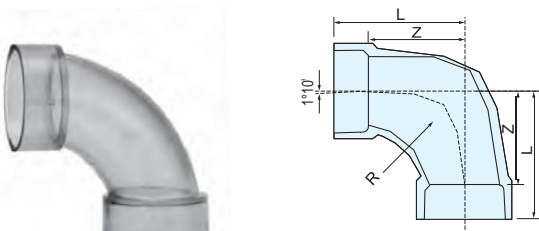

#### Transparent DV Fittings Code No. 2152

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
40	52	74	75	JIS K 6739
50	66	91	88	
65	90	125	108	
75	100	140	119	
100	128	178	152	


#### Transparent VU-DV Fittings Code No. 2252

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
50	66	91	85	AS38
75	100	140	120	
100	128	178	159	

#### 90° Large Radius Reducing Elbows

(Abbreviation : LL)

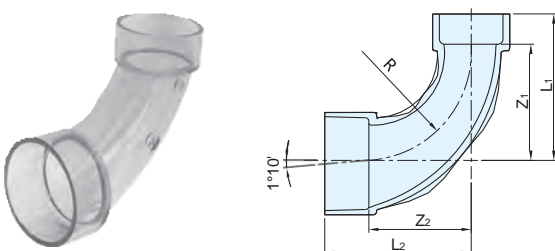


#### Transparent DV Fittings Code No. 2152

Unit : mm

Nominal Dia.	Z <sub>1</sub>	Z <sub>2</sub>	L <sub>1</sub>	L <sub>2</sub>	R(Reference)	Standards
50x40	66	66	88	91	105	(M)

#### 45° Elbows

(Abbreviation : 45L)

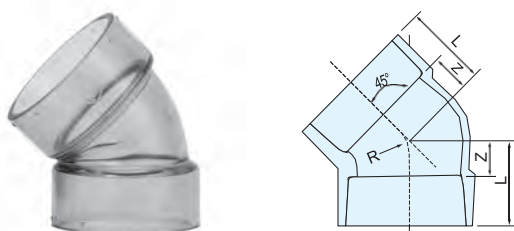

#### Transparent DV Fittings Code No. 2153

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
30	12	30	30	JIS K 6739
40	14	36	31	
50	18	43	44	
65	22	57	52	
75	25	65	58	
100	30	80	69	


#### Transparent VU-DV Fittings Code No. 2253

Unit : mm

Nominal Dia.	Z	L	R(Reference)	Standards
50	18	43	45	AS38
75	25	65	60	
100	30	80	69	

## 90° Y

(Abbreviation : DT)

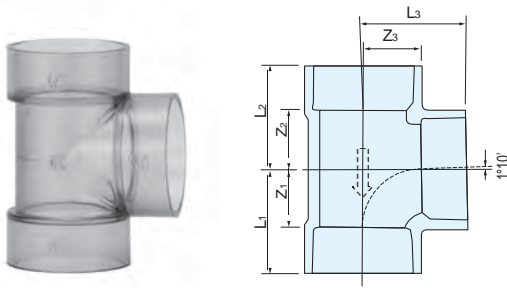

## Transparent DV Fittings

Code No. 2154

Unit : mm

Nominal Dia.	Z1	Z2	Z3	L1	L2	L3	Standards
30	22	22	22	40	40	40	JIS K 6739
40	27	27	27	49	49	49	
40x 30	22	22	27	44	44	45	
50	34	34	34	59	59	59	
50x 40	27	27	33	52	52	55	
65	42	43	42	77	78	77	
65x 40	27	28	42	62	63	64	
65x 50	34	35	42	69	70	67	
75	48	49	48	88	89	88	
75x 50	34	35	48	74	75	73	
100	62	63	62	112	113	112	
100x 50	34	35	62	84	85	87	
100x 75	48	49	62	98	99	102	
125x100	62	64	75	127	129	125	(M)

## Transparent VU-DV Fittings


Code No. 2254

Unit : mm

Nominal Dia.	Z1	Z2	Z3	L1	L2	L3	Standards
50	34	34	34	59	59	59	AS38
75	48	49	48	88	89	88	
75x 50	34	35	48	74	75	73	
100	62	63	62	112	113	112	
100x 50	34	35	62	84	85	87	
100x 75	48	49	62	98	99	102	
150x100	62	63	88	142	143	138	(M)

## 45° Y

(Abbreviation : Y)

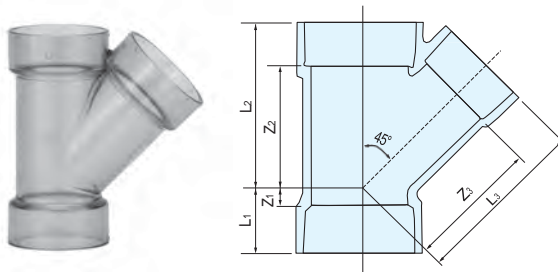

## Transparent DV Fittings

Code No. 2157

Unit : mm

Nominal Dia.	Z1	Z2	Z3	L1	L2	L3	Standards
40	12	58	62	34	80	84	JIS K 6739
50	20	72	78	45	97	103	
50x40	8	62	70	33	87	92	
65	20	92	98	55	127	133	
65x50	8	80	88	43	115	113	
75	26	106	115	66	146	155	
75x50	3	86	98	43	126	123	
100	32	134	144	82	184	194	
100x50	8	98	118	42	148	143	
100x75	19	118	132	69	168	172	

## Transparent VU-DV Fittings

Code No. 2257

Unit : mm


Nominal Dia.	Z1	Z2	Z3	L1	L2	L3	Standards
50	20	72	78	45	97	103	AS38
75x50	3	86	98	43	126	123	
100	32	134	144	82	184	194	

## 90° Large Radius Y

(Abbreviation : LT)



65x50x50



## Transparent DV Fittings

Code No. 2155

Unit : mm

Nominal Dia.	Z1	Z2	Z3	L1	L2	L3	Standards
40	52	23	52	74	45	74	JIS K 6739
50	66	26	66	91	51	91	
50x40	52	23	57	77	48	79	
65	90	33	90	125	68	125	
65x40	52	24	66	87	59	88	
65x50	66	27	74	101	62	99	
75	100	30	100	140	70	140	
65x50x50	66	31	74	101	56	99	(M)
75x50	66	29	79	106	69	104	JIS K 6739
75x65	90	32	95	130	72	130	
100	128	45	128	178	95	178	
100x40	52	28	82	102	78	104	
100x50	66	32	90	116	82	115	
100x65	90	36	107	140	86	142	
100x75	100	33	110	150	83	150	

## Transparent VU-DV Fittings


Code No. 2255

Unit : mm

Nominal Dia.	Z1	Z2	Z3	L1	L2	L3	Standards
50	66	26	66	91	51	91	AS38
75	100	30	100	140	70	140	
75x50	66	29	79	106	69	104	
100	128	45	128	178	95	178	
100x50	66	32	90	116	82	115	
100x75	100	33	110	150	83	150	

## Sockets

(Abbreviation : DS)



### Transparent DV Fittings

Code No. 2158

Unit : mm

Nominal Dia.	Z	L	Standards
30	3	39	JIS K 6739
40	3	47	
50	3	53	
65	3	73	
75	4	84	
100	4	104	

### Transparent VU-DV Fittings


Code No. 2258

Unit : mm

Nominal Dia.	Z	L	Standards
50	3	53	AS38
75	4	84	
100	5	105	

## Increasesers

(Abbreviation : IN)



### Transparent DV Fittings

Code No. 2159

Unit : mm

Nominal Dia.	Z	L	Standards
40x30	20	60	JIS K 6739
50x40	20	67	
65x50	20	80	
75x50	25	90	
75x65	25	100	
100x50	30	105	
100x75	30	120	

### Transparent VU-DV Fittings


Code No. 2259

Unit : mm

Nominal Dia.	Z	L	Standards
75x50	25	90	AS38
100x75	30	120	

## S Sockets

(Abbreviation : SS)



### Transparent DV Fittings

Code No. 5437


Unit : mm

Nominal Dia.	Z	L	H	Standards
50	25	100	30	(M)

Notes 1. The tolerance for the dimension Z is  $\pm 2$  mm.  
2. The dimensions L and H are basic dimensions.

## Insert Sockets (Expansion Fittings)

(Abbreviation : ES-A)
















### Transparent DV Fittings

Code No. 2155




Unit : mm

Nominal Dia.	D <sub>1</sub>	D <sub>2</sub>	D <sub>3</sub>	D	L	ℓ <sub>1</sub>	ℓ <sub>2</sub>	ℓ <sub>3</sub>	Standards
75	120	89	114	91.0	114	42	43	65	(M)
100	150	114	140	115.8	134.5	52	51	78	

## 4. PVC-U Mini-Manhole Product Lineup

Code No.	Abbreviation		Size			Pipe Connection
5409-0100-0151			100	—	150	Solvent cement joint
5409-0100-0200			100	—	200	Solvent cement joint
5409-0150-1201			150	—	200	Solvent cement joint
1592-2150-1301			150	—	300	Rubber ring joint
1592-2200-1301			200	—	300	Rubber ring joint
5202-0100-1200		Left	100	—	200	Solvent cement joint
1593-9015-1301		Left	150	—	300	Rubber ring joint
1593-9020-1301		Left	200	—	300	Rubber ring joint
5202-0100-2200		Right	100	—	200	Solvent cement joint
1593-9015-2301		Right	150	—	300	Rubber ring joint
1593-9020-2301		Right	200	—	300	Rubber ring joint
5202-0100-0150		Left/Right	100	—	150	Solvent cement joint
5202-0150-0200		Left/Right	150	—	200	Solvent cement joint
5203-0100-1200		Left	100	—	200	Solvent cement joint
5203-0150-1200		Left	150	—	200	Solvent cement joint
1593-4515-1301		Left	150	—	300	Rubber ring joint
1593-4520-1301		Left	200	—	300	Rubber ring joint
5203-0100-2200		Right	100	—	200	Solvent cement joint
5203-0150-2200		Right	150	—	200	Solvent cement joint
1593-4515-2301		Right	150	—	300	Rubber ring joint
1593-4520-2301		Right	200	—	300	Rubber ring joint
5203-0100-0150		Left/Right	100		150	Solvent cement joint
5205-0100-1150		Left	100	—	150	Solvent cement joint
5205-0100-1200		Left	100	—	200	Solvent cement joint
5205-0150-1200		Left	150	—	200	Solvent cement joint
5205-0100-2150		Right	100	—	150	Solvent cement joint
5205-0100-2200		Right	100	—	200	Solvent cement joint
5205-0150-2200		Right	150	—	200	Solvent cement joint
5207-0100-1150		Left	100	—	150	Solvent cement joint
5207-0150-1200		Left	150	—	200	Solvent cement joint
5207-0100-2150		Right	100	—	150	Solvent cement joint
5207-0150-2200		Right	150	—	200	Solvent cement joint
5206-0100-1150		Left	100	—	150	Solvent cement joint
5206-0100-2150		Right	100	—	150	Solvent cement joint
5227-0100-0150	WY		100	—	150	Solvent cement joint
5209-0100-0150	WLS		100	—	150	Solvent cement joint
5881-6151-0000	AI Light with Chain			150		
5881-6121-0000				200		
5881-6131-0000				300		
5685-0200-9001	Inner Cover (CV-R)			200		
5685-0300-0001				300		
6527-0120-0001	Cast Iron Cover		T25A	200		
6527-0130-0001				300		
6528-0120-0001			T14A	200		
6528-0130-0001				300		
6529-0120-0001			T8A	200		
6529-0130-0001				300		
6710-0000-9000	Cast Iron Cover Opening/ Closing Jig					
6730-0200-9000	Cast Iron Cover Frame		For T25A and T14A	200		
6730-0300-0000				300		
6731-0200-9000			For T8A	200		
6731-0300-9000				300		

### Caution About the "left" and "right" designations for Mini-Manhole products

Left	Right	Left/Right
<p>Upstream side</p>  <p>Downstream side</p> <p>Direction of view</p>	<p>Upstream side</p>  <p>Downstream side</p> <p>Direction of view</p>	 <p>Can be used in either direction.</p>

The arrow indicates the direction of water flow.

## IV Adhesives

### 1. Vinyl-Base Adhesives

**⚠ The adhesive must not be mixed with other adhesive. If the adhesive is mixed with other adhesive or a solvent, the adhesive strength decreases significantly.**

Usage range of nominal diameters covered by supplied brush

Can size	Guideline range of nominal diameter
100 g	13~50
500 g	13~50
1 kg	65~150

#### Tough dyne HI

Code No. 1039

Product conforms to Japan Water Works Association's standards JWWA S101



100 g can (with brush) 500 g can (with brush) 1 kg can (with brush)

**Use** Bonding of HI products  
(can be used on general pipes and fittings)

**Property** Low viscosity (A), quick drying (viscosity: 500 MPa·s)

**Color** Colorless

#### Tough dyne HI (White)

Code No. 1039

Product conforms to Japan Water Works Association's standards JWWA S101



500 g can (with brush) 1 kg can (with brush)

**Use** Bonding of HI products  
(can be used on general pipes and fittings)

**Property** Low viscosity (A), quick drying (viscosity: 500 MPa·s)

**Color** White

#### Tough dyne Red

Code No. 1039

Product conforms to Japan Water Works Association's standards JWWA S101



500 g can (with brush) 1 kg can (with brush)

**Use** Bonding of general pipes and fittings

**Property** High viscosity (B), quick drying (viscosity: 1,700 MPa·s)

**Color** Colorless

**⚠ Caution** • This adhesive cannot be used to bond HI products.

#### Tough dyne Blue

Code No. 1039

Product conforms to Japan Water Works Association's standards JWWA S101



100 g can (with brush) 500 g can (with brush) 1 kg can (with brush)

**Use** Bonding of general pipes and fittings

**Property** Low viscosity (A), quick drying (viscosity: 150 MPa·s)

**Color** Colorless

**⚠ Caution** • This adhesive dries quickly; therefore, it is not suitable for bonding pipes with nominal diameter of 200 and more.  
• This adhesive cannot be used to bond HI products.

#### Tough dyne HT

Code No. 2039

Product conforms to the manufacturer's standards



100 g can (with brush) 250 g can (with brush) 500 g can (with brush)

**Use** Bonding of HT products

**Property** Low viscosity, quick drying (viscosity: 500 MPa·s)

**Color** Colorless

**⚠ Caution** • This adhesive cannot be used to bond general pipes/fittings or HI products.

(Note) Expiration date is indicated only on the Tough dyne HT can. Please check the expiration date before using.

#### Color Tough dyne Blue

Code No. 1039

Product conforms to the manufacturer's standards



500 g can (with brush) 1 kg can (with brush)

**Use** Bonding of DV fittings

**Property** Low viscosity, quick drying (viscosity: 500 MPa·s)

**Color** Blue

**⚠ Caution** • Use Tough dyne Yellow for drain pipes with nominal diameter of 200 and more.  
• This adhesive must not be used to bond pipes and fittings for water supply such as for drinking water.  
• Be sure to wipe off the adhesive adhered on the base material. The dye contained in the adhesive penetrates the sheet over time. As a result, the blue dye appears on the surface.

#### Tough dyne Yellow

Code No. 1039

Product conforms to the manufacturer's standards



1 kg can (with brush)

3 kg can

**Use** Bonding of general pipes and fittings (nominal diameter of 200 and more)

**Property** High viscosity, slow drying (viscosity: 1,000 MPa·s)

**Color** Colorless

**⚠ Caution** • This adhesive must not be used to bond pipes and fittings for water supply such as for drinking water.  
• When applying to pipes with large diameters, pour a necessary amount of adhesive into a different metal container and use a large brush.

## 2. Selection of Vinyl-Base Adhesive to Use

◎ Recommended ○ Usable × Cannot be used

Pipeline Classification	Pressurized Pipeline						Nonpressurized Pipeline		
Application Classification	Water Supply/Hot Water Supply			General Pressurized Pipe			Drain and Vent		
Pipe Product Classification	HI Product	General Pipe	HT Product	HI Product	General Pipe		HT Product	General Pipe	
Nominal Diameter Classification	150 and less			150 and less	150 and less	200 and more (Note 1)	150 and less	150 and less	200 and more (Note 1)
Tough dyne HI	◎	○	×	◎	○	×	×	○	×
Tough dyne HI (White)	◎	○	×	◎	○	×	×	○	×
Tough dyne Red	×	○ (Note 4)	×	×	○ (Note 4)	◎	×	○ (Note 4)	◎
Tough dyne Blue	×	◎	×	×	◎	×	×	◎	×
Tough dyne HT	×	×	◎	×	×	×	◎ (Note 3)	×	×
Color Tough dyne Blue	×	×	×	×	◎	×	×	◎	×
Tough dyne Yellow	×	×	×	×	×	◎ (Note 2)	×	×	◎

Note 1. When applying the adhesive to pipes with nominal diameter of 200 and more, pour a necessary amount of adhesive into a different metal container and use a large brush.

Note 2. Tough dyne Blue and Color Tough dyne Blue dry quickly; therefore, they are not suitable for bonding pipes with nominal diameter of 200 and more.

Note 3. When bonding HT-DV products to general pipes, such as for the connection of the drain pipe from a dishwasher, use Tough dyne HT.

Note 4. Tough dyne Red is recommended for nominal diameters of 65 and more.

Note 5. Tough dyne Yellow must not be used to bond pipes and fittings for water supply such as for drinking water.

Note 6. Use Tough dyne HI for HI pipes and fittings with nominal diameter of 200 and more.

## 3. Lubricants for Rubber Ring Joints

### V Soap

Code No. 7000

Product conforms to the manufacturer's standards



1 kg resin container (with brush)



2 kg resin container

**Use** Connecting pipes to fittings with rubber ring  
**Property** Liquid  
**Main component** Potassium soap

### V Spray

Code No. 7000

Product conforms to the manufacturer's standards



340ml

**Use** Connecting pipes to fittings with rubber ring  
**Property** Spray  
**Main component** Silicone oil

## 4. Amount of Adhesive and Lubricant to Apply

1. The amount of adhesive/lubricant indicated in the tables are guideline figures. When ordering, add 20% to 30% more to compensate for the loss that can occur at the construction site.

2. The indicated amount is the amount applied on the socket and pipe at one location.

### Amount of vinyl-base adhesive to apply (reference)

#### For TS socket

Nominal Dia.	13	16	20	25	28	30	35	40	50	65	75	100	125	150	200	250	300	350	400	450	500	600
Tough dyne HI/ HI (White)	0.6	0.8	1.1	1.6	—	2.1	—	3.3	4.8	6.6	8.1	13	20	30	55	—	—	—	—	—	—	—
Tough dyne Red	0.9	1.2	1.7	2.4	2.6	3.2	3.5	5.0	7.1	9.9	12	20	30	45	80	130	180	—	—	—	—	—
Tough dyne Blue	0.6	0.8	1.1	1.6	1.7	2.1	2.3	3.3	4.8	6.6	8.1	13	20	30	—	—	—	—	—	—	—	—
Tough dyne HT	0.6	0.8	1.1	1.6	—	2.1	—	3.3	4.8	6.6	8.1	13	20	30	—	—	—	—	—	—	—	—
Tough dyne Yellow	—	—	—	—	—	—	—	—	—	—	—	—	—	—	70	105	150	205	265	330	410	595

Note The indicated amount is for a surface area of 1m<sup>2</sup>. The amount in the table were calculated based on 300 g for Tough dyne Red, 200 g for Tough dyne HI and Tough dyne HI (White) , and 250 g for Tough dyne Yellow.

#### For DV socket

Nominal Dia.	20	25	40	50	65	75	100	125	150	200	250	300	350	400	450	500	600	700
Tough dyne Blue	—	—	4	5	7	10	15	20	30	—	—	—	—	—	—	—	—	—
Color Tough dyne Blue	—	—	4	5	7	10	15	20	30	—	—	—	—	—	—	—	—	—
Tough dyne HT	0.8	1.1	4	5	—	10	—	—	—	—	—	—	—	—	—	—	—	—
Tough dyne Yellow	—	—	—	—	—	—	—	—	—	55	90	125	175	220	275	350	525	700

### Amount of lubricant for rubber ring joint to apply (reference)

Nominal Dia.	40	50	75	100	125	150	200	250	300	350	400	450	500	600
Amount of V Soap used	5	5	7	10	15	20	25	35	50	65	90	115	140	190

Number of application locations per can

Nominal Dia.	150	200	250
Number of joint location per V Spray can	35	23	15

# I Performance and Quality

## 1. Operating Temperature and Pressure

(1) Operating temperature ranges and operating pressure for HI-VP, VP, VU and major fittings

Pipe	Major fitting	Use	Operating temperature range (see notes)		Operating pressure range (see notes)
HI-VP pipe for water supply	HI-TS fitting	Water pipe	Ordinary temperature (5 - 35°C)		0.75 MPa (hydrostatic pressure)
VP pipe for water supply	TS fitting	Pressure pipe	Ordinary temperature (5 - 35°C)		1.0 MPa (hydrostatic + water hammer pressure)
VP pipe for general purposes	DV fitting	Non-pressure pipe	W/o external pressure	5 - 60 °C	—
			W/ external pressure	5 - 45 °C	
VU pipe for general purposes	VU fitting	Non-pressure pipe	W/o external pressure	5 - 60 °C	—
			W/ external pressure	5 - 45 °C	

Notes: 1. The operating temperature range and pressure may vary with the fitting type or joint technique.

2. Since PVC-U pipes expand and contract due to temperature differences, exposed PVC-U pipes require a means to absorb thermal expansion and contraction.

(2) Maximum operating pressures for HT pipes at various temperature

Use	Nominal Dia	Max. operating pressure various temperatures (hydrostatic + water hammer pressure)				
Pipes for hot water and hot-spring water supply (pressure pipe)	13-50	Operating temperature (°C)	50-40	41-60	61-70	71-90 (see Notes)
		Max. operating pressure	1.0 MPa	0.6 MPa	0.4 MPa	0.2 MPa
	65-150	Operating temperature (°C)	50-40	41-60	61-70	71-85 (see Notes)
		Max. operating pressure	1.0 MPa	0.6 MPa	0.25 MPa	0.15 MPa

Notes: 1. The continuous operating temperature range for pressure pipes is 5 to 85°C for nominal diameters of 13 to 50 and 5 to 80°C for nominal diameters of 65 to 150.

2. Since the thermal expansion coefficient of HT pipes due to temperature differences is four to six times those of copper and steel pipes, a means to absorb thermal expansion and contraction are important for HT pipes.

## 2. Performance Specification for VP and HI-VP Pipes for Water Supply

(excerpt from JIS K 6742: 2007)

Performance attribute		Performance	Applicable pipe
Tensile yield strength		Min. 45 MPa for the tensile strength at yield at 23°C.	VP
Pressure resistance (hydrostatic pressure 4.0 MPa x 1 min at ordinary temperature) <sup>1</sup>		Min. 40 MPa for the tensile strength at yield at 23°C.	HI-VP
Flatness		There shall be no leaks and other defects.	VP, HI-VP
Impact resistance		There shall be no cracks.	VP, HI-VP
Vicat softening temperature		There shall be no anomalies.	HI-VP
Opacity		Min. 76°C	VP, HI-VP
Leachability	Turbidity	Visible light transmittance shall be 0.2% or less.	VP
	Chromaticity	Max. 0.5 degree	VP, HI-VP
	Organic matter (TOC)	Max. 1 degree	
	Lead	Max. 1 mg/L	
	Zinc	Max. 0.008 mg/L	
	Reduction in residual chlorine	Max. 0.5 mg/L	
	Odor	Max. 0.7 mg/L	
	Taste	There shall be no anomalies.	

Note: 1. 4.0 MPa is the pressure for the hydrostatic pressure test to check product quality. The maximum operating pressure of VP and HI-VP Pipes for water supply is 0.75 MPa and the maximum operating pressure (water hammer + hydrostatic pressure) is 1.0 MPa.

## 3. Performance Specification for VP Pipes for General Purposes

(excerpt from JIS K 6741: 2007)

Performance attribute	Performance	Applicable pipe
Tensile yield strength	Min. 45 MPa for the tensile strength at yield at 23°C.	VP, VM, VU
Pressure resistance (VP: hydrostatic pressure 2.5 MPa x 1 min at ordinary temperature) <sup>1</sup>	There shall be no leaks or other defects.	VP, VM, VU
Joint pressure resistance <sup>1, 2</sup>	There shall be no leaks or other defects.	VP, VM, VU
Flatness	There shall be no cracks.	VP, VM, VU
Vicat softening temperature	Min. 76°C	VP, VM, VU

Notes: 1. 2.5 MPa is the pressure for the hydrostatic pressure test to check product quality. The maximum operating pressure (water hammer + hydrostatic pressure) of VP pipes for general purposes is 1.0 MPa.

2. The joint pressure resistance applies to pipes with rubber ring and bonding-type ends for pressure applications. For these pipes, this joint pressure resistance test may be substituted for a pressure test.

## 4. Performance Specification for HT-VP Pipes for Hot Water Supply

(excerpt from JIS K 6776: 2007)

Performance attribute	Performance	Applicable pipe
Tensile yield strength	Min. 50 MPa for the tensile strength at yield at 23°C.	HT
Pressure resistance (hydrostatic pressure 4.0 MPa x 1 min at ordinary temperature) <sup>1</sup>	There shall be no leaks other defects.	HT
Hot internal pressure creep performance	There shall be no leaks other defects.	HT
Flatness	There shall be no cracks.	HT
Vicat softening temp erasure	Min. 95°C	HT
Leachability <sup>2</sup>	Turbidity	HT
	Chromaticity	
	Organic matter (TOC)	
	Lead	
	Zinc	
	Odor	
	Taste	
	Reduction in residual chlorine	

Notes: 1. 4.0 MPa is the pressure for the hydrostatic pressure test to check product quality. The operating temperature and the maximum operating pressure of HT Pipes for hot water supply are as per item 1.

2. Unless otherwise specified, a leachate at 90±2°C shall be used in the leaching test.

3. "Leachate at 90±2°C" means a leaching test using a leachate at 90±2°C.

4. "Leachate at ordinary temperature" means a leaching test using a leachate at ordinary temperature.

## 5. General Properties of VP, HI-VP and HT-VP Products

	Attribute	Units	VP	HI	Test method	HT	Test method
Physical properties	Color	—	Gray	Grayish blue	—	Brown	—
	Specific gravity	—	1.43	1.40	JIS K 7112 Sink-float method 20°C	1.48	ASTM D 792 20°C
	Hardness	Rockwell R	115	115	ASTM D 785 20°C	140	JIS K 7202 20°C
	Water absorption	One week at ordinary temperature mg/cm <sup>2</sup>	Max. 0.15	Max. 0.15		Max. 0.15	
Mechanical properties	Tensile strength	MPa (kgf/cm <sup>2</sup> )	49-54(500-550)	49-54(500-530)	JIS K 6742 23°C, etc.	49-54 (500-550)	JIS K 6776 20°C
	Longitudinal elastic modulus	MPa (kgf/cm <sup>2</sup> )	2942 (3X10 <sup>4</sup> )	2942 (3X10 <sup>4</sup> )	JIS K 7113 20°C	2942 (3X10 <sup>4</sup> )	ASTM D 747 20°C
	Elongation at fracture	%	50-150	50-150	JIS K 6741 20°C	40-80	JIB K 6741 20°C
	Bending strength	MPa (kgf/cm <sup>2</sup> )	78.5-98.1 (800-1000)	78.5-98.1 (800-1000)	JIS K 7203 20°C 65%RH	89 (900)	ASTM D 970 20°C
	Bending elastic modulus	MPa (kgf/cm <sup>2</sup> )	2746(2.8X10 <sup>4</sup> )	2746(2.8X10 <sup>4</sup> )	JIS K 7203 20°C 65%RH	—	—
	Compression strength	MPa (kgf/cm <sup>2</sup> )	69(700)	64(650)	JIS K 7208 20°C 85%RH	69 (700)	ASTM D 695 20°C
	Poisson's ratio	—	0.35-0.40	0.35-0.40		0.38	—
Thermal properties	Charpy impact strength	kJ/m <sup>2</sup> (kgf-cm/cm <sup>2</sup> )	6.9-9.8(7-10)	Min. 17.7		7.84X10 <sup>-2</sup> (8.0)	ASTM D 256
	Vicat softening temperature	°C	Min. 76	Min. 76	JIS K 6742	Min. 95	JIS K 6776
	Linear expansion coefficient	1/°C	6-8X10 <sup>-5</sup>	6-8X10 <sup>-5</sup>		6-8X10 <sup>-5</sup>	
	Specific heat	J/(kg·K) (cal/g·°C)	1.05X10 <sup>3</sup> (0.25)	1.05X10 <sup>3</sup> (0.25)		1.05X10 <sup>3</sup> (0.25)	
	Thermal conductivity	W/(m <sup>2</sup> ·K) (kcal/m·h·°C)	0.15 (0.13)	0.15 (0.13)	DIN 8061	0.15 (0.13)	DIN 8061
Electrical properties	Combustibility	—	Self-extinguishability	Self-extinguishability		Self-extinguishability	—
	Voltage resistance	kV/mm	Min. 40	Min. 40		Min. 40	—
	Volume resistivity	Ωcm	5.3X10 <sup>15</sup>	5.3X10 <sup>15</sup>	30°C 65%RH	5.3X10 <sup>15</sup>	ASTM D 257
	Dielectricity 60 Hz	—	3.2	3.2	30°C 55%RH	3.2	ASTM D 150
	Dielectricity 10 <sup>3</sup> Hz	—	3.1	3.1		—	—
	Dielectricity 10 <sup>6</sup> Hz	—	3.0	3.0		—	—
	Power factor 60 Hz	10 <sup>2</sup>	1.18	1.18	30°C 55%RH	—	—
	Power factor 10 <sup>3</sup> Hz	10 <sup>2</sup>	1.91	1.91		—	—
	Power factor 10 <sup>6</sup> Hz	10 <sup>2</sup>	1.72	1.72		—	—

Note: The above values indicate typical values.

## 6. Chemical Resistance of VP and HI-VP Products



The chemical resistance in the table is only for reference. Please consult us when using VP and HI-VP products for chemicals.

	Chemical name	Temperature (°C)				Chemical name	Temperature (°C)				Chemical name	Temperature (°C)		
		20	40	60			20	40	60			20	40	60
Acids	Hydrochloric acid 35%	⊗	⊗	△	Alkali	Aqueous ammonia 30%	⊗	○	△	Organic chemicals	Ethyl acetate	x	x	x
	Sulfuric acid 60%	⊗	⊗	△		Lime milk	⊗	⊗	⊗		Ethylene chloride	x	x	x
	Sulfuric acid 98%	x	x	x		Most metal chlorides, nitrates, sulfates	⊗	⊗	○		Formalin	⊗	○	○
	Nitric acid 70%	○	△	x		Potassium bichromate 10%	⊗	○	△		Carbon bisulfide	x	x	x
	Nitric acid 95%	x	x	x		Potassium perchlorate 1%	○	△	x		Acetaldehyde	x	x	x
	Mixed acid H <sub>2</sub> SO <sub>4</sub> + HNO <sub>3</sub> 50-10%:20-40%	⊗	○	○		Potassium permanganate 15%	⊗	○	△		Gasoline	△		
						Sodium hypochlorite	△*	△*	x		Petroleum	x	x	x
	50%:50%	△	x	x		Methylene chloride	x	x	x		Aromatic hydrocarbon	x	x	x
	Mixed acid: CrO <sub>3</sub> : H <sub>2</sub> SO <sub>4</sub> 25%:25%	x	x	x		Triol (toluene)	x	x	x		Glycerin	⊗	⊗	⊗
	Hydrogen fluoride 10%	⊗	⊗	△	Organic chemicals	Trichloroethylene	x	x	x		Oil, fat	⊗	⊗	⊗
	Phosphoric acid	⊗	⊗	△		Acetone	x	x	x		Cresol solution 5%	x	x	x
	Acetic acid 95%>	○	△	△		Ketones	x	x	x		Lacquer, thinner	x	x	x
	Acetic acid ≥95%	△	x	x		Methyl alcohol	⊗	△	x	Gas	Dry chlorine gas 100%	△	x	x
	Aminoformic acid 50%	⊗	○	x		Ethyl ether	x	x	x		Wet chlorine gas 5%	△	x	x
	Oxalic acid	⊗	⊗	⊗		Ethyl alcohol	⊗	○	△		Ammonia, many other gaseous wastes	⊗	○	○
	Lactic acid	○	△	△		Butyl alcohol	⊗	○	△		Seawater, brine	⊗	⊗	⊗
	Hydrogen peroxide 30%	⊗	○	△		Aniline	x	x	x	Other	Ant repellent	x	x	x
	Caustic soda 40%>=	⊗	⊗	○		Benzene	x	x	x		Wood preservative (creosote)	x	x	x
	Caustic potash 40%>=	⊗	⊗	○		Carbon tetrachloride	x	x	x					
					Alkali	Chloroform	x	x	x					

Notes: ⊗: not eroded at all ○: not apparently eroded △: slightly eroded x: unusable

For chemical marked with \*, VP and HI-VP products may not be used depending on the service conditions. Please consult us.

## 7. Chemical Resistance of HT-VP Products



The chemical resistance in the table is only for reference. Please consult us when using HT-VP products for chemicals.

	Chemical name	Temperature (°C)					Chemical name	Temperature (°C)					Chemical name	Temperature (°C)			
		20	40	60	80			20	40	60	80			20	40	60	80
Acids	35% hydrochloric acid	⊗	⊗	⊗	○	Alkali	50% caustic soda	○	○	△	x	Organic chemicals	Oil, fat	⊗	⊗	⊗	○
	Nitric acid 70%>	○	x	x	x		60% caustic potash	⊗	○	○	○		Ethyl ether	X	—	—	—
	Sulfuric acid 90%>	⊗	⊗	○	△		Saturated ammonia water	⊗	⊗	⊗	○		Hexane	⊗	—	—	—
	Hypochlorous acid	△	x	x	x		Chlorine, sulfurous acid	○	—	—	—		Creosote	x	x	x	x
	50% chromium acid	△	x	x	x	Gas	Ammonia	⊗	⊗	○	△	Organic chemicals	Benzol	x	x	x	x
	Acetic acid 95%>	○	△	x	x		Most metal chlorides	⊗	⊗	⊗	○		Formalin	⊗	⊗	○	—
	Chloroacetic acid	⊗	○	○	x		Potassium perchlorate	⊗	⊗	⊗	○		Benzin	x	—	—	—
	Oxalic acid	⊗	⊗	⊗	⊗		Ethanol	⊗	○	○	△	Other	Ketones	x	—	—	—
	Lactic acid	⊗	⊗	○	○	Organic chemicals	Butanol	⊗	⊗	⊗	○		Plating solutions	⊗	⊗	○	○
	Fatty acid	○	○	○	△		Carbon tetrachloride	x	x	x	x		Petroleum	x	x	x	x
	Maleic acid	⊗	⊗	⊗	⊗		Glycerin	⊗	⊗	⊗	⊗						

Note: ⊗: not eroded at all ○: not apparently eroded △: slightly eroded (usable with restrictions on length of period and pressure) x: unusable

## II Installation Design

### 1. Installation Design for HT Pipes for Hot Water Supply

#### 1.1 Main check points

##### (1) Operating temperature ranges and operating pressure (hydrostatic + water hammer pressure)

**Nominal diameters of 50 and less** (JIS K 6776)

Operating temperature (°C)	5~40	41~60	61~70	71~90(Note)
Maximum operating pressure (MPa)	1.0	0.6	0.4	0.2

Note : Continuous normal operating maximum temperature is 85°C.

**Nominal diameters of 65 and more** (manufacturer's standards)

Operating temperature (°C)	5~40	41~60	61~70	71~85(Note)
Maximum operating pressure (MPa)	1.0	0.4	0.25	0.15

Note : Continuous operating maximum temperature is 80°C.

##### (2) Applications which HT pipes cannot be used

- Do not use HT pipes for instant water heaters since the water temperature can be as high as 100°C when the water flow rate decreases.
- Do not use HT pipes for solar water heaters or heat exchangers since the water temperature can be as high as 100°C.
- If the water heater is other than the types above and it directly receives water pressure, it is necessary to take a measure such as installing a pressure reducing valve.

##### (3) About expansion and contraction protection

- Use expansion joints or form a pipe loop.
- Use fixed supports at pipe sections near tees and elbows because the expansion and contraction force in the hot water supply pipe acts on the fittings.

\* For details, refer to "1.5 Pipe Expansion and Contraction Protection" and "1.6 Pipe Supports."

##### (4) About buried pipes

- When burying pipes in concrete, use casing pipes or bury the pipes to a depth of less than 1 m, and do not bury fittings.
- When burying pipes under dirt floor or outdoors, do not use elbows at bending parts. Bends are only recommended at bending parts.
- Do not bury pipes that branch to multiple faucets, such as pipes to a bathroom.

##### (5) About freeze-up prevention and thermal insulation

For pipes that may freeze, take a freeze-up prevention measure such as installation of water drain port or thermal insulation material.

### 1.2 Head Loss in Pipeline

#### (1) Friction head loss in straight pipe sections

Use the following Darcy-Weisbach Equation to calculate the friction head loss in a straight pipe section.

$$h = \lambda \frac{l}{d} \cdot \frac{V^2}{2g}$$


h : Friction head loss in straight pipe section (m)

λ : Friction loss coefficient (0.02)

l : Pipeline length (m)

d : Pipe inside diameter (m) V :  
Pipe flow velocity (m/sec)

g : Gravitational acceleration (9.8 m/sec<sup>2</sup>)


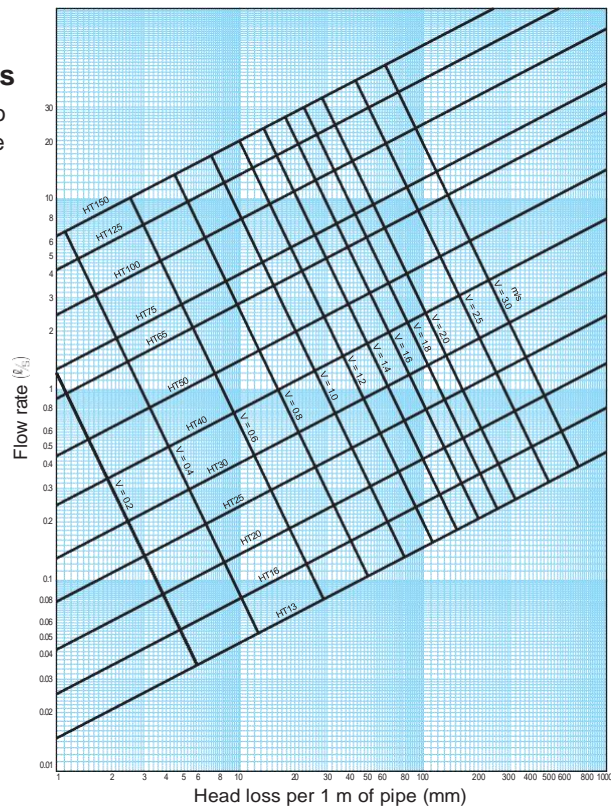


#### (2) Head loss in fitting (reference)

The head loss in a fitting can be determined by calculation according to the shape of the fitting. For the calculation, a fitting is usually converted to a straight-pipe-equivalent length and added as an extension pipe to the straight pipe section to determine head loss.

##### Straight-pipe-equivalent lengths for the calculation of head loss in fittings

Unit : m

Fitting \ Nominal Dia.	13	16	20	25	30	40	50	65	75	100
Elbow	0.2	0.3	0.4	0.5	0.5	0.7	0.9	1.2	1.4	1.8
90° Bend	0.1	0.1	0.1	0.2	0.2	0.2	0.3	0.4	0.5	0.6
45° Bend	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.3	0.3	0.4
Same-diameter tee 	0.2	0.3	0.4	0.5	0.5	0.7	0.9	1.2	1.4	1.8
Same-diameter tee 	0.7	0.8	1.0	1.3	1.5	2.0	2.5	3.3	3.8	5.0
Reducer (1: 0.5)	—	0.1	0.1	0.1	0.2	0.2	0.3	0.3	0.4	0.5
Gate valve (fully open)	0.1	0.1	0.2	0.2	0.2	0.3	0.4	0.4	0.5	0.7
Stop valve (fully open)	5.5	5.5	7.6	9.1	12.1	13.6	18.2	21.2	26.0	36.0

## 1.3 Temperature Drop and Thermal Insulation

HT pipes offer excellent thermal insulation performance, so no insulation measure is necessary for short-distance hot water supply pipes. However, to reduce the electricity/gas expenses, use commercially available easy-to-install heat insulation covers on heating/cooling equipment pipes.

Use the following formula to calculate the temperature drop in HT pipes used for hot water supply.

$$t_o = t_a + (t_i - t_a) e^{-\left(\frac{2\pi L}{R \cdot C_p \cdot Q}\right)}$$

$t_o$  : Water temperature at pipe outlet (°C)

$t_a$  : Outdoor air temperature (°C)

$t_i$  : Water temperature at pipe inlet (°C)

$e$  : Base of natural logarithm (2.71828)

$L$  : Pipe length (m)

$R$  : Heat transfer resistance (h·m·°C/Kcal)

$C_p$  : Specific heat of water (1 Kcal/kg·°C)

$Q$  : Water flow rate (kg/h)

Use the following formula to calculate heat transfer resistance  $R$ . Note that heat transfer resistance  $R$  varies depending on whether thermal insulation is installed or not.

### (1) For exposed bare pipes

$$R = \frac{2}{h_a \cdot D} + \frac{1}{\lambda} \ln \frac{D}{d} + \frac{2}{h_w \cdot d}$$

### (2) For exposed thermally insulated pipes

$$R = \frac{2}{h_a \cdot D_o} + \frac{1}{\lambda_o} \ln \frac{D_o}{D} + \frac{1}{\lambda} \ln \frac{D}{d} + \frac{2}{h_w \cdot d}$$

$h_a$  : Coefficient of heat transfer to outside air (10 Kcal/h·m²·°C)

$h_w$  : Heat transfer coefficient of water in pipe

(Min. 3,000 Kcal/h·m²·°C)

$d$  : HT pipe inside diameter of (m)


$D$  : HT pipe outside diameter (m)

$D_o$  : Outside diameter of thermally insulated pipe (m)

$\lambda$  : Thermal conductivity of HT pipe (0.12 Kcal/h·m·°C)

$\lambda_o$  : Thermal conductivity of thermal insulation material (Kcal/h·m·°C)

### Example of temperature drop in exposed bare pipe

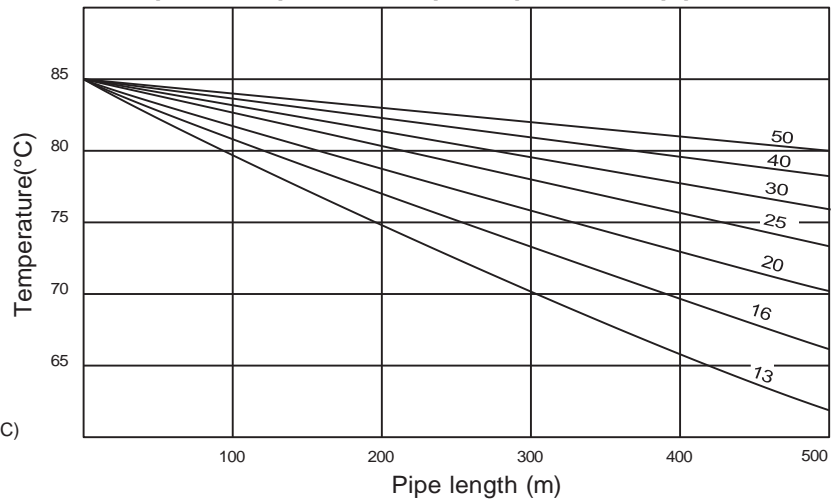


Conditions: Pipe inlet temperature at 85°C, outside air temperature at 0°C, pipe flow velocity at 1.5 m/s

### Thermal transfer coefficient of thermal insulation materials

Unit : cm

Thermal Insulation Material	Thermal Conductivity (Kcal/h·m·°C)
Magnesium carbonate	0.040~0.048
Diatomaceous earth	0.053~0.097
Rock wool	0.046~0.056
Cow fur felt	0.046~0.047
Hemp felt	0.046~0.050
Carbonized cork	0.043~0.046
Glass fiber	0.039~0.057
Polyurethane foam	0.027~0.047

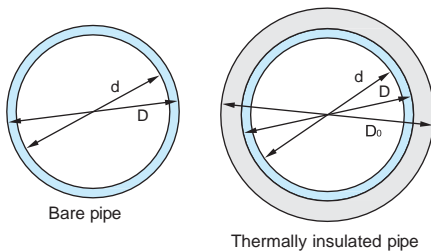

## 1.4 Thermal Expansion and Contraction and Thermal Stress

### (1) Thermal expansion and contraction

The linear expansion coefficient  $\alpha$  of a HT pipe is usually  $7 \times 10^{-5}/^{\circ}\text{C}$ , which is 4 to 6 times higher than that of a steel pipe or copper pipe. The amount of expansion and contraction resulting from a change in the temperature inside the pipe can be obtained with the following formula. According to the formula, the amount of expansion and contraction per 1 m of pipe resulting from a temperature change of  $10^{\circ}\text{C}$  is 0.7 mm.

$$\Delta \ell = \alpha \cdot \ell \cdot \Delta t$$

$\Delta \ell$  : Amount of expansion and contraction (cm)  $\alpha$   
: Linear expansion coefficient ( $7 \times 10^{-5}/^{\circ}\text{C}$ )  $\ell$   
: Pipe length (cm)  
 $\Delta t$  : Temperature difference ( $^{\circ}\text{C}$ )

### (2) Thermal stress

When the HT pipe movement in the axial direction is restricted and the temperature increases, compressive stress generates. When the temperature decreases, tensile stress generates. The thermal stress values can be obtained with the following formula. By multiplying a thermal stress value by the cross-sectional area of the pipe, the amount of expansion and contraction force that is generated due to the heat and acts on the pipe body can be obtained.

$$\sigma = \alpha \cdot E \cdot \Delta t$$

$\sigma$  : Thermal stress (kN/cm²)  
 $E$  : Elastic modulus of pipe (kN/cm²)

## 1.5 Pipe Expansion and Contraction Protection


Since HT pipes have a higher linear expansion coefficient than metal pipes, it is important to protect HT pipes against thermal expansion and contraction when designing pipe installation.

By either using expansion fittings or using a special piping method, thermal expansion and contraction can be absorbed for the protection of pipes, fittings and equipments.


### (1) Types of expansion and contraction protection

#### Expansion fittings


Loop Bend (nominal diameter: 13 to 50 mm)




U-shape expansion pipe loop (nominal diameter: 13 to 50 mm)

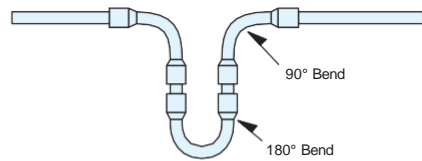

Metal expansion pipe loop (nominal diameter: 13 to 25 mm)

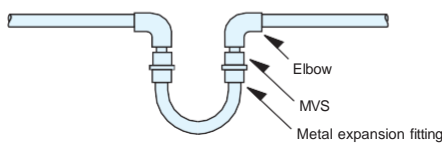


Thermal-resistant expansion joint (nominal diameter: 20 to 25 mm)




( Do not use this expansion joint in a concealed location.  
It is difficult to conduct maintenance of the joint installed in a concealed location. )

#### Piping method

Pipe loop formed with elbows (for branching)

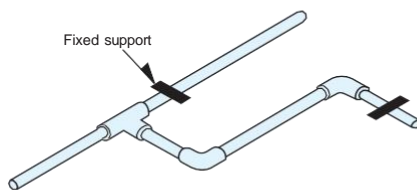


Pipe loop formed with Bend (nominal diameter: 13 to 50 mm)

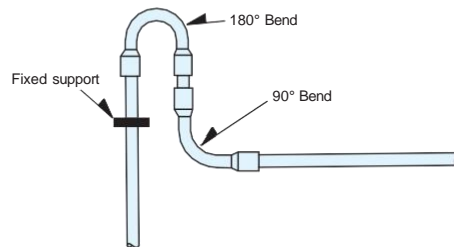

### (2) Selection of expansion and contraction protection method

The amount of expansion and contraction absorbed varies depending on the type of expansion and contraction protection method, such as installation of expansion fittings or use of a special piping method. Select the most suitable expansion and contraction protection method to use based on the difference between the temperature at the time of pipe installation and the temperature during hot water supply or between the temperature at the time of pipe installation and the temperature during the cold season as well as the length of the straight pipe section and by referring to the diagram below.

Selection of expansion and contraction protection method based on temperature difference

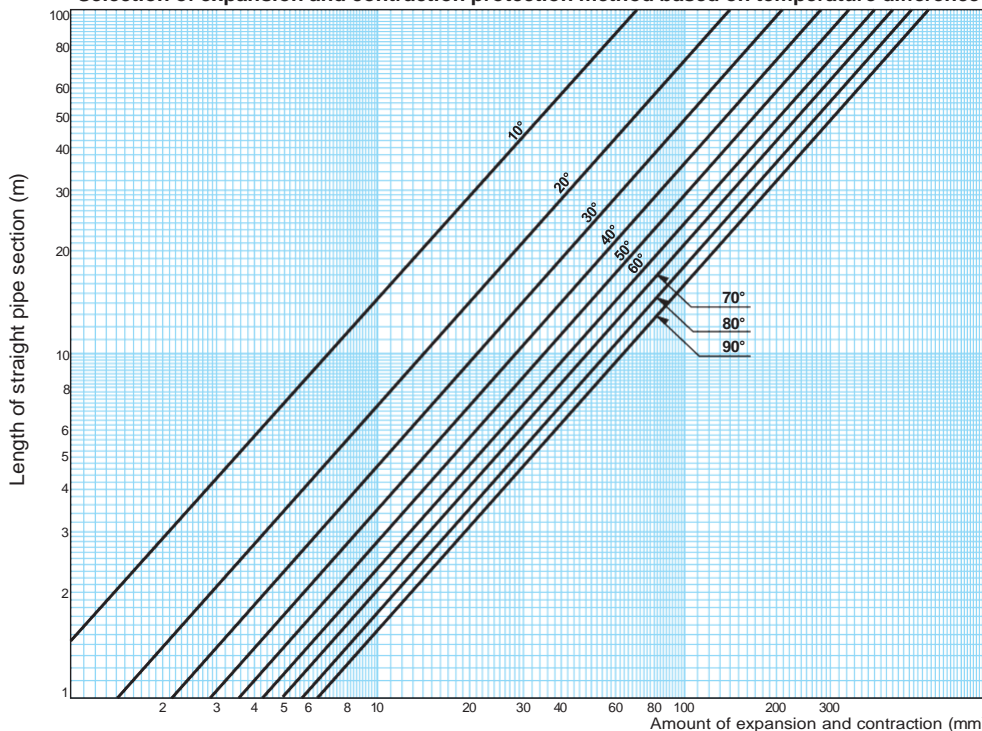

Supporting length per expansion fitting

Unit : m

Expansion fitting \ Temperature difference (°C)	80	60	40
Thermal-resistant expansion joint	12.0	16.0	25.0
90° Bend	1.7	2.3	3.5
180° Bend	3.6	5.0	7.2
Loop Bend	5.0	6.8	10.0
U-shape expansion pipe loop	7.0	9.5	14.0


Thermal-resistant expansion joint, 1 piece	2 pieces	3 pieces
90° Bend, 1 piece	Loop Bend, 1 piece	2 pieces
	U-shape expansion fitting, 1 piece	2 pieces
180° Bend, 1 piece		

Note Secure one side of the 90° Bend at a location 50 cm away using a fixed support.  
180° Bend is combined with a 90° Bend.

## 1.6 Pipe Supports

### (1) Maximum support pitch

The elastic modulus of HT pipe decreases as the temperature increases. To ensure the pipeline reliability, make the support pitch less than the value shown in the table.

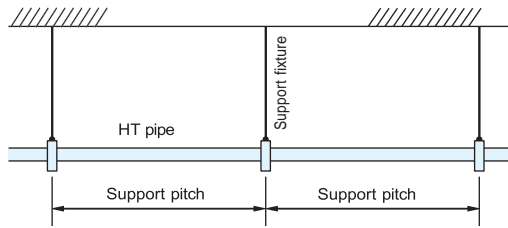


Unit : cm

Nominal Dia.(mm)	Maximum operating temperature 85°C
13	55
16	60
20	65
25	70
30	75
40	85
50	95
65	95
75	110
100	120


### (2) Support method

Either loose supports, which allow the movement of the pipe in the axial direction, or fixed supports, which constrict the pipe movement, are used to support HT pipes. Although loose supports are used in general, always use fixed supports at interval locations equal to the supporting pitch required for each expansion fitting determined based on the temperature difference, at locations near branching sections, and at elbows.

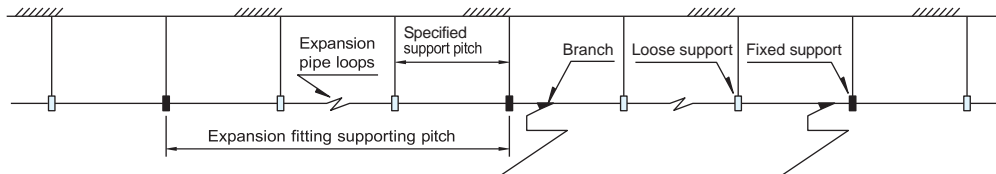


#### Examples of loose support

When using loose supports, provide Min. 10 cm space between the joint and supporting fixture in order to prevent the joint from contacting the support fixture when the pipe expands.

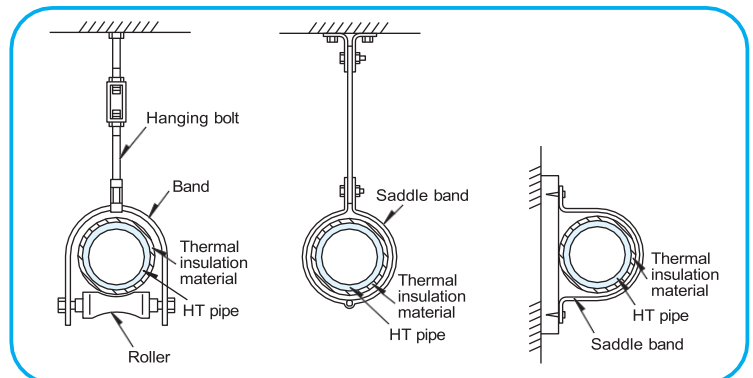

#### Examples of Fixed support

When installing a pipe to a fixed support, use a saddle band with wider than the pipe outside diameter. If a U-bolt is used, local stress will be generated and cause pipe deformation. Also, place a rubber sheet between the pipe and saddle band and secure the pipe directly in place, and then cover the pipe with a thermal insulation material if necessary.

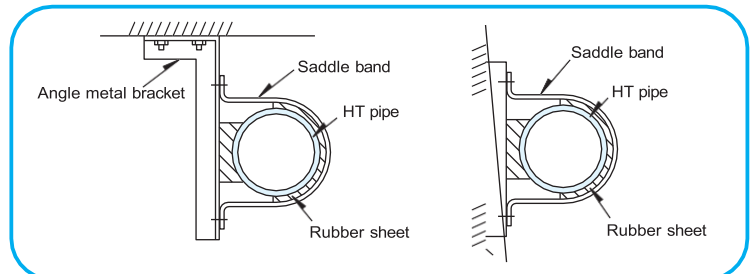


⚠ The rubber sheets used must not contain any plasticizer.

## 1.7 Standard Piping Diagrams

### (1) Examples of expansion and contraction protection


\* Depending on the conditions of construction site, the most suitable method may not be indicated. Consult our company for details.

#### A Loop Bend

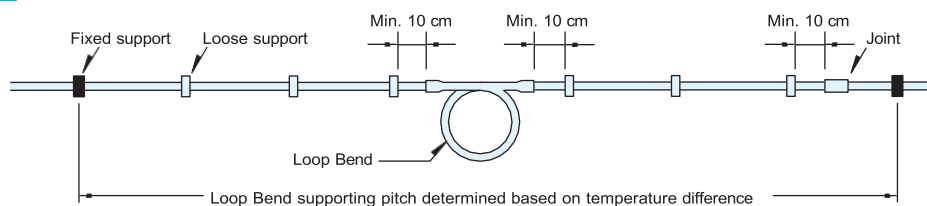


- The pitch of loose supports must be less than the maximum support pitch determined based on the operating temperature.
- Position the loop bend section horizontal or downward. If the loop bend is installed upward, air will be trapped inside the pipe.
- This method cannot be used for riser pipes.

## B U-shape expansion pipe loop

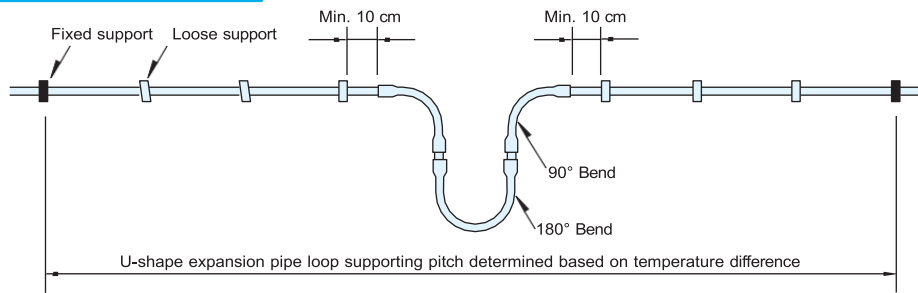

- Position the U-shape expansion pipe loop section horizontal or downward.
- This method can be used for riser pipes.

## C Thermal-resistant expansion joint

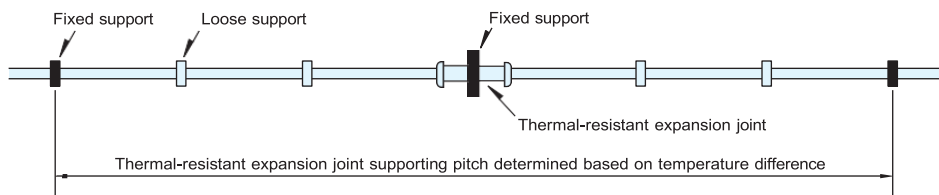


- Do not use thermal-resistant expansion joints in concealed locations such as above ceiling or under floor because it will be difficult to maintain the joints installed in concealed places.
- Be sure to secure the thermal-resistant expansion joints firmly in place.
- The pipe butt gap in the thermal-resistant expansion joint must be as follows:  $\frac{\theta_1 - \theta_2}{\theta} \times 50 + 10$  (mm); where  $\theta$  is the maximum temperature difference in the pipe,  $\theta_1$  is the temperature of hot water, and  $\theta_2$  is the temperature of the pipe at the time of installation.

## (2) Examples of pipe installation at bending section


### A Elbow

- Be sure to use fixed supports at locations near the elbows.
- When using two elbows at the bending section, the distance between the elbows must not exceed 1 m.
- When connecting a joint or securing the pipe in place, do not apply any twisting, bending or pulling force. If excessive force is applied to the pipe, especially under low temperatures, damage can occur to the pipe or joint.

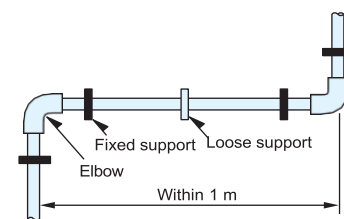


### B Elbow + Bend

- Secure the pipe at locations near both sides of the elbow and at a location near one side of the 90° Bend as shown in the diagram.
- The distance between the elbow and 90° Bend must be less than 2 m.

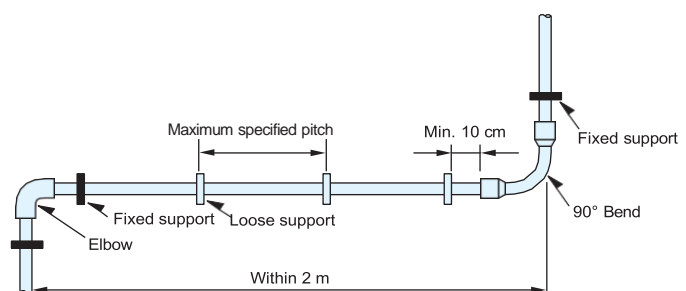


### C Bend

- Use a fixed support on a location near one side of the 90° Bend as shown in the diagram.
- The distance between the Bends must be less than 4 m.
- If the distance between the Bends exceeds 4 m for unavoidable reasons, form a loop bend, U-shape expansion pipe loop, etc.

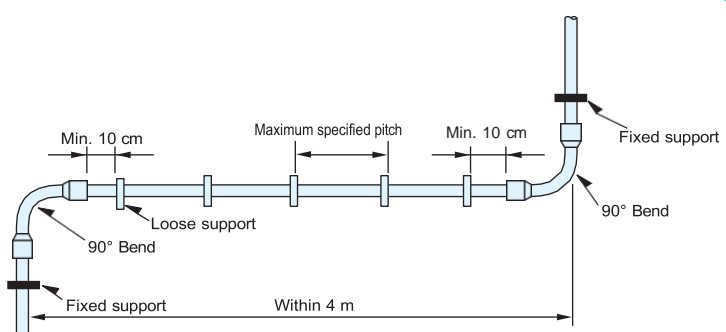

#### D 180° Bend


- Use a fixed support at a location near one side of the 180° Bend as shown in the diagram.
  - When providing expansion and contraction protection by combining a 180° Bend and a 90° Bend, the distance between the fixed supports must not exceed 6 m.
- \* Regarding the maximum support pitch, refer to "(1) Maximum support pitch" above.

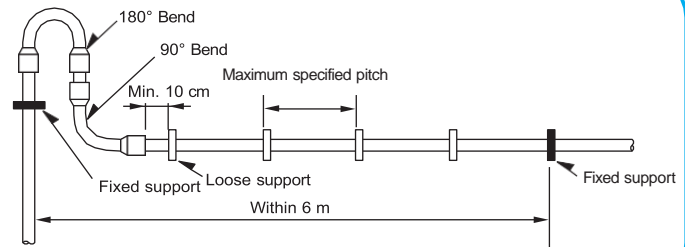

### (3) Examples of pipe branching


#### A Method of bracing pipe from main pipe

- Use a fixed support at a location near the branching section.
- If a fixed support cannot be used, connect the branching pipe at a location near a fixed support and route it to the water supply point.

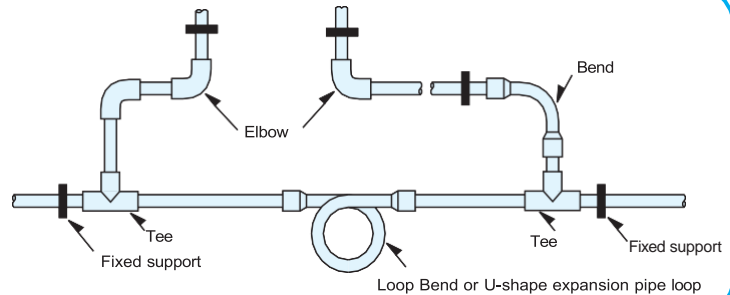

#### B Branching pipe installation


- When two elbows are used, install the pipes on the same plane in order to prevent excessive force from being applied to the pipes or joints.
- A continuously bending section is subject to vibration caused by water hammer. Install a fixed support within 1 m from the branching point.
- When a swing pipe is provided by using fittings at two or more locations, use 90° Bends instead of elbows.
- A continuously bending section is subject to vibration caused by water hammer. Install a fixed support within 1 m from the branching point.

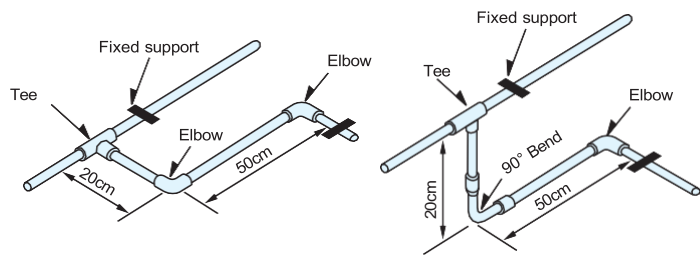

### (4) Accessories and connection examples


#### A Connection to copper/steel pipe

- Use a valve socket with metal insert (HT-MVS), and use a copper pipe female adaptor when connecting to a copper pipe and use a steel pipe socket when connecting to a steel pipe. Do not connect a steel pipe with tapered threads to a hydrant socket with metal insert (MWS) or hydrant elbow with metal insert (MWL).

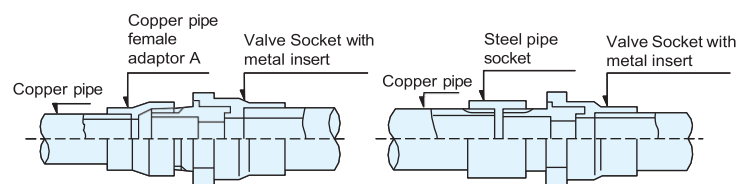

#### B Connection to valve

- Use a valve socket with metal insert when connecting to a screw-in valve.
- To connect to a flanged valve, use a screw-in flange and connect in the same way as with a screw-in valve.

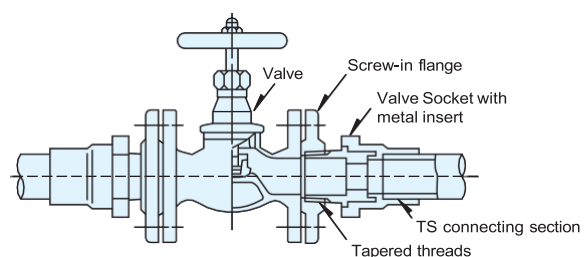

## 2. Installation Design for Drain and Vent Pipes

### 2.1 Installation design

#### **(1) Pipeline must be protected against expansion and contraction**

A PVC-U pipe expands and contracts by about 0.07 mm per meter when the temperature changes by 1°C.

If there is a large temperature difference in the ambient temperature or in the water flowing in the installed drain pipeline, the pipe must be protected against expansion and contraction. Pipes are in a fully expanded condition when they are installed during the mid-summer. Therefore, when the pipes installed in summer contract during the winter and large force is applied to the fittings. This causes breakage in some cases. Be sure to include expansion fittings when designing pipe installation.

#### **(2) Drain water temperature must be lower than 60°C.**

Make sure that the temperature of drain water is lower than 60°C. For drain pipelines for high-temperature miscellaneous waste water, avoid draining high-temperature water or take a measure to reduce the water temperature below 60°C. (\* As a general rule, take a measure to reduce the water temperature to lower than 45°C before drainage.)

#### **(3) DV fittings must not be used on pressurized pipelines.**

DV fittings are designed for use on drain or vent pipes. Do not use DV fittings on pressurized pipelines. Using DV fittings on a pressurized pipe may cause water leakage or damage to fittings.

# III Bonding Techniques

## 1. Bonding HI-TS and TS Products

Cutting the pipe

### 1 Draw a cut line.



Draw a cut line around the pipe, using a wide piece of thick paper or tape.

### 2

### Cut the pipe.

#### Cut with a power disc saw



#### Cut with a disc sander



#### Cut with a PVC pipe saw



Cut the pipe along the cut line at right angles to its longitudinal axis.

Chamfering

#### Chamfer with a disc sander



#### Chamfer with a rasp



#### Chamfer with a Chamfering tool (commercially available)



#### Chamfer with a reamer (commercially available)



The edge should be chamfered as the table below.

Drawing a marker line for inserting the pipe



After chamfering the pipe edge, draw a marker line around the inserting end of the pipe with a marker pen to show the insertion length. Draw the line all around the pipe as possible.

#### • Zero point and bonding length (for nominal diameters 50 and more)

(The position where the pipe stops after lightly pushing the inserting end into the socket)

The position of the marker line is obtained by adding the zero point length to the bonding length in the table on the right, and should be marked with a marker pen.

⚠ For nominal diameters 40 and less, insert the pipe up to the stopper located in the socket.

#### Bonding lengths for nominal diameters 50 and more

Units: mm	
Nominal Dia.	Bonding length
50	20
75	25
100	30
125	35
150	45
200	70
250	85

#### Typical insertion lengths for nominal diameters 40 and less

Units: mm	
Nominal Dia.	Fitting insertion length
13	26
16	30
20	35
25	40
30	44
40	55

#### Chamfer dimension

Units: mm	
Nominal Dia.	30 and more
40-65	2
75-150	5
200 and less	10

⚠ If a pipe and a joint are bonded together without the edges chamfered, a film is formed back in the inserted end and the pipe line may become clogged.

## Bonding (for nominal diameters 40 and less)

### 1 Clean the surface.



Clean the inner surface of the fitting and the outer surface of the inserting end of the pipe with a dry cloth.

### 2 Apply the adhesive.



Apply the adhesive evenly and thinly in the circumferential direction around the inner surface of the fitting first and then the outer surface of the inserting end of the pipe.

### 3 Insert the pipe.



Insert the pipe straight into the fitting up to the marker line without a pause immediately after applying the adhesive. Hold the fitting and the pipe together for at least 30 seconds.

### 4 Bonding completion.



After bonding the pipe to the fitting, remove any adhesive coming out of the joint surface immediately. Do not apply unreasonable force to the joint.

## Bonding (for nominal diameters 50 and more)

### 1 Clean the surface.



Clean the inner surface of the fitting and the outer surface of the inserting end of the pipe with a dry cloth. Position the wire and fastener in advance.

### 2 Apply the adhesive.



Apply the adhesive evenly and thinly in the circumferential direction around the inner surface of the fitting first and then the outer surface of the inserting end of the pipe.

### 3 Insert the pipe.



Insert the pipe straight into the fitting up to the marker line without a pause, immediately after applying the adhesive. Hold the fitting and the pipe together.

### 4 Bonding completion.



After bonding the pipe to the fitting, remove any adhesive coming out of the joint surface immediately. Do not apply unreasonable force to the joint.

⚠ Sand, water or oil on the surface to be bonded may cause faulty bonding.

⚠ In the summer two persons should work together as much as possible to work quickly and prevent the adhesive from drying during this process.

⚠ Do not hammer the pipe into the fitting. This may damage the pipe.

⚠ After the bonding work, ventilate the work area to remove any solvent gas.

#### Typical holding time required to bond TS products

Nominal Dia.	50 and less	65 to 150	200 and more
Typical holding time	At least 30 sec.	At least 60 sec.	At least 1 min. in summer At least 3 min. in winter

## Bonding HT-TS Products

### 1 Cutting the pipe



Determine the cutting length of the pipe, considering the insertion length of the fitting. When drawing a cut line, wrap a wide piece of paper around the pipe to ensure that the cut surface will be at right angles to the longitudinal axis of the pipe. Draw the line all around the pipe with a felt-tip pen.

Use a saw with fine teeth. Cut the pipe shallowly all around the circumference rotating the pipe.

### 2 Chamfering



Chamfer the pipe to remove burrs and shavings produced by the cutting work on the inner and outer edges, using a chamfering tool or a rasp.

Always chamfer the cut surface.

Otherwise, when the pipe is inserted, the adhesive on the surface of the fitting will be removed by the cut edge, leading to potential pipe clogging.

### 3 Drawing a marker line




Measure the joint length of the fitting. Draw a marker line around the inserting end of the treated pipe.

**Note: The insertion length of the fitting varies with the product types. Always measure the length of the fitting and draw a marker line.**

For nominal diameters 50 and more, the position of the marker line should be obtained by adding one-third of the insertion length to the zero point length.

#### • Zero point and bonding length

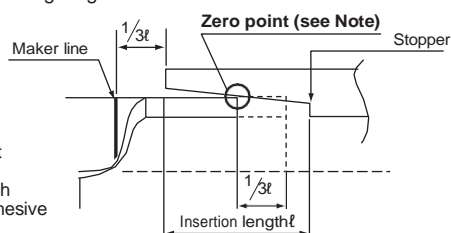

**Note:** The zero point indicates the insertion length before the adhesive is applied.

### 4 Cleaning



Clean the inner surface of the fitting and the outer surface of the inserting end of the pipe with a dry cloth. Dirty surface may cause leakage or the disconnection of the pipe and fitting.

Wipe off any oil with a small amount of acetone or alcohol. Be careful not to touch the bonding surfaces with oily or wet gloves.

### 5 Applying the adhesive



Always use Tough dyne HT. Do not use other adhesives.

Apply the adhesive evenly and thinly around the inner surface of the fitting first and then the outer surface of the inserting end of the pipe. Do not apply the adhesive excessively to the inner surface of the fitting.

Excessive adhesive will be pushed into the pipe when the pipe is inserted, which leads to potential cracking (solvent cracking).

#### • Amount of adhesive to apply (reference)

Nominal Dia.	13	16	20	25	30	40	50	65	75	100	125	150
Amount	0.6	0.8	1.1	1.6	2.1	3.3	4.8	6.6	8.1	13	20	30

g/surface

Notes: 1. The above values are for use on each of the inserting surface of the pipes and the surface of the socket.

2. Prepare 20 to 30% more required amount of adhesive, taking into account the expected loss in actual use.

### 6 Bonding the pipe to the fitting



Push the pipe into the fitting tightly. Check the positions and orientations of the pipe and the fitting, and align their axes so that there is no twisting. Insert the pipe straight into the fitting up to the marker line without a pause. Hold the fitting and the pipe together for the time shown in the table below.

After bonding the pipe to the fitting, immediately remove any adhesive coming out of the joint surface.



#### • Typical holding time

Nominal Dia.	Time
50 and less	At least 30 sec.
65 - 150	At least 60 sec.

**Due to the tolerance of the fitting, the pipe may not be inserted in to the marker line. If this is the case, stop inserting the pipe there. Do not hammer the pipe into the fitting. The fitting will be subject to large load and may crack.**


### 7 Treatment after bonding

During the bonding work, open both ends of the pipe to remove the solvent vapor of the adhesive from the pipe by natural ventilation or using a blower. Do not move the bonded pipe and fitting for 15 to 30 minutes. If a bending or tension force is applied to the joint immediately after bonding, the bonded surfaces will be separated.

After the bonding work, fix the pipe and provide protection against expansion. Check any parts that came into contact with chemicals, such as creosote, to prevent accidents after start of use.

## 3. Bonding DV Products

### 3.1 Bonding DV products

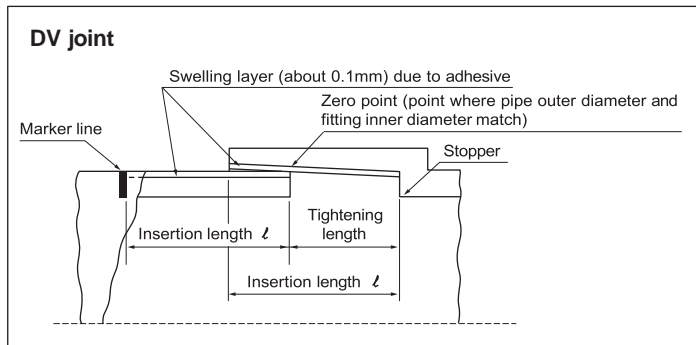

- Most PVC drain pipes can be joined together using DV fittings. This technique is generally called TS connection, which a pipe is bonded to a DV fitting with a tapered inserted end, using the swelling of the PVC pipe due to the adhesive as well as the elasticity of the pipe.

- When a PVC adhesive is applied to a pipe and fitting, a 0.1 mm thick swelling layer is formed on the surface. These layers facilitate the insertion of the pipe into the fitting. After insertion, the swelling layers of the pipe and the fitting mix and melt to combine the bonding surfaces, resulting in excellent water tightness.
- The insertion lengths of DV fittings are shorter than those of pressure pipe fittings, and the taper angles are smaller than those of pressure pipe fittings (for nominal diameter up to 150 mm). These allow a pipe to be inserted right up to the stopper, forming a flat joint surface. The inner corners of elbows and Y-fittings are round enough to ensure a smooth flow of effluent.


**Note:** DT fittings are designed for drain and vent applications, and should not be used for pressure pipe applications.

### 3.2 Cutting and chamfering

- Determine the cutting length of the pipe, considering the insertion length of the fitting. Draw a cut line all around the pipe with an oil-based pen to ensure that the pipe will be cut at right angles to the longitudinal axis of the pipe. Use a wide piece of paper or tape when drawing the line.



- Use a saw with fine teeth. Cut the pipe evenly and shallowly all around the circumference along the cut line rotating the pipe.

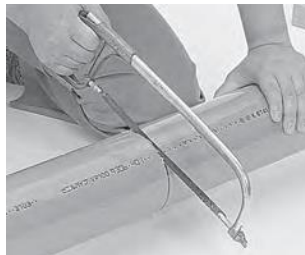

- Remove burrs and shavings on the cut surface. Chamfer the outer circumference with a chamfering tool (about 1 mm size) or a rasp.



- After chamfering the pipe end, measure the insertion length of the fitting and draw a marker line with an oil-based pen.



### 3.3 Bonding

- Clean the inner surface of the fitting and the outer surface of the inserting end of the pipe with a dry cloth. Wipe off any oil on the pipe with thinner. Make sure that the pipe end has been treated and a marker line indicating the insertion length has been drawn on the pipe.



- Apply the adhesive thinly and evenly to the inner surface of the fitting first and then the outer surface of the inserting end of the pipe. For pipes with large nominal diameters, put the adhesive into a larger can and use a larger brush to work efficiently. An animal hair brush should be used. A plastic brush will melt, which reduces the adhesion of the adhesive.



- After applying the adhesive, immediately push the pipe into the fitting lightly, and align their axes so that there is no twisting. Then, insert the pipe straight into the fitting to the marker line without a pause.

For pipes with larger nominal diameters, two persons should work together to ensure that the pipe is inserted in the fitting to the stopper. Do not hammer in the pipe.

- Always keep the force holding the fitting and the pipe together applied for a while after bonding them. Otherwise, the pipe may be disconnected from the fitting due to the tapered inner surface of the fitting. The holding time varies with the amount of adhesive applied, dimensional tolerance and temperature. Typical holding times are shown in the table below. Remove any adhesive coming out the joint surface immediately.



#### Typical holding time for DV fittings

Nominal Dia.	150 and less	200 and more
Holding time	At least 30 sec. in summer At least 60 sec. in winter	At least 1 min. in summer At least 3min. in winter

Note: For nominal diameters 200 and more, Tough dyne Yellow, a high-viscosity, slow drying adhesive for large pipes, is typically used. Therefore, the holding time becomes longer.


## IV Preventing Solvent Cracking

Solvent cracking is a phenomenon which hairline cracks occurs when a solvent is added to objects.

The hairline cracks would grow larger after starting the service and increase the possibility of leakage. For PVC-U or PVC-C pipes, the possibility of leakage increases particularly when the following factors occur.


When all these factors are combined, the possibility increases furtherer.

### ● Pipe clogging after bonding (adhesive residue)

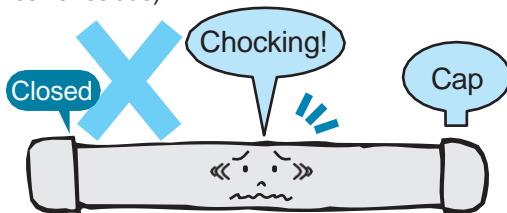

### ● Presence of solvent


Adhesive coming out of the inner surface of the pipe due to excessive adhesive applied or the presence of chemicals that have adverse effects (such as preservatives) on the surface

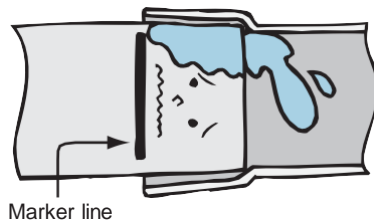

### ● Unreasonable stress being applied (Thermal stress, pipe flattening, pipe bending)



### ● Low temperature below 5°C (Particularly piping work in winter)

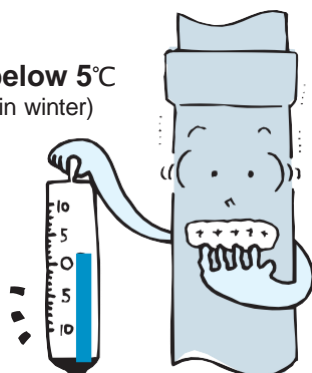


## Preventing solvent cracking

### During bonding work


**Position to apply the adhesive on the outer surface of the pipe**

⚠ Do not apply the adhesive beyond the marker line.

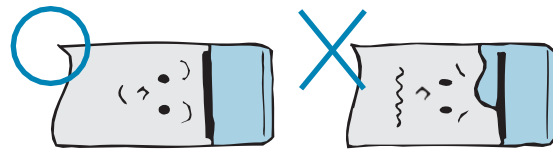


**Adhesive coming out to the pipe inner surface**

⚠ Apply the adhesive thinly and evenly to the inner surface of the TS fittings.

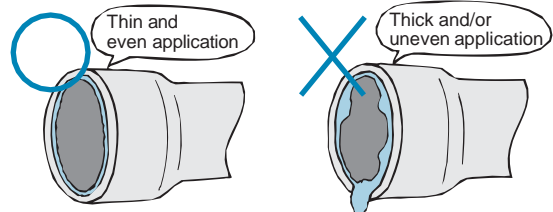

**Removing excessive adhesive**


⚠ After inserting the pipe into the fitting, remove adhesive coming out of the joint surface with a cloth.

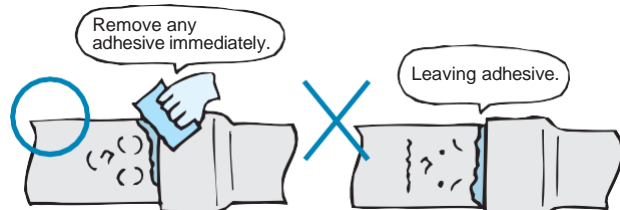

### During piping work


**Use bends**

⚠ Use bends at pipe corners. Do not bend the pipe.

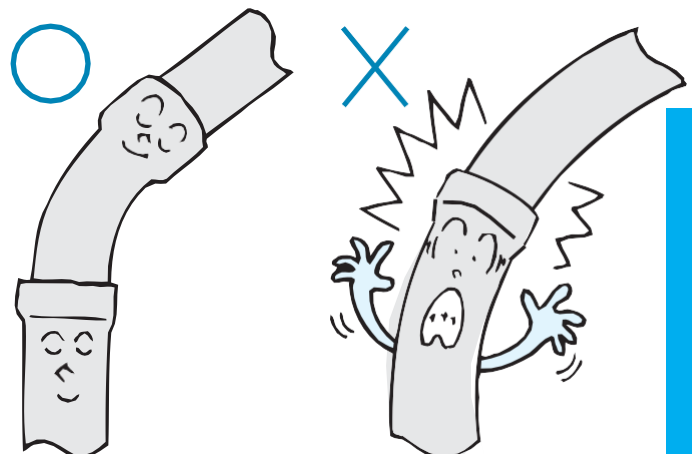


## Pipe supports

⚠ When supporting the pipe with saddle bands, use wide fastener bands. Do not use U-bolts. Be careful not to tighten the bands excessively.

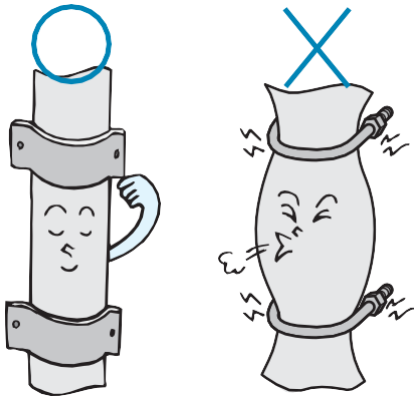

## Backfilling


⚠ Backfill the pipe as quickly as possible to prevent thermal stress due to temperature differences or external impact. (Do not let the pipe get cold.)

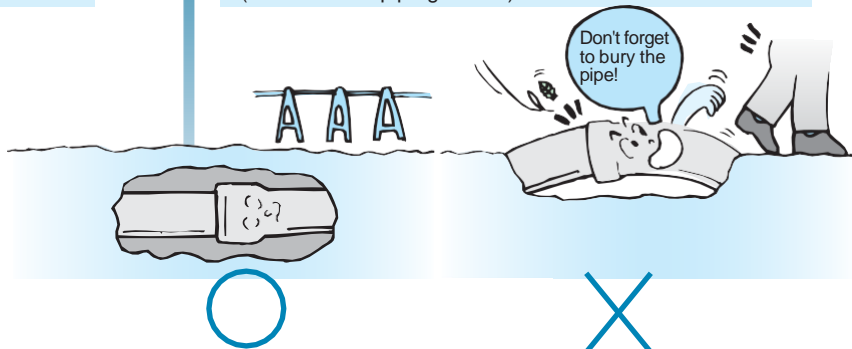

## Removing the solvent gas after bonding work

### Ventilation


⚠ After bonding work, remove the solvent gas using a blower (low pressure type) or other means.

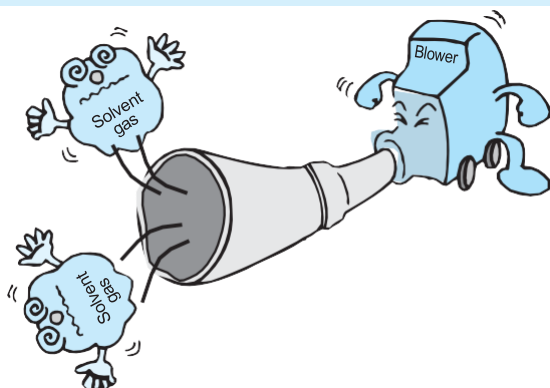

### Washing with water avoiding water pressure in the pipe

⚠ Pour water into the pipe 30 minutes after the bonding work for nominal diameter 50 and less and one hour after the bonding work for nominal diameters 65 and more. Do not make any water pressure in the pipe.

### Opening the pipe ends

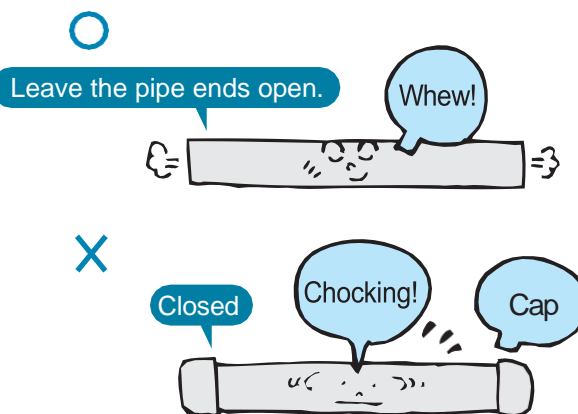


⚠ Do not close the pipe ends. Leave them open to remove the adhesive vapor.

## Other important information

There is a recently developed technique which installs a PVC-U or PVC-C pipe through an interior wall and then the gap between the pipe and the wall is filled with a sealant. Some sealants contain a plasticizer, such as DOP and phthalate ester, or a solvent such as xylene and toluene, which may cause solvent cracking to PVC pipes. Usually, these plasticizers and solvents are contained in polyurethane sealants but not in silicon sealants.

However, plasticizers and solvent may be added to silicon sealants to improve their performance in the future. It is advisable to contact the sealant manufacturer for details.

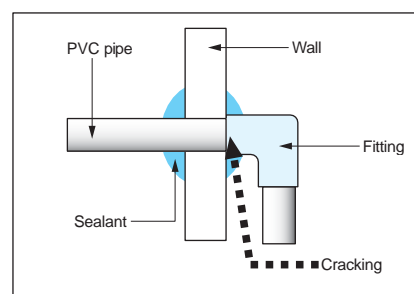

# V User Instructions

This section is about do's and don'ts in order to make the most of the performance of Okubo Plumbing Co., Ltd PVC-U or PVC-C pipes and fittings. Please read carefully and use the instructions in the safety manual where appropriately.

## ● Please observe the following instructions.

Classes of actions are represented by the following graphic symbols.



indicates that the action needs to be taken carefully.



indicates that the action is prohibited.



indicates that the action must be taken.

## 1. Instructions for the treatment of left-over material and scraps



### No on-site burning

Do not burn PVC pipes and fittings on site. Toxic chlorine gas will be released into the air, by burning.



### Laws and regulations

Left-over and scrapped PVC pipes and fittings should be treated according to local laws and regulations. Do not crush leftovers and scraps with a hammer. Crushed pieces may fly away.

## 2. Carrying instructions



### Wear gloves

Wear rubber-coated gloves with a firm grip to prevent injury.



### Careless handling is dangerous

Large PVC pipes are heavy. Also, PVC pipes which are bundled together can be heavier than expected. Handle them with care to prevent injury. Careless handling is dangerous.



### Careful handling

When loading and unloading the PVC pipes from truck, do not throw or drag PVC pipes into the truck. Handle with care to prevent scratches and damage to the pipes and injury.



### Prevent collapsing during transport

Take measures to stop ropes from becoming loose or coming off to prevent pipes from falling off the truck.



### Do not step on pipes

Do not step on pipes. The surface of PVC pipes is slippery, which may lead to an accident.



### Carefully lift and lower pipes

If a truck with a hoist is used, balance the load when lifting to prevent injury.



### Use a cushion

Place cushions between pipes and the truck bed and on the parts of a pipe that are secured with a rope to prevent scratches and deformation.

## 3. Storage instructions



### When storing pipes horizontally indoors

When storing PVC-U or PVC-C pipes, pile them in a crisscross pattern or in a staggered pattern to prevent them from warping or deforming. Put stoppers at the pipe ends to prevent the pile from collapsing.



### Storing pipes vertically

When there is no choice but to store pipes vertically, take measures to prevent them from falling over, such as securing them with ropes.



### When storing pipes outdoors

When storing pipes outdoors, put a simple roof over the storage area or an opaque sheet on the pipes to block direct sunlight. When a sheet is used, provide a good air flow.



### Storing fittings

Fittings should be stored indoors with the pipes. When there is no choice but to store them outdoors, put a sheet over them to protect from sunlight. Always put a cover on fittings with a rubber ring to protect from direct sunlight which will degrade the performance quality of rubber rings.

## 4. Installation instructions

Pipes and fittings should be installed using the standard installation techniques recommended by Okubo Plumbing Co., Ltd, in order to ensure work safety and the performance of pipe lines. If installation conditions do not allow this, please contact us.



### Using the proper tools

Select tools with the proper specifications for tasks such as cutting, drilling and joining. Read and ensure that you fully understand the instruction manuals of the tools before using.



### Ventilation after bonding work

After bonding work, ventilate the bonded pipe well. Do not close the bonded pipe. Otherwise, solvent cracking or a bad odor may result. Solvent cracking is a phenomenon which hairline cracks occur in a PVC-U or PVC-C pipe due to residual solvent vapor in the adhesive. Residue of bad odor in drinking-water pipes affects the smell and taste of the water. It should be noted that, particularly in the winter, solvents do not easily evaporate and tend to remain in the pipe.



### Caution against the use of organic chemicals

PVC-U or PVC-C pipes and fittings can be eroded by organic chemicals, and should not be allowed to come into contact with creosote (wood preservative), termite and other pesticides or paint. If soil contaminated by these chemicals is expected along the pipe line route, take measures to protect against contamination by avoiding contaminated areas when installing the pipe line.



### Treatment for thermal expansion and contraction

For pipes bonded to fittings, expansion fittings should be used to prevent pipes from becoming disconnected from their fittings or damaged due to thermal expansion and contraction.



### Do not bend pipes

Do not bend pipes. Otherwise, the strain will remain, causing potential pipe rupture. If curved pipes are required, always use bends.



### About thrust protection

For buried pipes subject to hydrostatic pressure, thrust protection should be provided to prevent the pipes from becoming disconnected from their fittings at corners and branches. The standard installation technique recommended by the Japan PVC Pipe and Fittings Association and Okubo Plumbing Co., Ltd should be used.



### Do not heat pipes on site

Do not heat pipes on site. Pipes may become scorched or burnt, resulting in reduced strength.



### About protective insulation cover

Avoid installing pipes near steam and hot-water pipes in order to prevent deformation and damage due to high temperatures. If this is not possible, put a protective insulation cover around the pipe.



### Public space used for pipes

When pipes are buried under public roads, follow the burying standards or instructions provided by the road administrator. For siphon pipes across a river and pipes buried under railways, follow the instructions provided by the respective administrators.



### Squeeze-off tools

Squeeze-off tools for polyethylene pipes should not be used to repair small water pipes. The ductility of PVC-U or PVC-C pipes is smaller than that of polyethylene pipes. If water sealing work is carried out with squeeze-off tools, whitening due to plastic deformation may occur to the pipe which lead to damage in the future.



### Freeze protection

In cold regions, pipes should be buried 20 cm deeper than the maximum freeze depth. Thermal insulation should be wrapped around the exposed part of a vertical water pipe to protect against freezing.



### Cutting small pipes

Do not use a pipe cutter to cut small pipes. The cutter may cause chippings or deformation to the cut section of the pipe.

**Joining a hydrant**

Since a hydrant has parallel pipe threads, water cannot be sealed by inserting the threads into the female threads of a water fitting with sealing tape. When joining a hydrant to a water fitting, place a gasket between the hydrant flange (the face with the gasket on) and the water fitting.

**Do not thread PVC pipes and fittings**

Do not thread PVC-U or PVC-C pipes and fittings directly. These pipes have a large notch effect, and their strength decreases if cracks or notches are made.

**Use of lubricant specifically designed for joining fittings with a rubber ring**

A lubricant specifically designed for rubber rings should be used to joint fittings with a rubber ring to a pipe. Do not use adhesive or oil. It may damage the rubber ring.

**Insertion force joining pipes to TS fittings**

When joining a pipe to a TS fitting, unreasonable stress may be applied to the fitting depending on the dimensional combination of the pipe and the fitting if the pipe is inserted up to the stopper in the fitting. In terms of the relation between the bonding length and the pressure resistance, it has been confirmed that a practically sufficient hydrostatic resistance can be achieved by inserting the pipe up to one-third of the insertion length of the fitting from the insertion length position without any adhesive applied (zero point position). In order to prevent the bonded pipe from becoming disconnected from the fitting due to the elasticity of the pipe, the insertion force should be applied for over 30 seconds for nominal diameters 50 and less and for over 60 seconds for nominal diameters 65 and more.

**Joining steel pipes to fittings with a tapered female thread**

Do not insert the tapered male threads of a metal pipe into a hydrant fitting. The joint may be damaged. Normally, a metal socket should be joined to the tapered male thread of the metal pipe. Then, a valve socket should be joined to the metal socket. When strength is required for the inserted section, a valve socket with a metal male thread should be joined to the metal socket.

## 5. Instructions for handling PVC adhesive

**Do not use adhesives for other applications**

PVC and plastic adhesives were developed to bond PVC pipes to PVC fittings, and should not be used for other applications.

**Use of appropriate adhesives**

There are three types of adhesive: one for HI products, one for HT products and one for other products. The adhesives are designed to provide appropriate joint strength to pipes and fittings. Therefore, it is necessary to use the adhesive appropriate for the type of pipe.

**If adhesive enters the eye**

If adhesive enters the eye, do not rub the eye. Seek medical attention immediately.

**Storage according to laws and regulations**

Adhesives are hazardous substances under the Fire Defense Law. Follow applicable laws, regulations and municipal ordinances when storing adhesives.

**Ventilation and fire prevention**

When using an adhesive, ventilation should be provided to prevent intoxication. Also fire sources should be kept away from organic solvents.

**Use of gloves**

Wear gloves to protect against skin irritation and sores. Do not touch the adhesive directly. If the adhesive touches the skin, wash it off with soap and water immediately.

**Washing hands and gargling**

After using the adhesive, wash your hands and gargle well.

**Store in a cool and dark place away from fire sources**

Adhesives contain organic solvents. After using the adhesive close the lid of the can securely and store it in a cool and dark place indoors. Be sure to keep away from fire sources.

**Do not use old and expired adhesives**

Do not use an old and expired adhesive that has jelled or that has no pungent solvent odor. Do not thin the adhesive with thinner. This will decrease the adhesion, leading to the pipe disconnection from the fitting and causing leakage.

## About Us

### Japanese Leading Plastic Pipe Manufacturer with a History of more than 60 Years

Many products have been developed with various materials such as PVC-U, PVC-C, HDPE, MDPE, LLDPE, XPE and PB. Also many products apply to broad markets such as water supply/sewer systems, agricultural water systems, water supply/drainage systems inside buildings, power/communication cable protection and gas plumbing.

Today, we are Japanese leading plastic pipe manufacturer, offering more than 10,000 items with a nationwide sales network, and have the largest share in the market of PVC pipes in Japan.



Note: The information in this brochure may be revised any time without notice due to product improvements. Values without tolerances are baseline values.

Note: The color in the pictures may differ slightly from the actual color of the product due to printing limitations.

## OKUBO PLUMBING CO., LTD

Head Office: 9-8, Minami Tanaka 1-chome, Nerima-ku, Tokyo, Japan Tel. + 34 540 9800

Website: <http://www.okuboplumbing.com>

No. 

D	0	1
---	---	---

 - 

0	1
---	---

 (07.1.4.)  
16.12.0.5. IN. BS